



TRACK IS CANTILEVERED TO FLUTE

- Please read the UL listing HW-D-0872


a) Offset $\leq 0.5"$ - CFS-TTS MD OS & 600



b) Offset $0.5" - 1.5"$ - CFS-TTS MD OS & 600




c) Offset $> 1.5"$ - CFS-TTS MD OS & 600 + CFS-TTS MD C



- Install flute cover according to the instructions given in listing (HW-D-0873)



Please note that depending on track width and deck dimensions an offset situation can also occur on both sides of the track.

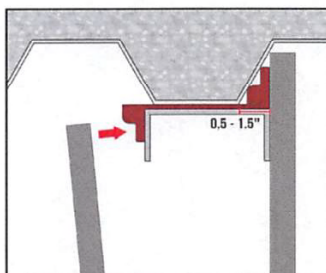

Version Date: 11/2021

TRACK RUNS DIAGONAL ACROSS FLUTING




- Please read the UL listing HW-D-0907

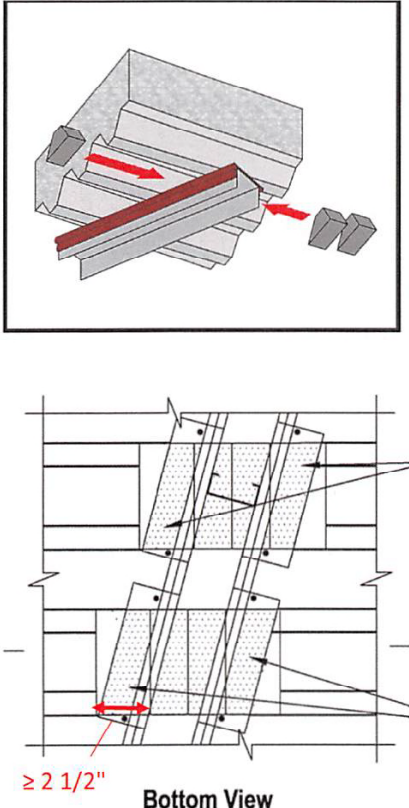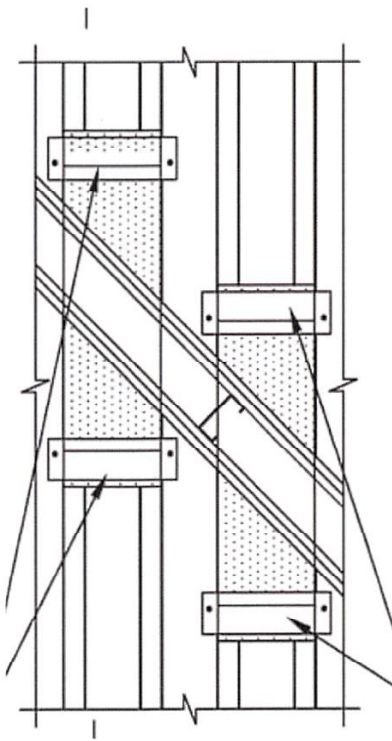a) CFS-TTS MD P	b) CFS-TTS MD P + CFS-TTS MD C
 Bottom View Flute plugs to extend a minimum 2 ½" (64mm) beyond the ceiling runner. The width of the strap should be adjusted as such that it properly supports the plug. Plugs should always be installed in a 90° angle, perpendicular to the flute.	Where steel straps are used, flute plugs to extend max ½ in. (13 mm) beyond steel straps at both sides of wall.  Bottom View


Version Date: 11/2021

CORNER INTERSECTIONS - PARALLEL & PERPENDICULAR

- Please read the UL listing HW-D-0871 (track perpendicular to flute) and the listing HW-D-0873 (track parallel to flute) and follow the instructions below to address corners.

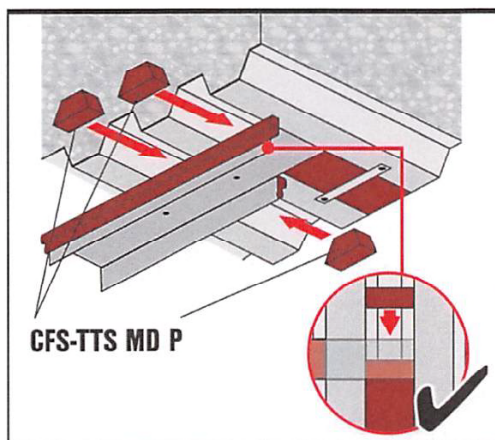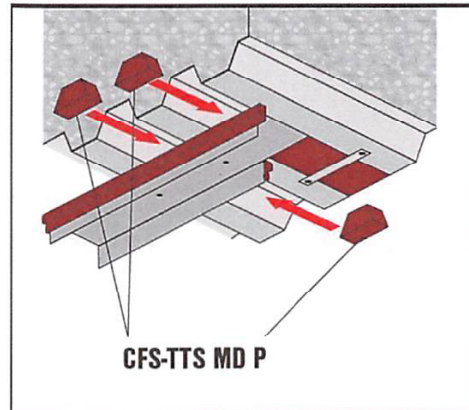
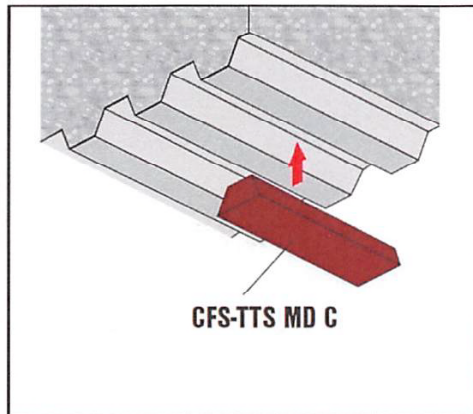


Version Date: 11/2021

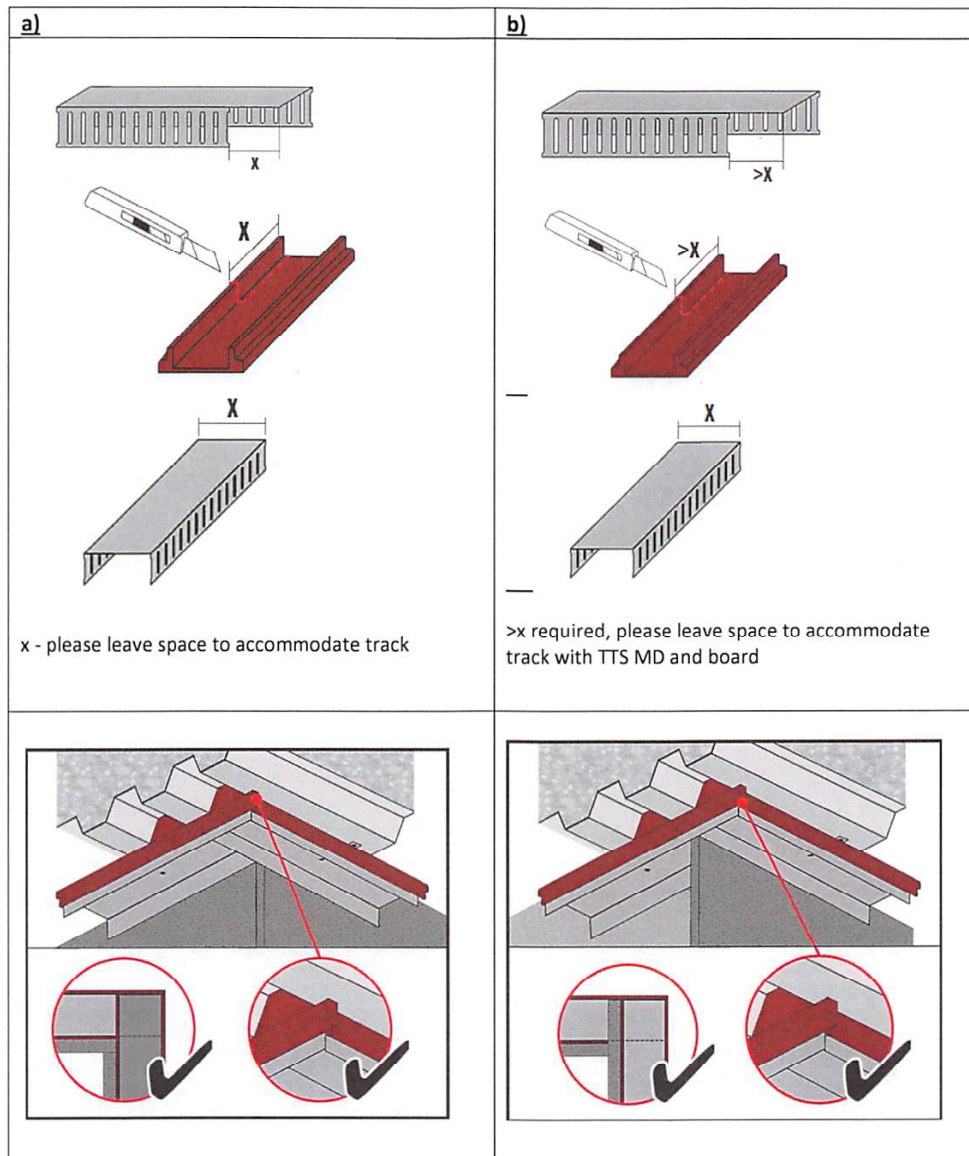

Version Date: 11/2021

TRACK IS PARALLEL UNDER I-BEAM WITH Z-CLIPS

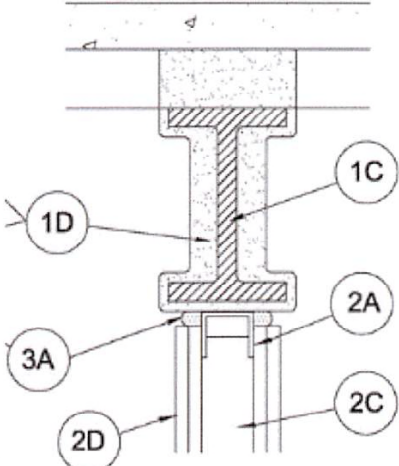
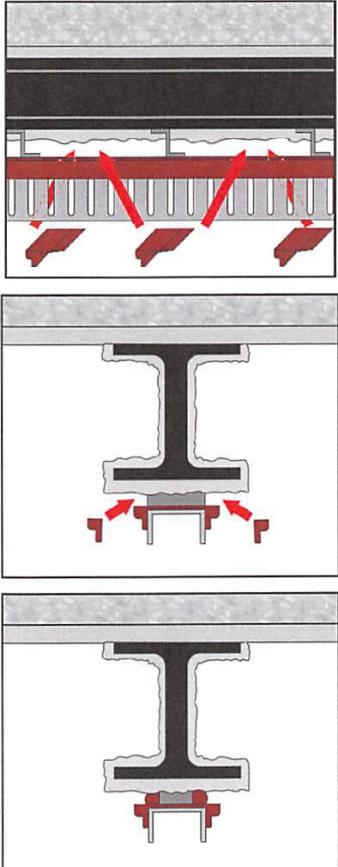
a) Gaps between track and beam filled with cementitious spray • Please read the UL listing HW-D-0875 	b) Gaps with width up to 1/2" between track and beam: (when void created by the Z-clips is not fully filled with cementitious fireproofing) • Compress CFS-TTS MD OS into gap on both sides of wall flush with track • Please request an EJ from our Hilti Fire Protection Engineering team for this installation situation 
---	--

Version Date: 11/2021


WALL AROUND FIREPROOFED BEAM / BAR JOIST

a) Around beam/bar joist using CFS-TTS MD OS

Please read the UL listing HW-D-0874

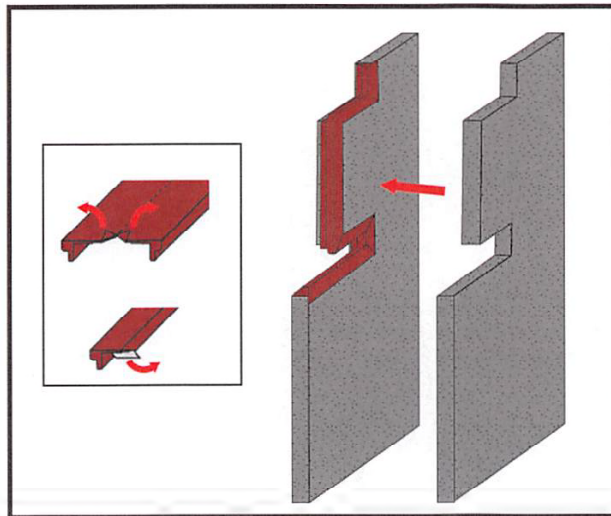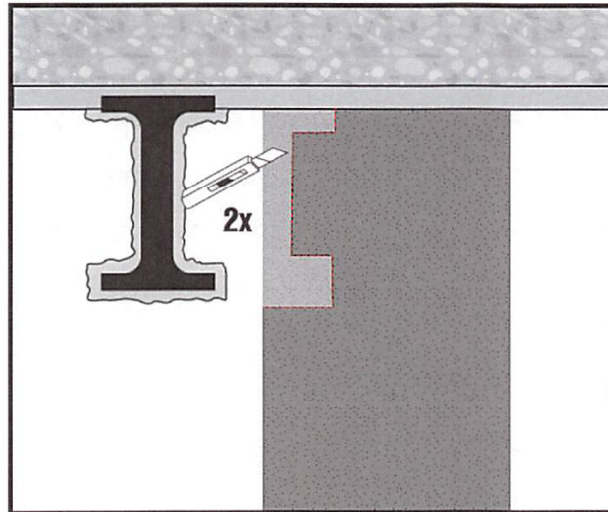


Version Date: 11/2021

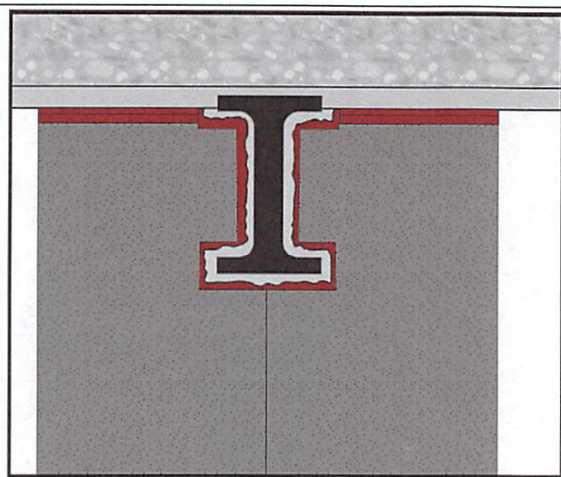

- For a one-hour wall with only one layer of drywall on each side, please request an EJ from our Hilti Fire Protection Engineering team for this installation situation

b) Around beam/bar joist using CFS-S SIL GG

- Please read the UL listing HW-D-0886
- Instead of using CFS-TTS MD OS to seal the joint around a fireproofed beam or bar joist, one could also use sealant installed at a depth of gypsum 5/8" or 1-1/4" of Hilti silicone sealant CFS-S SIL GG in up to a 3/4" maximum annular space

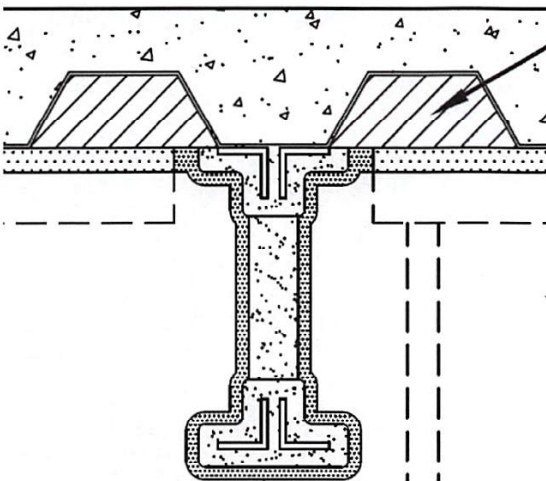


Version Date: 11/2021

WALL RUNNING PARALLEL OR OFFSET TO BEAM AND

PERPENDICULAR TO FLUTES


a) Wall running parallel to beam

- Please read the UL listing HW-D-0884
- CFS-TTS MD P plugs can be installed from one side (non-beam facing side)

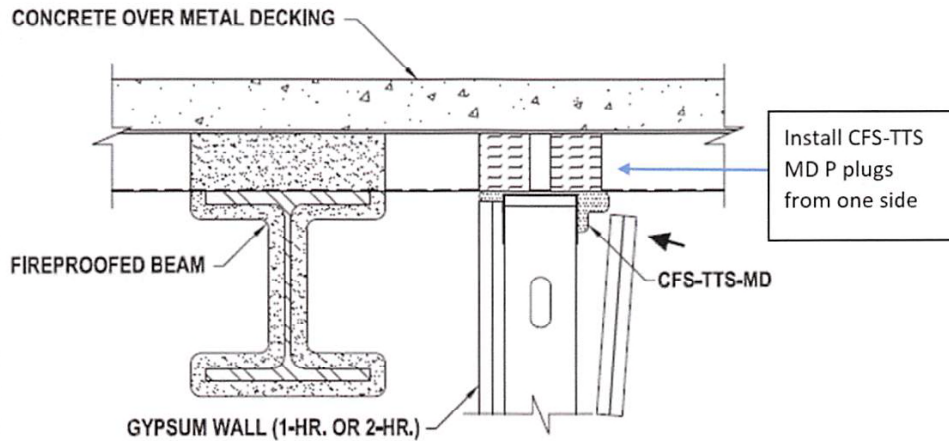


b) Wall running offset to beam up to deck

- Please request an EJ from our Hilti Fire Protection Engineering team for this installation situation

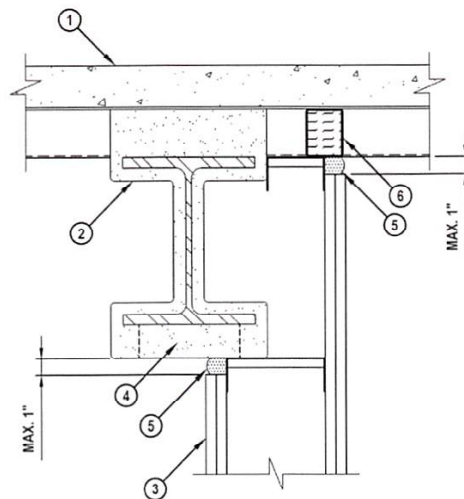


Version Date: 11/2021

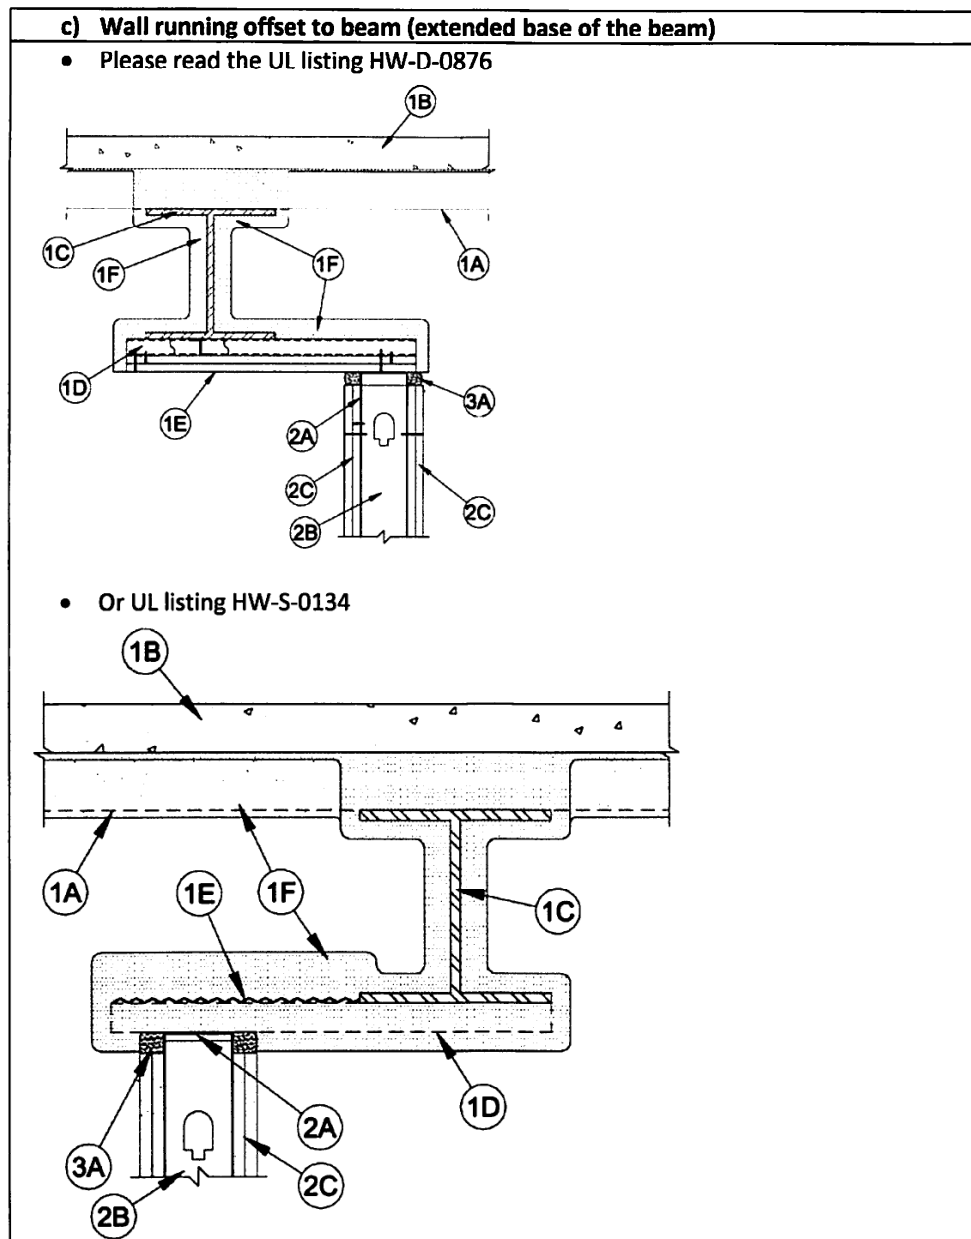

PIPE OR CAST-IN DEVICE INTERSECTING TRACK PERPENDICULAR


- Please read the UL listing HW-D-0871
- Please use min. 20ga steel plates butted against ceiling runner at both sides of wall to span the flute and support the projected flute plug
- If the pipe type is CPVC please contact pipe manufacture for compatibility

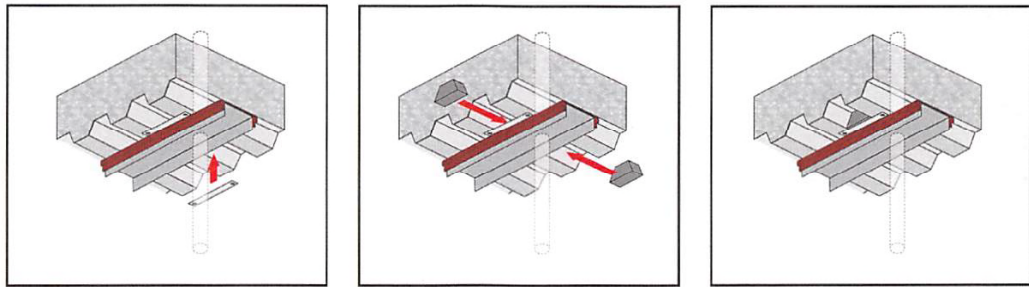

Version Date: 11/2021

PIPE OR CAST-IN DEVICE INTERSECTING TRACK PARALLEL

- Please request an EJ from our Hilti Fire Protection Engineering team for this installation situation
- If the pipe type is CPVC please contact pipe manufacture for compatibility

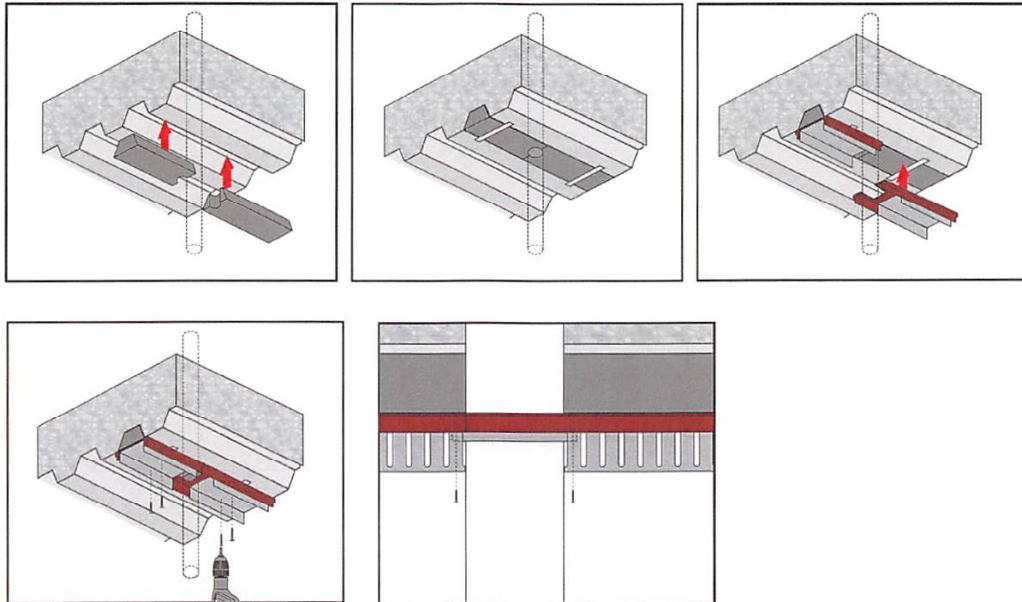


Version Date: 11/2021


SHAFT WALL

- Please read the UL listings HW-D-0881, HW-D-0882, HW-D-0883


HW-D-0881

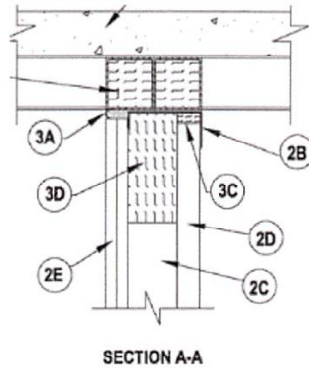

HW-D-0882

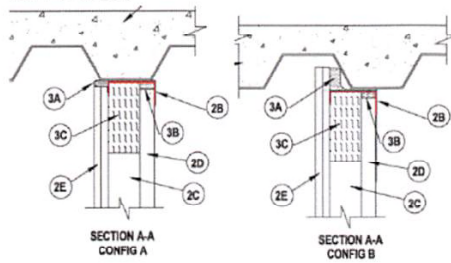

HW-D-0883

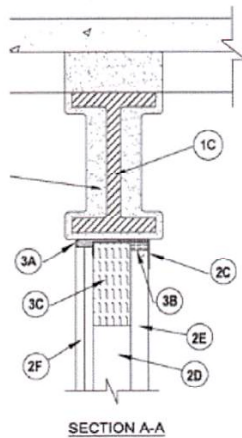


- For 2 1/2" shaft walls please request an EJ from our Hilti Fire Protection Engineering team

Version Date: 11/2021

RATED WALL TO THE UNDERSIDE OF A NON-RATED METAL ROOF

DECK


- Please request an EJ from our Hilti Fire Protection Engineering team for this installation situation
- Below picture refers to a min. 20 GA non fire-rated metal roof deck assembly

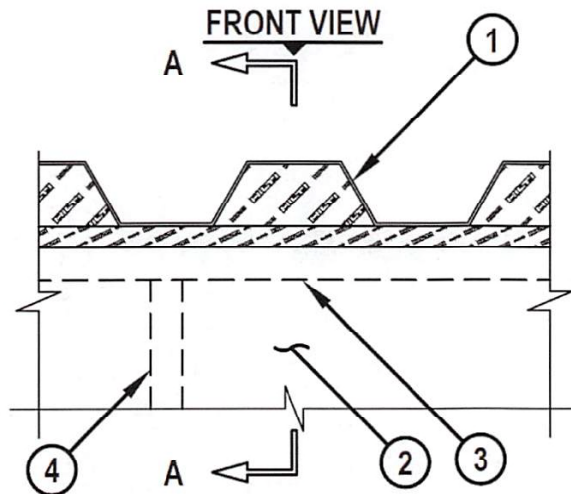

Version Date: 11/2021

NON-FIREPROOFED BEAM RUNNING PERPENDICULAR TO FLUTES

- Please request an EJ from our Hilti Fire Protection Engineering team for this installation situation
- The fire rating of the assembly is dependent upon the performance of the steel I-beam under fire conditions

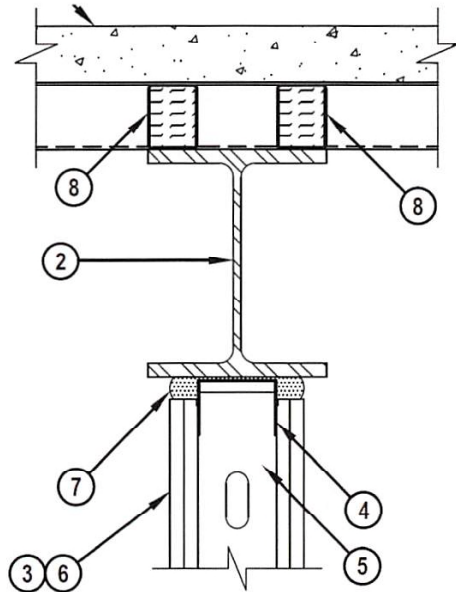

Hilti Firestop
Saving lives
through innovation
and education

Hilti North America
7250 Dallas Parkway Ste. 1000
Plano TX 75024
1-800-879-8000
www.hilti.com

Version Date: 11/2021

EXHIBIT O



CFS-TTS MD


2239499-11.2019

Top Track Seal CFS-TTS MDFirestop top track seal | Coupe-feu pour profils supérieurs
Perfil cortafuego de techo

qr.hilti.com/r9599576

UL: www.hilti.comcUL: www.hilti.cawww.hilti.group

- en** Before handling and for specific application details, refer to Hilti product literature, 3rd party published listings and national approvals. For professional use only.
- fr** Avant toute utilisation et pour tout détail concernant une application, se référer à la documentation Hilti, à la liste de publications des tierces parties et aux approbations nationales. Seulement pour utilisateurs professionnels.
- es** Antes de usar y para detalles específicos de aplicación, véase la información que acompaña al producto Hilti, el listado publicado por terceros y las aprobaciones nacionales. Solamente para los usuarios profesionales.

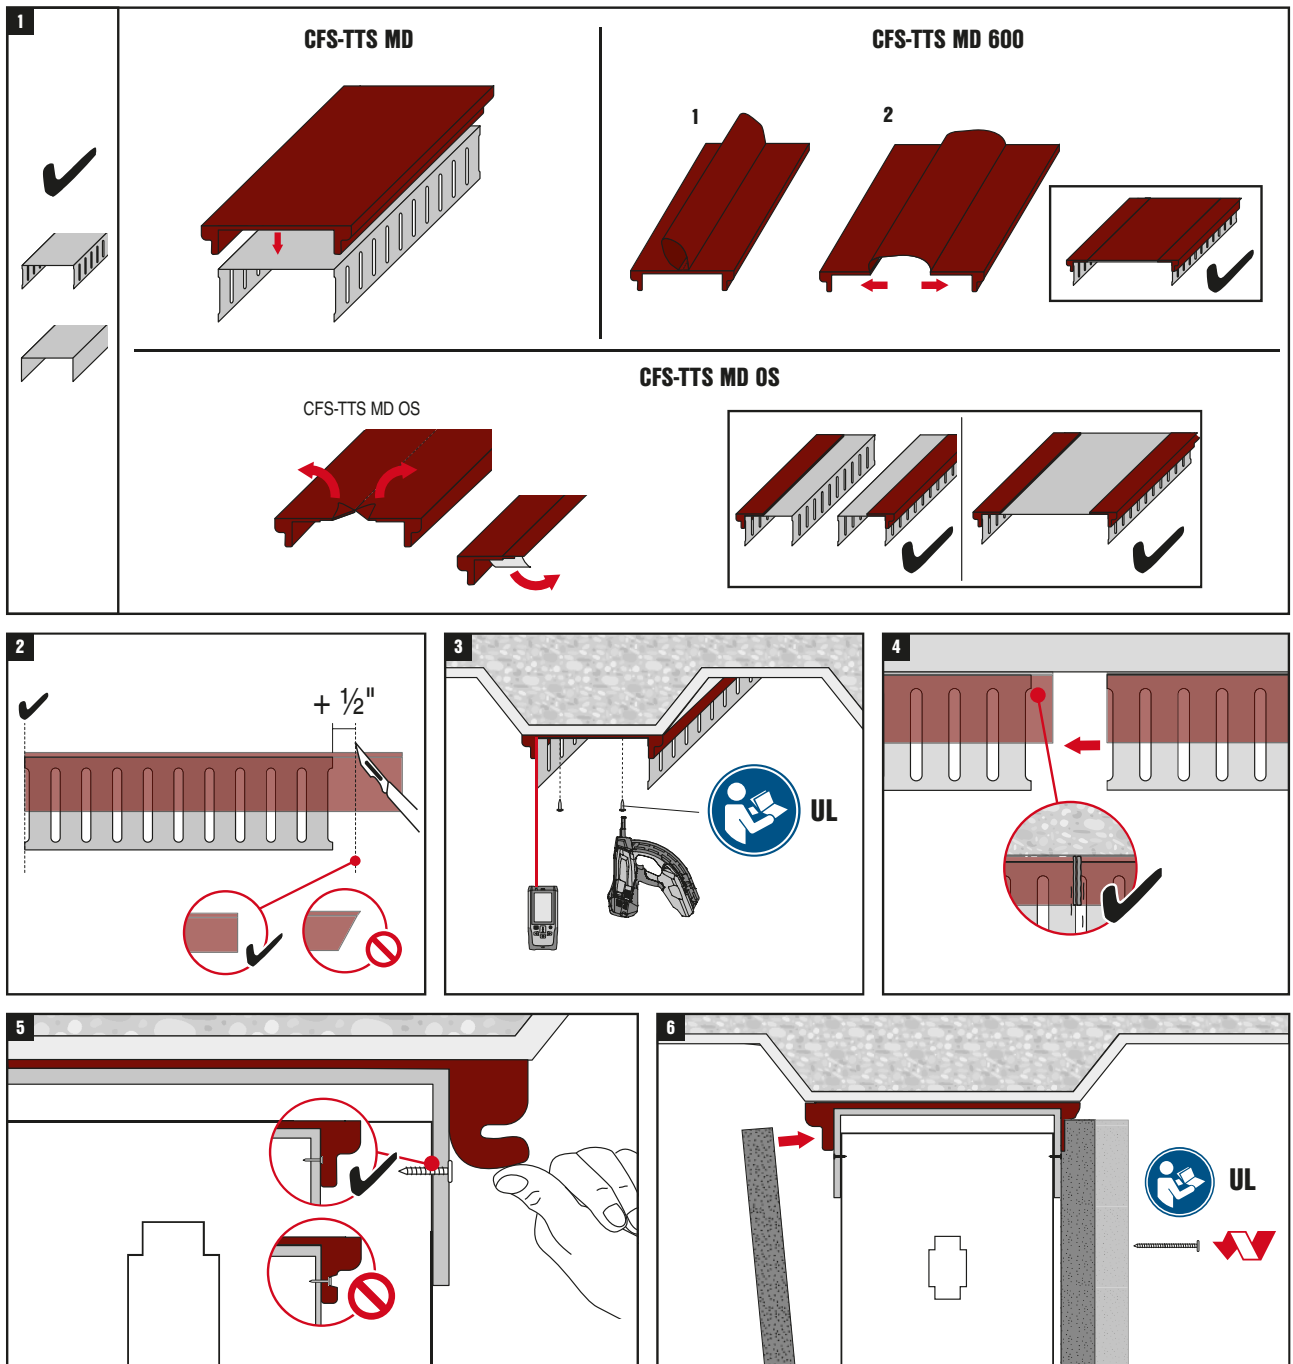

Hilti Aktiengesellschaft


Petitioner Exhibit 1013

Page 229 of 235




CFS-TTS MD


FLOOR PENETRATION / PENETRATION PLAFOND

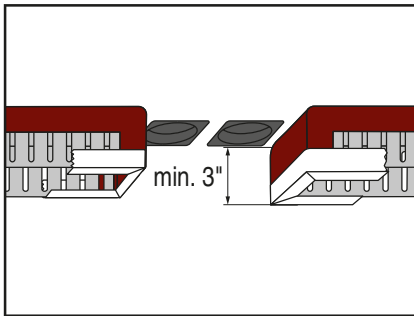

CFS-TTS MD OS

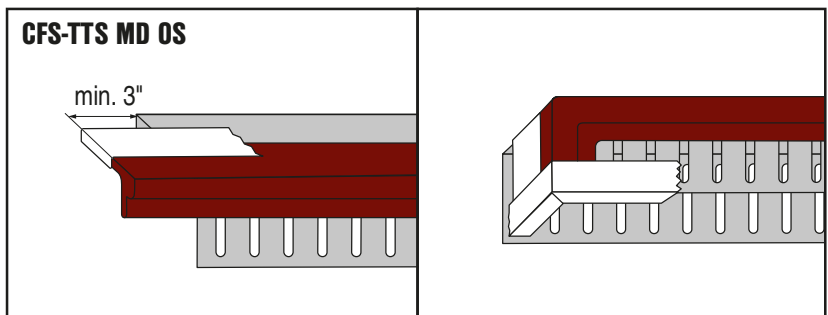

PERIMETER WALL / MUR D'ENCEINTE

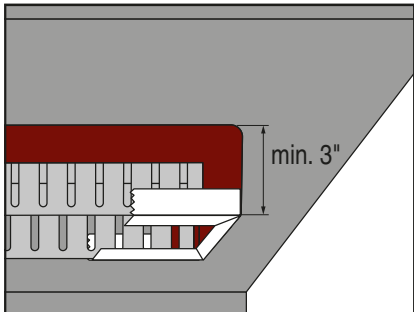

BOTTOM-OF-WALL / BAS DE MUR

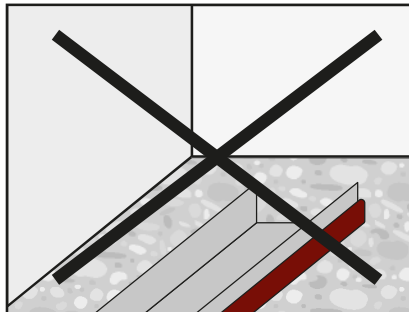


EXHIBIT P



Product Information

SMOKE & ACOUSTIC TRACK SEAL CS-TTS SA

Product description

- Eliminate the need to caulk ceiling and wall joints in flat concrete construction with Hilti's Top Track Seal (TTS) solutions — simply saddle your track with TTS, install it, and you're done. No mess, zero waste.

Applications for use

- Smoke and sound seal for head-of-wall joints between top track and gypsum to flat concrete slabs
- Smoke and sound seal for head-of-wall joints between gypsum walls to corrugated metal deck and metal roof decks with CFS-TTS MD P & C
- CS-TTS SA 358/600 is designed for a perfect friction fit with common track sizes — 3-5/8" and 6"
- CS-TTS SA OS is a flexible solution for various track sizes

Advantages

- Fast installation — fewer working steps
- Excellent sealing properties designed for reliability under real jobsite conditions — STC and smoke seal on imperfect concrete
- No mess, zero waste — no caulking required
- Ideal shape designed to saddle over top track without additional folding, taping, or gluing

Installation instructions

- See Hilti Literature or third-party listings for complete application and installation details



Technical Data

Chemical basis	Polyurethane foam
Color	Light grey
Application temperature range	23° to 122°F
Storage and transportation temperature range	14° to 122°F
Movement	Approx. ±50%
Temperature resistance range	23° to 122°F
Mold and mildew performance	Class 0 (ASTM G21-96)
Tested in accordance with	ASTM E 90, ASTM G21, CAN/ULC-S102, UL 2079 (L-Rating), ASTM E 84
LEED VOC	0.20 lb/gal (US)
Acoustics performance	62 (relates to specific construction)



Hilti Firestop
Saving lives
through innovation
and education



EXHIBIT Q



CS-TTS SA

2174405 A3-11.2018

Smoke And Acoustic Track Seal CS-TTS SA

Smoke and acoustic track seal / Isolation acoustique de profile / Insonorización para perfiles



qr.hilti.com/r7433686


www.hilti.com
www.hilti.ca
www.hilti.group



en Before handling and for specific application details, refer to Hilti product literature, 3rd party published listings and national approvals. For professional use only.

fr Avant toute utilisation et pour tout détail concernant une application, se référer à la documentation Hilti, à la liste de publications des tierces parties et aux approbations nationales. Seulement pour utilisateurs professionnels.

es Antes de usar y para detalles específicos de aplicación, véase la información que acompaña al producto Hilti, el listado publicado por terceros y las aprobaciones nacionales. Solamente para los usuarios profesionales.

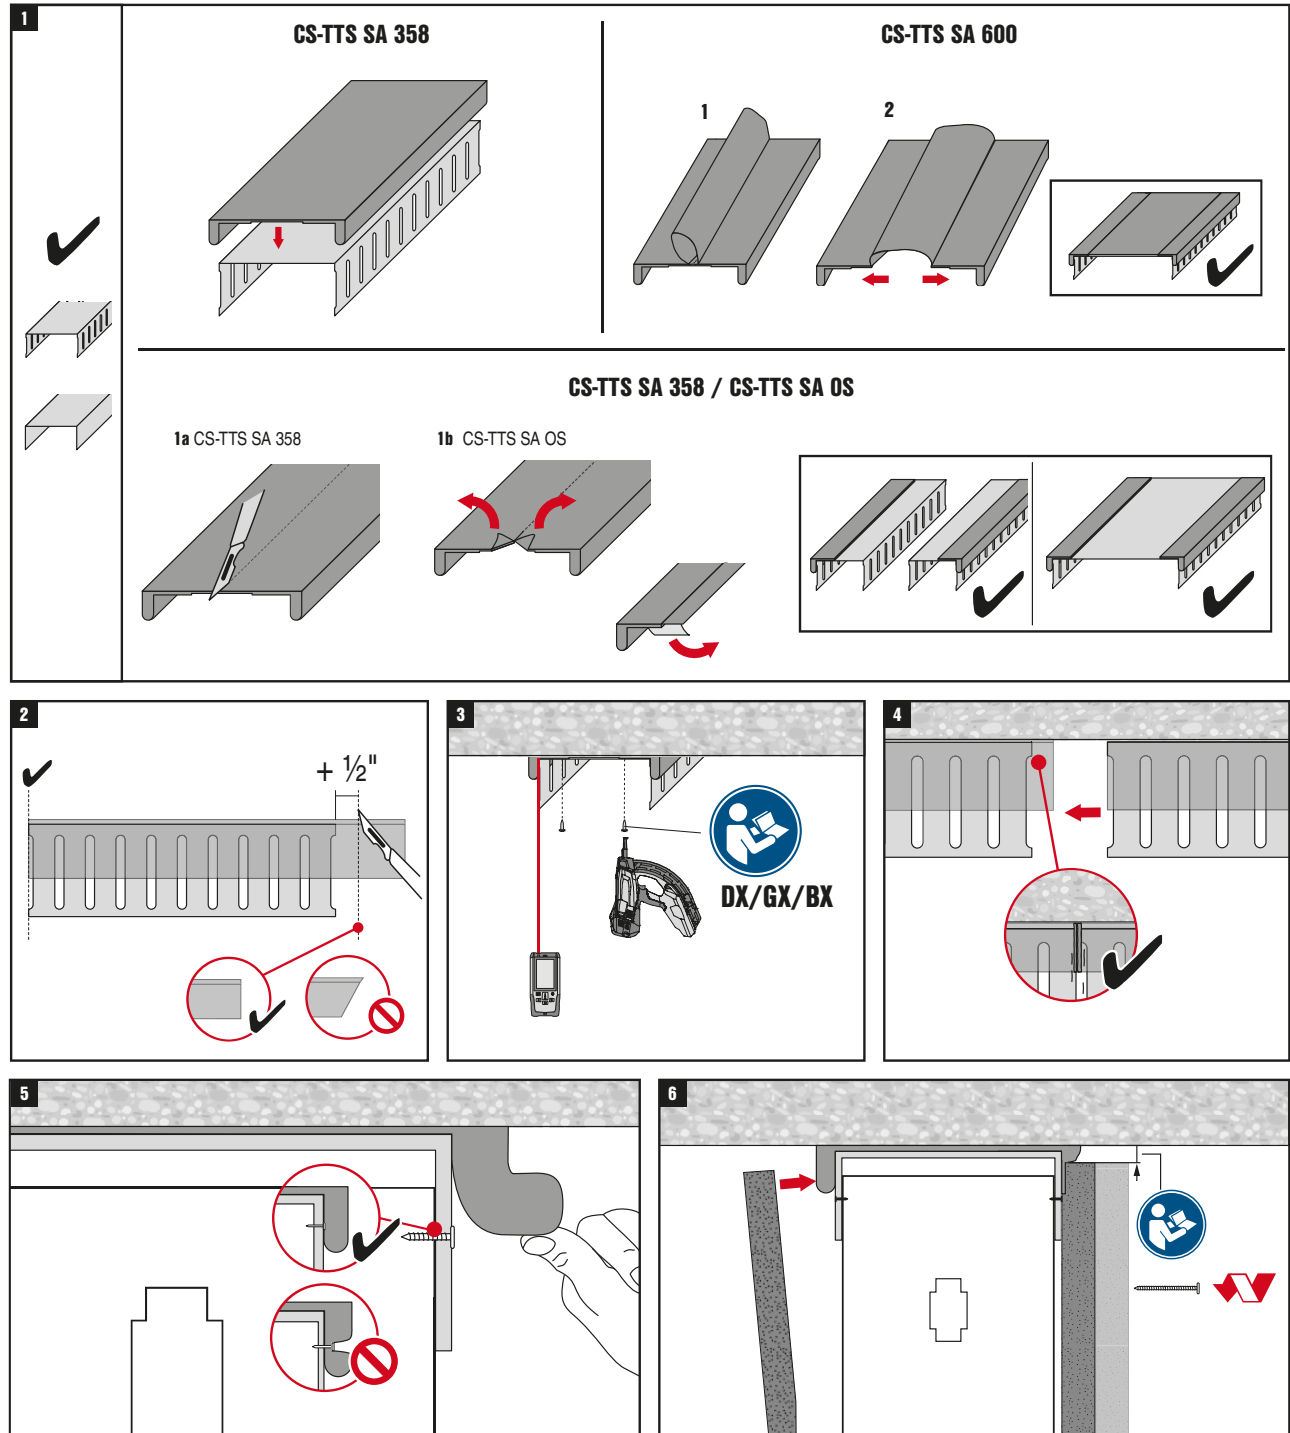

Hilti Aktiengesellschaft



Petitioner Exhibit 1013

Page 234 of 235




CS-TTS SA

FLOOR PENETRATION / PENETRATION PLAFOND

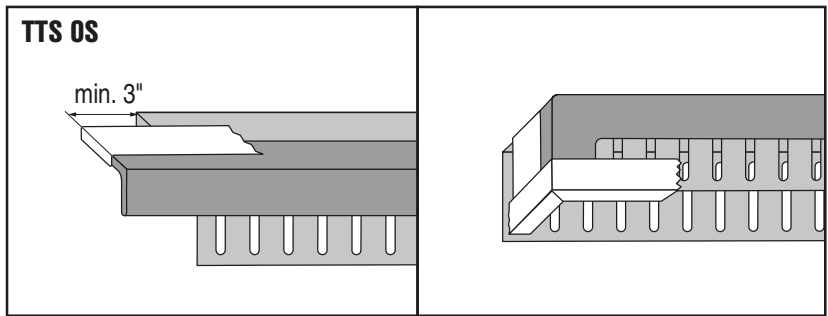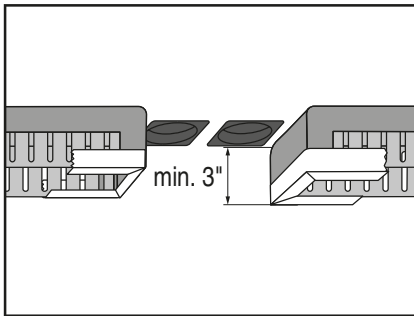

PERIMETER WALL / MUR D'ENCEINTE

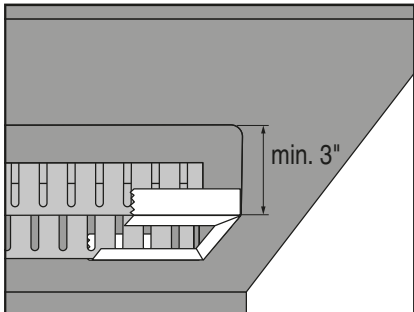

BOTTOM-OF-WALL / BAS DE MUR

