



1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41

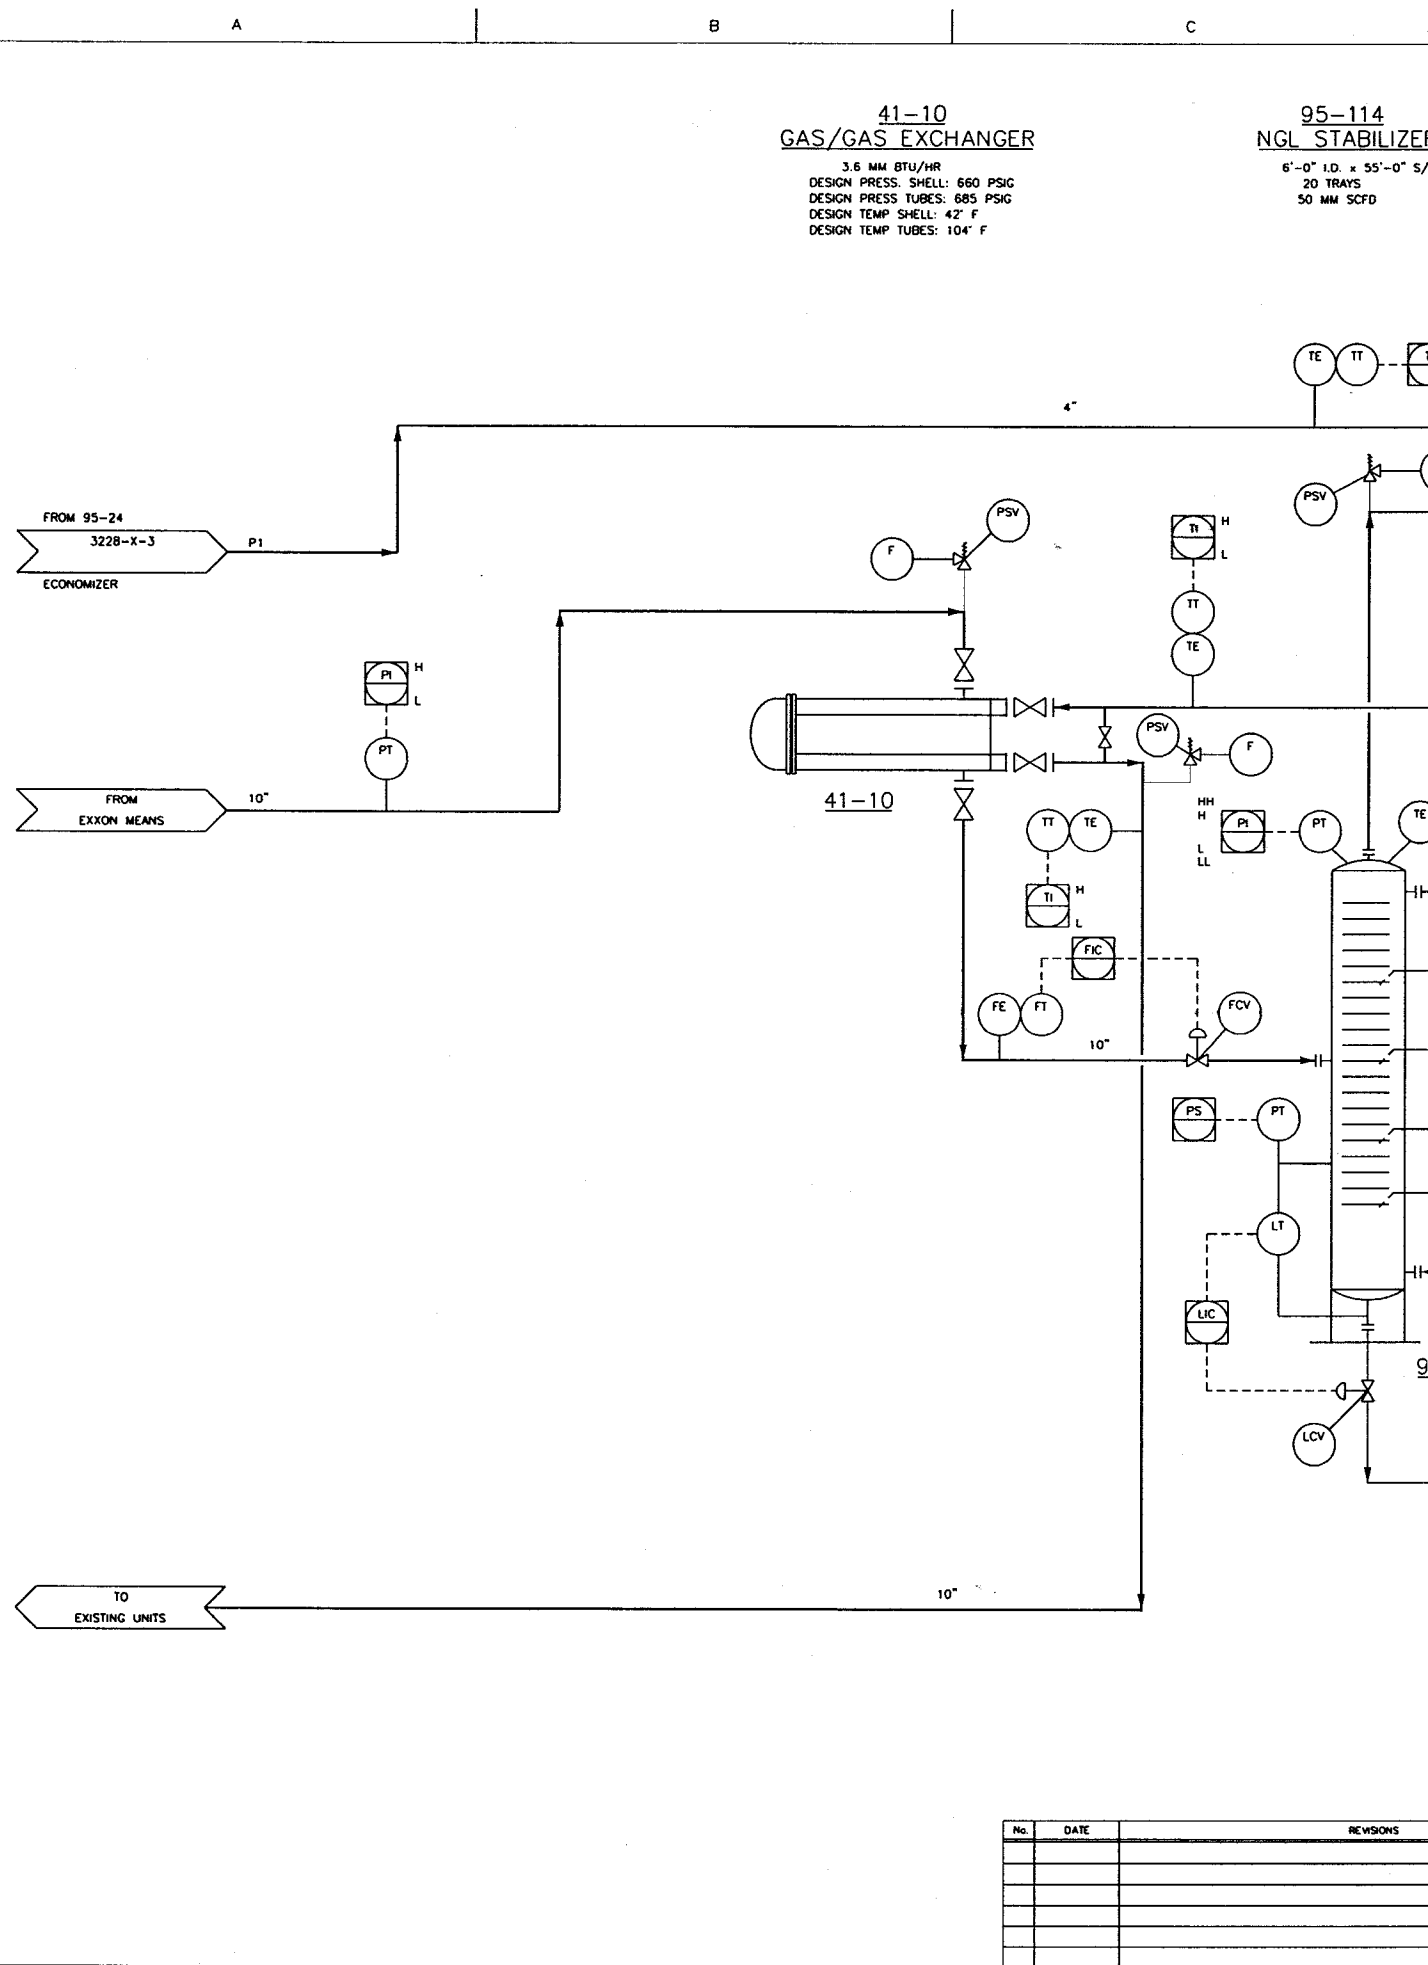

No.	DATE	REVISIONS

F

95-17
OVERHEAD RECEIVER
6'-0" I.D. x 20'-0" S/S
DESIGN PRESS.: ??? PSIG
DESIGN TEMP.: ?? F

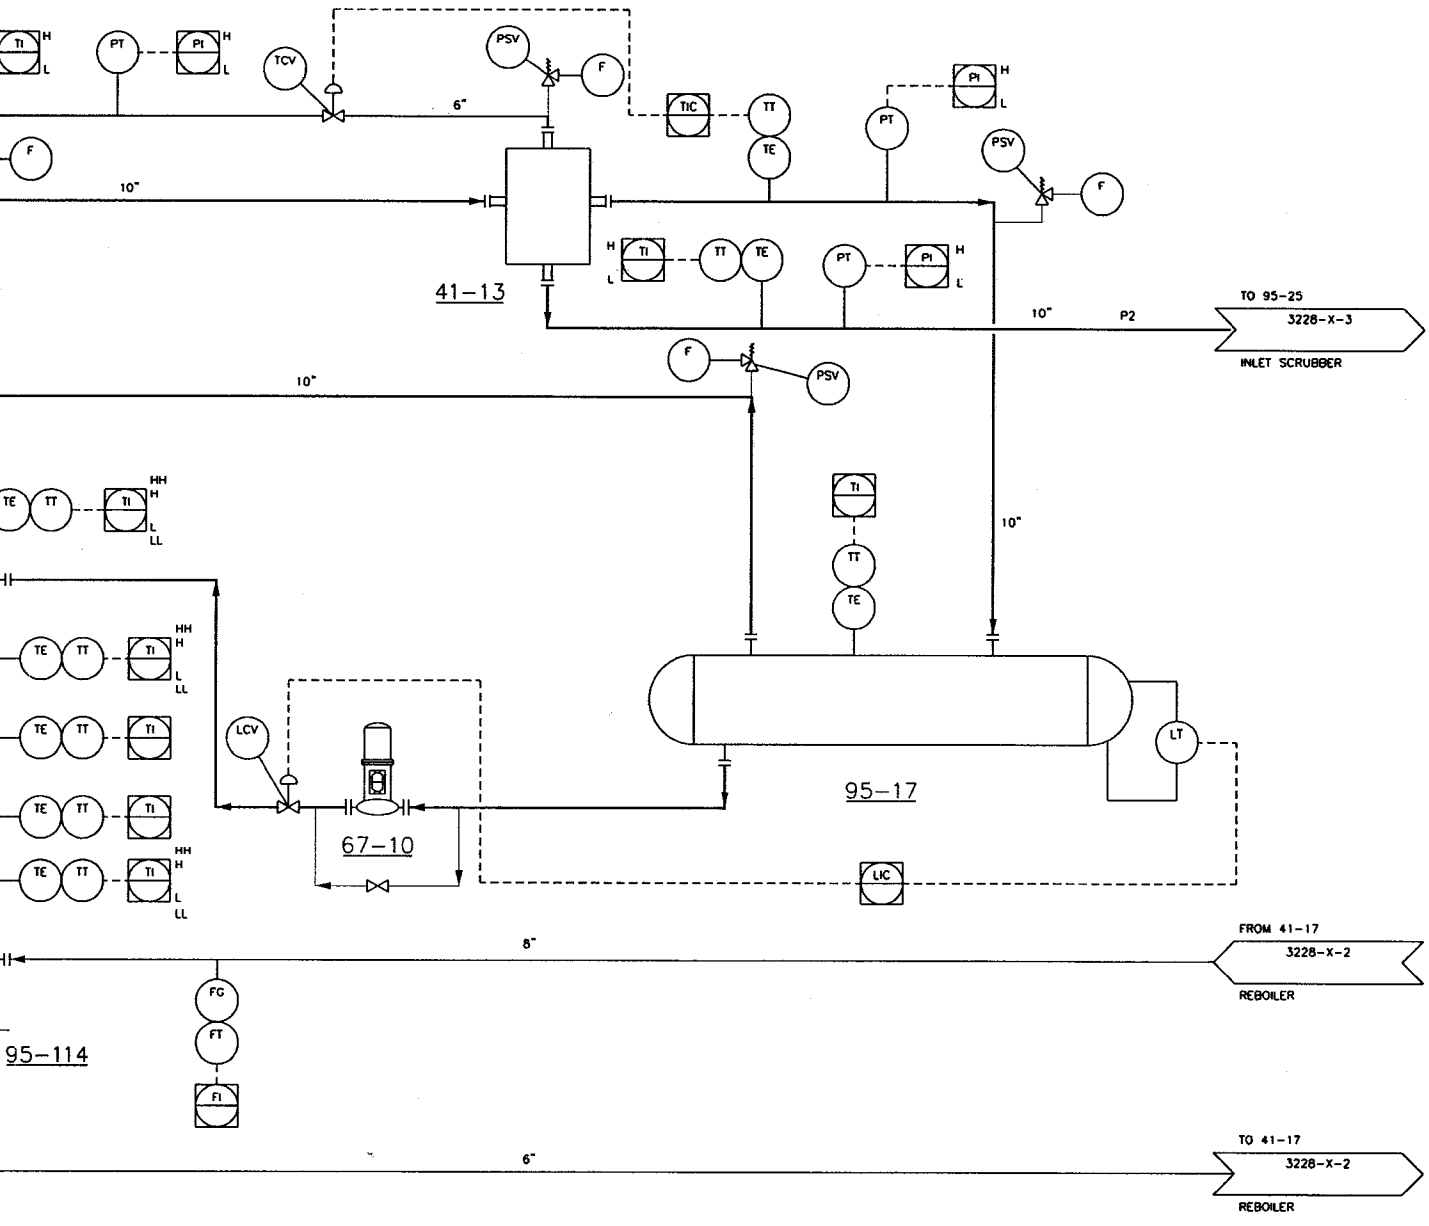[illegible]


ENGINEERING RECORD	DATE	MEANS GCF PROCESSING PLANT		
DRN: JMR	8/9/01			
CHK:		PRELIMINARY P&ID DIAGRAM (50 MM CASE)		
APP:				
APP:				
W.O. No.:		DWG. No. 3228-X-1	CND FILE: 3228X1 PLOT DATE:	REV A
SCALE: NONE				

36-1
HOT OIL HEATER
7.7 MM BTU/HR

67-12
OIL CIRCULATION
PUMP
 $\Delta P = 50$ PSIG
 $\Delta T = 50^\circ$
GPM - 500 GPM
25 HP

67-12
OIL CIRCULATION
PUMP
 $\Delta P = 50$ PSIG
 $\Delta T = 50^\circ$
GPM - 500 GPM
25 HP

67-14A/B
TRUCK LOADING
PUMP
INLET 200 PSIG
GPM - 135

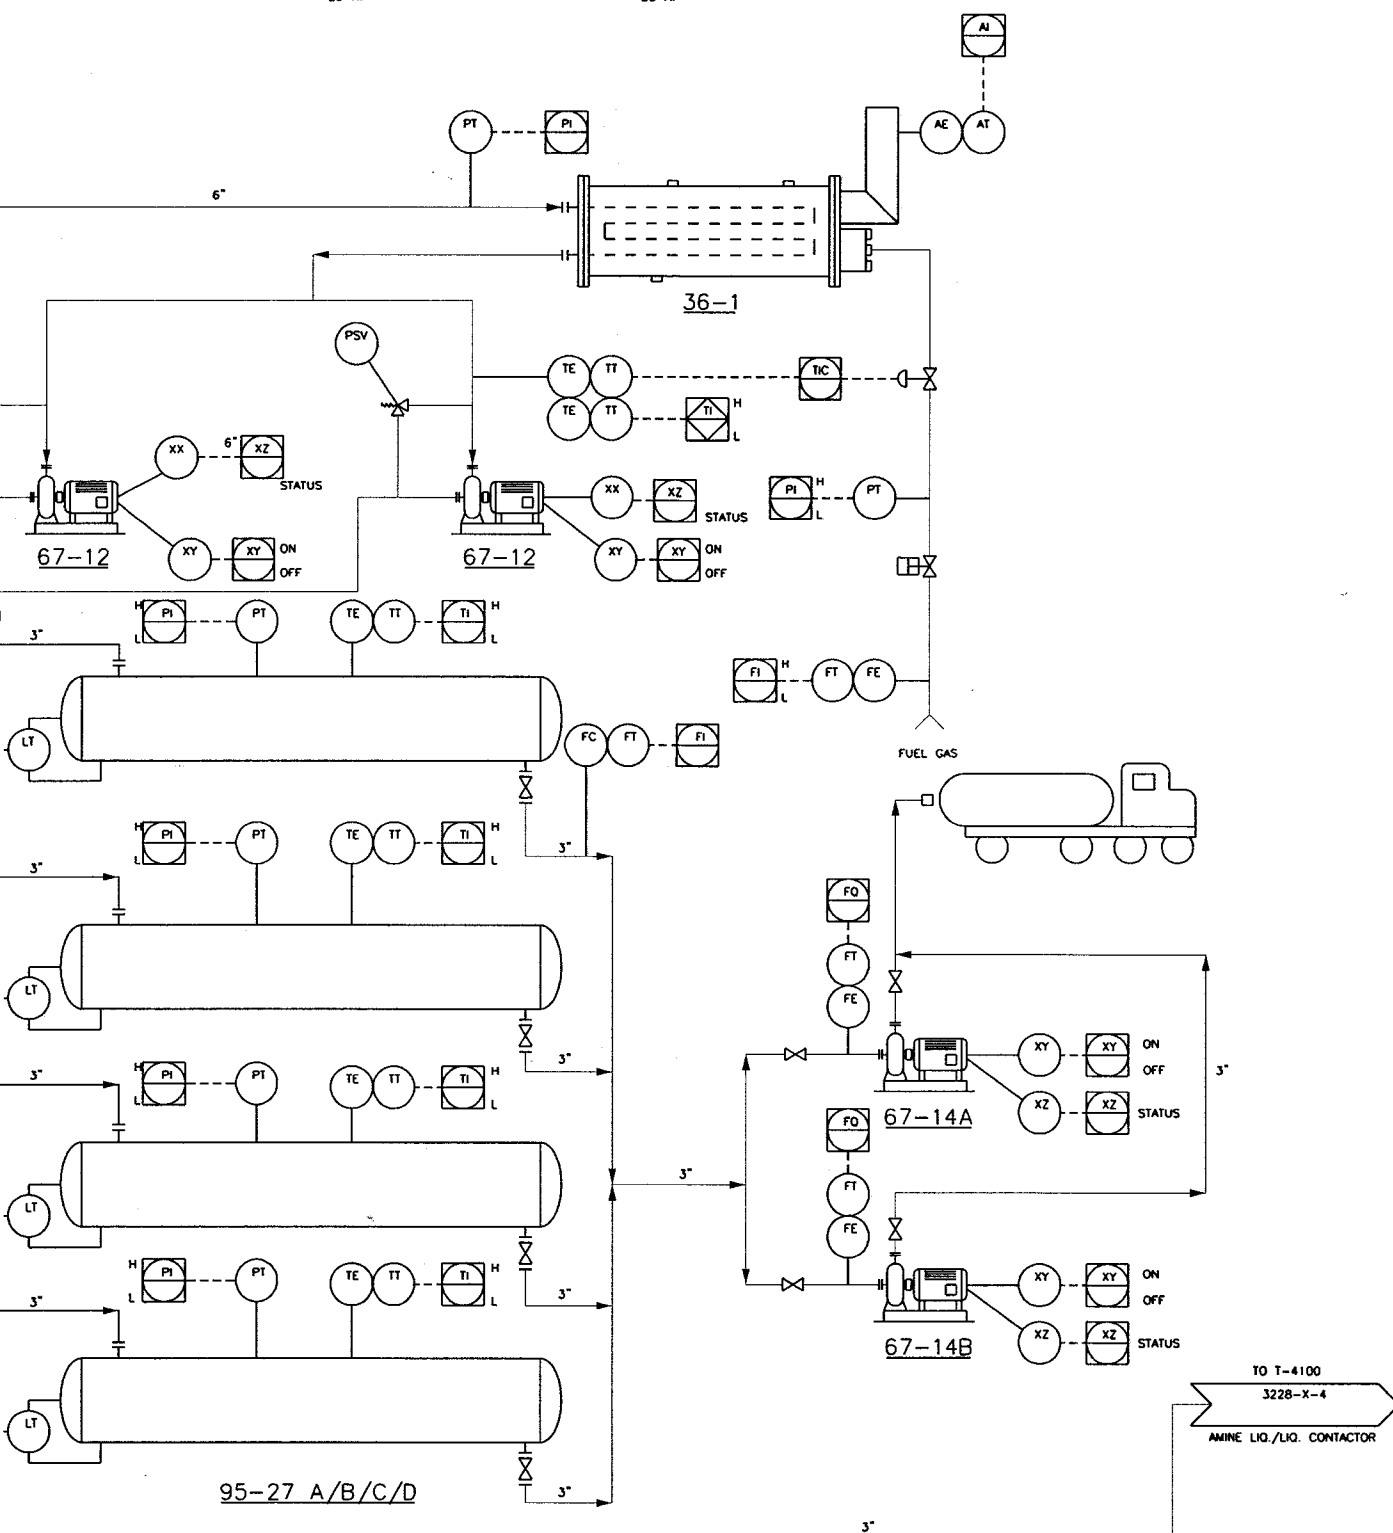

BY	CHK'D	HAZOP DATE	APP	DATE	APP	DATE



ENGINEERING RECORD	DATE
DRN: JMR	8/9/01
CHK:	
APP:	
W.O. No.:	
SCALE: NONE	

MEANS GCF PROCESSING PLANT PRELIMINARY P&ID DIAGRAM (50 MM CASE)	
OWC No. 3228-X-2	CAD FILE: 3228X2 PLOT DATE: REV A