GYPSUM ASSOCIATION

20th Edition
GA-600-2012

FIRE RESISTANCE DESIGN MANUAL

SOUND CONTROL

GYPSUM SYSTEMS

GYPSUM ASSOCIATION
JUNE 2012
GYPSUM DRYWALL

Simpson Strong-Tie Company Inc. EX1017
Simpson Strong-Tie Co. v. Columbia Insurance Co.
U.S. Patent No. 11,649,626

FOREWORD

The Gypsum Association *FIRE RESISTANCE DESIGN MANUAL* is referenced by the following code and standards writing organizations:

INTERNATIONAL BUILDING CODE, published by:
International Code Council, Inc.
5203 Leesburg Pike, Suite 600
Falls Church, Virginia 22041
(See footnote m, Table 721.1(1); footnote o,Table 721.1(2); and footnote q, Table 721.1(3)

BOCA NATIONAL BUILDING CODE, published by:
Building Officials and Code Administrators International, Inc.
(See Chapters 7, 12, and 25, Commentary to the BOCA National Building Code)

UNIFORM BUILDING CODE, published by:
International Conference of Building Officials
(See footnote a, Tables No. 7-A, -B, and -C, and Appendix Section 1209)

STANDARD BUILDING CODE, published by:
Southern Building Code Congress International, Inc.
(See Section 701.5.2)

THE NATIONAL FIRE CODES, published by:
National Fire Protection Association
1 Batterymarch Park
P.O. Box 9101
Quincy, Massachusetts 02269-9101
(See NFPA 90A, NFPA 101, NFPA 221, NFPA 5000, and the Life Safety Code Handbook)

The *FIRE RESISTANCE DESIGN MANUAL* is also referenced in the code documents of major jurisdictions in the United States such as Florida, Chicago, Los Angeles, and New York City. In addition, the Manual has been recognized in major jurisdictions in Canada.

FSC
www.fsc.org
MIX
Paper from responsible sources
FSC® C015782

Copyright - 2012
by
GYPSUM ASSOCIATION
6525 Belcrest Road, Suite 480
Hyattsville, MD 20782

All rights reserved. No portion of this Manual may be duplicated without the express written permission of the Gypsum Association. Limited permission is hereby granted to design professionals to selectively reproduce individual systems in the routine course of their design work for inclusion in the plans and specifications for individual projects.

TABLE OF CONTENTS

FOREWORD . . . 3
TABLE OF CONTENTS . . . 4
INTRODUCTION . . . 6
SECTION I - USE OF THIS MANUAL AND GENERAL EXPLANATORY NOTES . . . 7
Overview . . . 7
Description of Terms Used in This Manual . . . 7
General Explanatory Notes . . . 8
Testing Agencies . . . 10
Product Identification . . . 11
Abbreviations . . . 12
SECTION II - REQUIREMENTS FOR FIRE PROTECTION . . . 13
Fire Resistive Properties of Gypsum . . . 13
Type X Gypsum Board . . . 13
Performance of Gypsum Plaster . . . 13
Fire Resistance Tests . . . 14
Wall and Partition Systems . . . 14
Area Separation Fire Walls (Party/Fire Walls) . . . 15
Floor-Ceiling and Roof-Ceiling Systems . . . 15
Ceiling Openings . . . 15
Protection Systems for Steel Beams, Girders, and Trusses . . . 16
Continuous Ceiling Protection . . . 16
Individual Encasement Protection . . . 16
Protection Systems for Steel Columns . . . 17
Protection of Wood Columns and Beams . . . 17
Fire Blocking . . . 18
Smoke Barriers . . . 18
Perimeter Relief and Control Joints . . . 18
Surface Burning Characteristics . . . 18
SECTION III - SOUND CONTROL . . . 19
Sound Insulation . . . 19
Sound Transmission Loss Tests . . . 21
Impact Noise Test . . . 22
Notes . . . 23
SECTION IV - FIRE RESISTANCE AND SOUND CONTROL SYSTEMS . . . 24
INDEX TO SYSTEMS BY STC RATING . . . 24
LISTING OF NEW SYSTEMS . . . 26
LISTING OF DELETED SYSTEMS . . . 26
WALL AND PARTITION SYSTEMS . . . 27
Walls and Interior Partitions, Noncombustible, ½ HOUR . . . 27
Walls and Interior Partitions, Noncombustible, 1 HOUR . . . 27
Walls and Interior Partitions, Noncombustible, 2 HOUR . . . 47
Walls and Interior Partitions, Noncombustible, 3 HOUR . . . 65
Walls and Interior Partitions, Noncombustible, 4 HOUR . . . 68
Walls and Interior Partitions, Wood Framed, ½ HOUR . . . 72
Walls and Interior Partitions, Wood Framed, 1 HOUR . . . 72
Walls and Interior Partitions, Wood Framed, 2 HOUR . . . 86
Chase Walls, Noncombustible, 1 HOUR . . . 89
Chase Walls, Noncombustible, 2 HOUR . . . 92
Chase Walls, Wood Framed, 1 HOUR . . . 96
Chase Walls, Wood Framed, 2 HOUR . . . 98
Movable and Office Partitions, 1 HOUR . . . 99
Movable and Office Partitions, 2 HOUR . . . 102

TABLE OF CONTENTS

Shaft Walls, 1 HOUR 103
Shaft Walls, 2 HOUR 106
Shaft Walls, 3 HOUR 122
Shaft Walls, 4 HOUR 124
Exterior Walls, 1 HOUR 125
Exterior Walls, 2 HOUR 134
Metal Clad Exterior Walls, 1 HOUR 140
Metal Clad Exterior Walls, 2 HOUR 141
Area Separation Fire Walls (Party/Fire Walls), 2 HOUR 143
Area Separation Fire Walls (Party/Fire Walls), 3 HOUR 151

FLOOR-CEILING SYSTEMS 152
Floor-Ceiling Systems, Noncombustible, 1 HOUR 152
Floor-Ceiling Systems, Noncombustible, 1½ HOUR 155
Floor-Ceiling Systems, Noncombustible, 2 HOUR 156
Floor-Ceiling Systems, Noncombustible, 3 HOUR 161
Floor-Ceiling Systems, Noncombustible, 4 HOUR 162
Floor-Ceiling Systems, Steel Framed, Wood Floor, 1 HOUR 163
Floor-Ceiling Systems, Steel Framed, Wood Floor, 2 HOUR 165
Floor-Ceiling Systems, Wood Framed, ¾ HOUR 166
Floor-Ceiling Systems, Wood Framed, 1 HOUR 166
Floor-Ceiling Systems, Wood Framed, 1½ HOUR 186
Floor-Ceiling Systems, Wood Framed, 1¾ HOUR 186
Floor-Ceiling Systems, Wood Framed, 2 HOUR 186

ROOF-CEILING SYSTEMS 189
Roof-Ceiling Systems, 1 HOUR 189
Roof-Ceiling Systems, 2 HOUR 194

COLUMN PROTECTION SYSTEMS 196
Columns, Noncombustible, 1 HOUR 196
Columns, Noncombustible, 2 HOUR 202
Columns, Noncombustible, 3 HOUR 212
Columns, Noncombustible, 4 HOUR 217

BEAM, GIRDER, AND TRUSS PROTECTION SYSTEMS 219
Beams, Girders, and Trusses, Noncombustible, 1 HOUR 219
Beams, Girders, and Trusses, Noncombustible, 2 HOUR 219
Beams, Girders, and Trusses, Noncombustible, 3 HOUR 220
Beams, Girders, and Trusses, Noncombustible, 4 HOUR 221

STRAIN RELIEF SYSTEMS 222
Strain Relief Systems, Control Joints, Walls, Noncombustible, 1 HOUR 222
Strain Relief Systems, Control Joints, Walls, Noncombustible, 2 HOUR 222
Strain Relief Systems, Control Joints, Walls, Noncombustible, 4 HOUR 222
Strain Relief Systems, Control Joints, Walls, Wood Framed, 1 HOUR 223
Strain Relief Systems, Control Joints, Walls, Wood Framed, 2 HOUR 223
Strain Relief Systems, Control Joints, Ceiling, Wood Framed, 1 HOUR 224
Strain Relief Systems, Control Joints, Ceiling, Suspended, 1 HOUR 225
Strain Relief Systems, Perimeter Relief, Head of Wall, 1 HOUR 226
Strain Relief Systems, Perimeter Relief, Head of Wall, 2 HOUR 226
Strain Relief Systems, Perimeter Relief, Wall-to-Wall, 1 HOUR 227
Strain Relief Systems, Perimeter Relief, Wall-to-Wall, 2 HOUR 227

APPENDIX 228
Commonly Used Metric Conversions 228

NOTES 229

INTRODUCTION

NOTE: This Introduction constitutes an essential part of the system descriptions contained in Section IV. It is important that the user be familiar with this introductory material.

This Manual is a convenient and useful specification aid for anyone concerned with the design, construction, or inspection of fire resistive and sound control systems. Design information is quickly and easily determined. Comparison of these characteristics allows the user to be more accurate in meeting design and code requirements. The data provided are especially useful to builders, architects, code officials, fire service, and insurance personnel.

When differences occur between provisions of this Manual and the appropriate building code or regulation, including provisions of other standards referenced in the code or regulation, the most stringent provision shall apply.

The systems in this Manual utilize gypsum products to provide fire resistance to walls, partitions, floor-ceilings, roof-ceilings, columns, beams, girders, and trusses. Systems are classified according to their typical uses and their fire-resistance ratings. Walls, partitions, and floor-ceiling systems are further classified by Sound Transmission Class (STC) or Field Sound Transmission Class (FSTC). The Impact Insulation Class (IIC) is included for many wood framed floor-ceiling systems.

WHERE THE WORD "PROPRIETARY" APPEARS IN SYSTEM DESCRIPTIONS EITHER THE SYSTEM OR ONE OR MORE OF ITS COMPONENTS IS CONSIDERED PROPRIETARY. EACH PROPRIETARY SYSTEM SHALL BE BUILT UTILIZING THE COMPONENTS SPECIFIED BY THE COMPANY OR COMPANIES LISTED UNDER THE DETAILED DESCRIPTION FOR THAT SYSTEM. ALL OTHER SYSTEMS ARE GENERIC. GENERIC SYSTEMS ARE APPLICABLE TO THE PRODUCTS OF ANY MANUFACTURER, WHETHER A MEMBER OF THE GYPSUM ASSOCIATION OR NOT, PROVIDED THE PRODUCTS MEET THE APPROPRIATE STANDARDS LISTED IN SECTION I AND, WHEN APPLICABLE, THE REQUIREMENTS SET FORTH IN SECTION II.

To maintain industry-wide quality assurance standards for gypsum board defined in this Manual as "type X," the Gypsum Association requires that all companies listing proprietary tests or systems, or relying on the generic systems in this manual, shall subscribe to an on-going third-party, in-plant product inspection and labeling service. Additionally, each member company makes annual written certification to the Gypsum Association that its products manufactured for use in systems listed in this Manual continue to be inspected and labeled by an independent third-party testing service as listed on page 10.

Fire-resistance ratings, STCs, FSTCs, and IICs are the results of tests conducted on systems composed of specific materials put together in a specified manner. Substitution of other materials or deviation from the specified construction could adversely affect performance. For example, if batt or blanket insulation is shown, then it is a required component of the system. In each system containing batt or blanket insulation the insulation is specified to be either mineral or glass fiber and, for fire resistance, the system shall be constructed using the type specified.

Mineral fiber or glass fiber shall not be arbitrarily added to floor-ceiling or roof-ceiling systems to increase either STCs or R-values. This practice has been shown to reduce the fire-resistance rating. The addition of up to 16 3/4 inches of 0.5 pcf glass fiber insulation (R-40), either batt or loose-fill, to any 1- or 2-hour fire resistance rated floor-ceiling or roof-ceiling system having a cavity deep enough to accept the insulation is permitted provided that one additional layer of either 1/2 inch or 5/8 inch type X gypsum board is applied to the ceiling. The additional layer of gypsum board shall be applied as described for the face layer of the tested system except that the fastener length shall be increased by not less than the thickness of the additional layer of gypsum board.

The detailed descriptions for the systems included in this Manual are summaries. For complete information on the systems or components tested, the listing or test report should be reviewed. Details regarding generic systems may be requested from the Gypsum Association; details on proprietary systems are available from the companies listed for those systems.

For information on limiting heights of nonload-bearing steel stud walls and partitions see ASTM C 754, *Standard Specification for Installation of Steel Framing Members to Receive Screw Attached Gypsum Panel Products,* or steel stud manufacturer's literature.

References to ASTM standards, CAN/ULC standards, or other standards refer to the respective standard in effect on the date that the test was performed. Each test reference contains the test report date.

The information in this Manual is based on characteristics, properties, and performance of materials and systems obtained under controlled test conditions as set forth in the appropriate standards in effect at the time of the test. The Gypsum Association and its member companies make no warranties or other representations as to the characteristics, properties, or performance of any materials or systems in actual construction. No warranty or representation is made that any material or component of any system, other than the gypsum material used in such system, conforms to any standard or standards.

SECTION I - USE OF THIS MANUAL AND GENERAL EXPLANATORY NOTES

OVERVIEW

The systems are divided into five major categories and listed in the Table of Contents on pages 4 an 5 under these headings:

- Wall and Partition Systems
- Floor-Ceiling Systems
- Roof-Ceiling Systems
- Column Protection Systems
- Beam, Girder, and Truss Protection Systems
- Stress Relief Systems

In the case of walls and partitions, floor-ceilings, and roof-ceilings, noncombustible systems are listed first, followed by wood-framed systems. They are further subdivided by fire-resistance rating starting with one hour and increasing. STCs (or FSTCs) are listed in descending order. *Where sound test data are not available, estimated STCs are based on evaluations of similar systems for which test data are available.*

Each system has been assigned a reference number - the GA File Number. This system of GA File Numbers was designed to group similarly rated systems together to facilitate comparing systems of like ratings. With the publication of the 2012 Edition, the number of systems used over the life of the Manual exhausted the available GA File Numbers in one or more rating categories. To avoid reusing GA File Numbers from retired systems and to avoid having to renumber existing systems while retaining the grouping by ratings, it was necessary to modify the numbering system by adding a decimal point (dot) followed by a digit to some systems. *Cite this complete GA File Number in specifications and on plans, or when making inquiries about specific systems.*

All system descriptions contain a brief list of the major components of the system followed by a more detailed description. The detailed descriptions of interior systems begin with the material exposed to the test fire and its method of attachment, followed by a description of the framing members and their methods of installation. Finally, the unexposed side and its method of attachment is described.

Where unsymmetrical systems were tested from one side only, the side exposed to the test fire is indicated by the words "Fire Side" on the system detail. When documentation is available to show that the wall was tested with the least fire-resistive side exposed to the test fire, the wall need not be subjected to tests from the opposite side and a "Fire Side" is not specified. All floor-ceiling and roof-ceiling systems were tested with fire exposure on the ceiling side.

When mineral or glass fiber insulation was a basic component of a fire tested system, it is included in the description as an integral part of the system. The insulation thickness, type, and density are described, and both the fire and sound details show fibrous insulation. If the insulation was used solely to increase the STC, the fibrous insulation is shown only in the sound detail. *When the insulation is not needed for the fire-resistance rating, but is used to improve the STC of the system, the last sentence of the detailed description states,* "Sound tested with [mineral] [glass] fiber insulation." (See General Explanatory Notes 11, 12, and 13 on page 9.)

Unless indicated otherwise, all load-bearing wood stud systems were tested while being subjected to the maximum load allowed by design under nationally recognized design criteria at the time of the test. Due to an increase in the maximum allowable loading in the *National Design Specifications* (1982 and later editions), the American Forest and Paper Association issued the following statement:

> Where a load-bearing fire rated wood stud wall assembly contained in this Manual is specifically designed for structural capacity, the design value in compression parallel to grain adjusted for slenderness ratio (F_c') used in such analysis shall be taken as 78 percent of the maximum F_c' value determined in accordance with normal design practice but shall not exceed 78 percent of the F_c' value for such member having a slenderness ratio (l_e/d) of 33.

DESCRIPTION OF TERMS USED IN THIS MANUAL

Gypsum Panel Products - defined in ASTM C 11, *Standard Terminology Relating to Gypsum and Related Building Materials and Systems*, as "the general name for a family of sheet products consisting essentially of gypsum."

Note: This term includes gypsum board, glass mat gypsum panels, fiber reinforced gypsum panels, and factory laminated gypsum panels.

Gypsum Board - defined in ASTM C 11, *Standard Terminology Relating to Gypsum and Related Building Materials and Systems*, as "the generic name for a family of sheet products consisting of a noncombustible core primarily of gypsum with paper surfacing." Gypsum board may be further described as follows:

Regular Gypsum Board - a gypsum board with naturally occurring fire resistance from the gypsum in the core; or

Type X Gypsum Board - a gypsum board with

NOTE: Listing of a system in a specific category in this Manual is not intended to limit its use to that category (see General Explanatory Note 14 on page 9). However, this shall not be interpreted to imply that vertical systems, such as walls and partitions, are permitted to arbitrarily be used in a horizontal orientation. In addition, the manufacturer shall be consulted for other products which satisfy the fire and sound requirements shown for the systems.

NOTE: Where the word “proprietary” appears in system descriptions either the system or one or more of its components is considered proprietary. Each proprietary system shall be built utilizing the components specified by the company or companies listed under the detailed description for that system.

special core additives to increase the natural fire resistance of regular gypsum board.

Limited Load-Bearing - this means that a constant superimposed load was applied to the test specimen throughout the fire test to simulate a design load less than 78% of the maximum allowable design load.

Load-Bearing - unless otherwise noted in the detailed description, this means that a constant superimposed load was applied to the test specimen throughout the fire test to simulate 78% or more of the maximum allowable design load.

Mineral Fiber - refers to either rock or slag wool products.

Metal Studs - refers to steel studs and runners (track) not less than 0.0179 in. base metal thickness and manufactured to comply with ASTM C 645 unless otherwise specified in the detailed description.

(NLB) - nonload-bearing.

GENERAL EXPLANATORY NOTES

1. All dimensions, weights, temperatures, and pressures are in U.S. customary units. For commonly used metric (SI) conversions refer to the Appendix on page 228 and IEEE/ASTM S 10-2002, *Standard for Use of the International System of Units (SI): The Modernized Metric System*.
2. Nails shall comply with ASTM F 547 or ASTM C 514. Other nails, suitable for the intended use, and having dimensions not less than those specified in this Manual shall be permitted as substitutions.
3. Fasteners installed along the edges of gypsum board shall be placed along the paper bound edges on the long dimension of the board. Fasteners at the end shall be placed along mill or field cut ends on the short dimension. Fasteners on the perimeter of the board shall be placed along both edges and ends. Indicated fastener spacings are maximums.
4. Screws meeting ASTM C 1002 shall be permitted to be substituted for the prescribed nails, one for one, when the length and head diameter of the screws equal or exceed those of the nails specified in the tested system and the screw spacing does not exceed the spacing specified for the nails in the tested system.
5. Vertically applied gypsum board shall have the edges parallel to framing members. Horizontally applied gypsum board shall have the edges at right angles to the framing members. Intermediate vertical framing members are those between the vertical edges or ends of the board.
6. Unless otherwise specified, the face layers of all systems, except those with predecorated or metal covered surfaces or exterior gypsum sheathing panels, shall have joints taped (minimum Level 1 as specified in GA-214, *Recommended Levels of Gypsum Board Finish*) and fastener heads treated. Base layers in multi-layer systems shall not be required to have joints or fasteners taped or covered with joint compound.
7. Unless otherwise stated in the detailed description of the individual system, joints shall be staggered as follows.
   a. Horizontal butt joints on opposite sides of a partition in single-layer applications shall be staggered not less than 12 inches.
   b. Horizontal butt joints in adjacent layers on the same side of a partition in multi-layer applications shall be staggered not less than 12 inches.
   c. Vertical joints on opposite sides of a partition in single layer applications shall not occur on the same stud.
8. When a fire-resistance rated partition extends above the ceiling, the gypsum board joints occurring above the ceiling need not be taped and fasteners need not be covered when all of the following conditions are met.
   a. The ceiling is part of a fire-resistance rated floor-ceiling or roof-ceiling system;
   b. All vertical joints occur over framing members;
   c. Horizontal joints are either staggered 24 inches o.c. on opposite sides of the partition, or are covered with strips of gypsum board not less than 6 inches wide; or the partition is a two-layer system with joints staggered 16 inches or 24 inches o.c.; and
   d. The partition is not part of a smoke or sound control system.

   Where joint treatment is discontinued at or just above the ceiling line, the vertical joint shall be cross taped at this location to reduce the possibility of joint cracking.
9. Metallic outlet boxes shall be permitted to be installed in wood and steel stud walls or partitions having gypsum board facings and classified as two hours or less. The surface area of individual boxes shall not exceed 16 square inches. The aggregate surface area of the boxes shall not exceed 100 square inches in any 100 square feet. Boxes located on opposite sides of walls or partitions shall be in separate stud cavities and shall be separated by a minimum horizontal distance of 24 inches. Approved nonmetallic outlet boxes shall be permitted as allowed by local code.
10. Water-resistant gypsum backing board shall be installed over or as part of the fire-resistance rated system in areas to receive ceramic or plastic wall tile or plastic finished wall panels. When fire or sound ratings are necessary, the gypsum board required for the rating shall extend down to the floor behind fixtures so that the construction will equal that of the tested system.

    Note: The use of water-resistant gypsum backing board as a base for tile in wet areas is regulated by

local codes. Consult local building codes for requirements.

11. When not specified as a component of a fire tested wall or partition system, mineral fiber, glass fiber, or cellulose fiber insulation of a thickness not exceeding that of the stud depth shall be permitted to be added within the stud cavity.
12. In floor-ceiling or roof-ceiling systems, the addition or deletion of mineral or glass fiber insulation in ceiling joist spaces could possibly reduce the fire-resistance rating. The addition of up to 16 3/4 inches of 0.5 pcf glass fiber insulation (R-40), either batt or loose-fill, to any 1- or 2-hour fire resistance rated floor-ceiling or roof-ceiling system having a cavity deep enough to accept the insulation is permitted provided that one additional layer of either 1/2 inch type X or 5/8 inch type X gypsum board is applied to the ceiling. The additional layer of gypsum board shall be applied as described for the face layer of the tested system except that the fastener length shall be increased by not less than the thickness of the additional layer of gypsum board.
13. In each system containing batt or blanket insulation the insulation is specified to be either mineral or glass fiber and, for fire resistance, the system shall be built using the type specified.
14. Although the systems are arranged in general groupings (i.e. walls and interior partitions, floor-ceilings, roof-ceilings, etc.), this is not intended to limit their use only to the specific category in which they are listed. For example, systems listed as shaft walls shall be permitted to be used as interior partitions. However, systems tested vertically (walls and partitions) shall not be permitted to be arbitrarily used in a horizontal orientation.
15. Unless otherwise specified in the detailed description, the generic steel studs and runners used in nonload-bearing walls and partitions in this Manual were fabricated from flat steel having a bare metal thickness of not less than 0.0179 inch and have a return lip dimension of not less than 3/16 inch.

    Note: Consult the steel stud manufacturer for performance data and recommendations before substituting proprietary steel studs that either are fabricated from steel having a bare metal thickness of less than 0.0179 inch or have a return lip dimension less than 3/16 inch.
16. Greater stud sizes (depths) shall be permitted to be used in metal- or wood-stud systems. Metal studs of heavier gage than those tested shall be permitted. The assigned rating of any load-bearing system shall also apply to the same system when used as a nonload-bearing system. Indicated stud spacings are maximums.
17. Specified floor-ceiling and roof-ceiling framing sizes or truss dimensions are minimums. Greater joist or truss sizes (depths) shall be permitted to be used in metal- or wood-framed systems. Indicated joist and truss spacings are maximums.
18. Within design limitations, the distance between parallel rows of studs, such as in a chase wall, shall be permitted to be increased beyond that tested. When stud cavities in walls constructed of parallel rows of steel studs exceed 9 1/2 inches and cross bracing is required the cross bracing shall be fabricated from steel studs.
19. Systems tested with metal furring channels attached directly to the bottom chords of steel beams, bar joists, or wood trusses or framing shall be permitted to be suspended. Generally, furring channels are attached to 1 1/2 inch cold rolled carrying channels 48 inches o.c. suspended from joists by 8 ga wire hangers spaced not greater than 48 inches o.c.
20. Floor-ceiling and roof-ceiling systems were fire tested at less than 36 inches total depth. However, the total depth of the systems, with either directly attached or suspended ceiling membranes, shall be permitted to extend greater than 36 inches.
21. Where laminating compound is specified, taping, all-purpose, and setting type joint compounds shall be permitted.
22. Additional layers of type X or regular gypsum panels shall be permitted to be added to any system.
23. When not specified as a component of a fire-resistance rated wall or partition system, wood structural panels shall be permitted to be added to one or both sides. Such panels shall be permitted to be applied either as a base layer directly to the framing (under the gypsum board), as a face layer (over the face layer of gypsum board), or between layers of gypsum board in multi-layer systems. When such panels are applied under the gypsum board or between layers of gypsum board the length of the fasteners specified for the attachment of the gypsum board applied over the wood structural panels shall be increased by not less than the thickness of the wood structural panels. Fastener spacing for the gypsum board and the number of layers of gypsum board shall be as specified in the system description.
24. Each proprietary system lists specific products that are acceptable for use in the specific system in which they are listed. Consult the manufacturer for information on additional proprietary products that are suitable for use in specific proprietary systems.

TESTING AGENCIES

Each detailed description is accompanied by a cross-section detail of the system. Also included is design information giving total thickness, limiting height where appropriate, and approximate weight of the system in pounds per square foot. Fire and sound test references identifying the agency which certified the test as well as a report number and date are also provided (see Tables I and II).

TABLE I
FIRE TESTING AGENCIES

BMS	Building Materials & Structures, National Bureau of Standards (now National Institute of Standards and Technology)
CTC	Commercial Testing Company
FM	Factory Mutual Research Corporation
GET	George E. Troxell, P.E., Consulting Engineer
ITS	Intertek Testing Services NA Inc.
NBS	National Bureau of Standards (now National Institute of Standards and Technology)
NRCC	National Research Council of Canada
OPL	Omega Point Laboratories, Inc.
OSU	The Ohio State University
PCA	Portland Cement Association
SFT	Standard Fire Test, Fire Prevention Research Institute
SWRI	Southwest Research Institute
UC	University of California
UL	Underwriters Laboratories Inc.
ULC	Underwriters' Laboratories of Canada
WFCi	Western Fire Center, Inc.
WHI	Warnock Hersey, Inc. (now Intertek Testing Services NA Inc.)

TABLE II
SOUND TESTING AGENCIES

ACI	Acoustical Consultants, Inc.
ASL	Acoustic Systems Acoustical Research Facility
BBN	Bolt, Beranek, and Newman, Inc.
BGL	British Gypsum Limited
BMS	Building Materials & Structures, National Bureau of Standards (now National Institute of Standards and Technology)
CK	Cedar Knolls Acoustical Laboratories (now Noise Unlimited, Inc.)
DRC	Domtar Research Center
G&H	Geiger and Hamme
INTEST	International Acoustical Testing Laboratories
KAL	Kodaras Acoustical Laboratories (now Electrical Testing Laboratories, ETL)
KG	Kaiser Acoustical Laboratories
NBS	National Bureau of Standards (now National Institute of Standards and Technology)
NGC	National Gypsum Company's Gold Bond Acoustical Laboratories (now NGC Testing Services)
NRCC	National Research Council of Canada
OL	Orfield Laboratories, Inc.
OR	Ohio Research Corporation
RAL	Riverbank Acoustical Laboratories
SA	Shiner & Associates
USG	USG Research & Technology Center
WEAL	Western Electro Acoustical Laboratory, Inc.
WHI	Warnock Hersey, Inc. (now Intertek Testing Services NA Inc.)

PRODUCT IDENTIFICATION

All gypsum products are identified with the manufacturer's name and trademark. The thickness and type of gypsum board are shown on the end bundling tape or on the board. Ready-mixed joint compounds are identified on the container. Bagged products are identified on the bag.

ASTM standard product specifications are shown in Table III.

NOTE:

ASTM Standards are available from:

ASTM International
100 Barr Harbor Drive
West Conshohocken, PA 19428-2959
(610) 832-9585
Fax: (610) 832-9555
E-mail: service@astm.org
Website: http://www.astm.org

TABLE III
APPLICABLE ASTM PRODUCT STANDARDS

Product	ASTM
Gypsum Board	C 1396*
Gypsum Wallboard	C 1396, Sec. 5*
Predecorated Gypsum Board	C 1396, Sec. 5*
Gypsum Lath	C 1396, Sec. 11*
Gypsum Sheathing Board	C 1396, Sec. 9*
Gypsum Backing Board	C 1396, Sec. 6*
Gypsum Coreboard	C 1396, Sec 6*
Gypsum Shaftliner Board	C 1396, Sec. 6*
Water-Resistant Gypsum Backing Board	C 1396, Sec. 7*
Gypsum Ceiling Board	C 1396, Sec. 12*
Exterior Gypsum Soffit Board	C 1396, Sec. 8*
Gypsum Base for Veneer Plasters	C 1396, Sec. 10*
Glass Mat Gypsum Panels	C 1658
Glass Mat Gypsum Substrate for Use as Sheathing	C 1177
Glass Mat Water-Resistant Gypsum Backing Panel	C 1178
Fiber Reinforced Gypsum Panels	C 1278
Abuse-Resistant Nondecorated Interior Gypsum Panel Products	C 1629
Joint Compound	C 475
Gypsum Plasters	C 28
Gypsum Veneer Plaster	C 587
Metal Lath	C 847
Accessories for Gypsum Wallboard and Gypsum Veneer Base	C 1047
Nails for the Application of Gypsum Board	C 514
Steel Drill Screws for the Application of Gypsum Panel Products or Metal Plaster Bases (Types G, W, and S)	C 1002
Steel Drill Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Steel Studs from 0.033 in. (0.84 mm) to 0.112 in. (2.84 mm) in Thickness (Type S-12)	C 954
Nonstructural Steel Framing Members	C 645
Load-Bearing (Transverse and Axial) Steel Studs, Runners (Tracks), and Bracing or Bridging for Screw Application of Gypsum Panel Products and Metal Plaster Bases	C 955

* ASTM Specification C 1396 is a consolidation of previous ASTM Standards C 36, C 37, C 79, C 442, C 588, C 630, C 931, C 960, and C 1395, which have been withdrawn.

ABBREVIATIONS

Abbreviations used in this Manual are shown in Table IV (also see Tables I and II on page 10).

TABLE IV
ABBREVIATIONS

ASTM	ASTM International (formerly American Society for Testing and Materials)
C&P	carpet and pad
dB	decibel
dia	diameter
DOC	U. S. Department of Commerce
est	estimated
FSTC	Field Sound Transmission Class
FSTL	Field Sound Transmission Loss
ft	foot
ga	gage or gauge
galv	galvanized
Hz	hertz (cycles/second)
hr	hour
IIC	Impact Insulation Classification
in.	inch
lab	laboratory
lb	pound
mfr	manufacturer
mm	millimeter
min	minimum
nom	nominal
NLB	nonload-bearing
o.c.	on center
oz	ounce
pcf	pounds per cubic foot
psf	pounds per square foot
rev	revised
sq	square
STC	Sound Transmission Class
STL	Sound Transmission Loss
T&G	tongue and groove

SECTION II - REQUIREMENTS FOR FIRE PROTECTION

FIRE RESISTIVE PROPERTIES OF GYPSUM

Gypsum is approximately 21 percent by weight chemically combined water which greatly contributes to its effectiveness as a fire resistive barrier. When gypsum board or gypsum plaster is exposed to fire, the water is slowly released as steam, effectively retarding heat transmission (Figure 1). It can, in a sense, be compared to what happens when a blowtorch is turned on a block of ice. Although the ice is being melted, one can hold a hand on the opposite side without being burned. Even though the ice gets very thin it effectively blocks the transfer of the intense heat and one's hand would not be burned until the ice is melted.

When gypsum-protected wood or steel structural members are exposed to a fire, the chemically combined water (being released as steam) acts as a thermal barrier until this slow process, known as calcination, is completed. The temperature directly behind the plane of calcination is only slightly higher than that of boiling water (212°F), which is significantly lower than the temperature at which steel begins losing strength or wood ignites. Once calcination is complete, the in-place calcined gypsum continues to act as a barrier protecting the underlying structural members from direct exposure to flames.

TYPE X GYPSUM BOARD

ASTM C 1396 describes two types of gypsum board - regular and type X - each providing a different degree of fire resistance. Where fire-resistance rated systems are specified, type X gypsum board is typically required to achieve the rating. Type X gypsum board is defined in ASTM C 1396 as gypsum board that provides not less than one-hour fire resistance for boards 5/8 inch thick or not less than 3/4-hour fire-resistance rating for boards 1/2 inch thick, applied parallel with and on each side of load bearing 2x4 wood studs spaced 16 inches on center with 6d coated nails, 1 7/8 inch long, 0.095 inch diameter shank, 1/4 inch diameter heads, spaced 7 inches on center with gypsum board joints staggered 16 inches on each side of the partition and tested in accordance with the requirements of ASTM E 119.

In order to qualify for use in generic systems contained in this Manual, the Gypsum Association also requires that 1/2 inch type X gypsum board shall achieve a one-hour fire-resistance rating when applied to a floor-ceiling system as described by GA File No. FC 5410 on page 175.

Where 3/4 inch or 1 inch gypsum board is described as "type X" in proprietary systems contained in this Manual, consult the manufacturer to determine what specific products are required.

PERFORMANCE OF GYPSUM PLASTER

Job performance of gypsum plaster systems can be affected by several factors such as: extreme weather conditions, poor or no ventilation, thermal shock, unusual framing or frame loading, etc. Precautions shall be taken to prevent these and other adverse conditions.

Mix ratios such as 1:2 gypsum-perlite, gypsum-vermiculite, or gypsum-sand are used to describe a mixture consisting of 100 pounds of gypsum plaster to 2

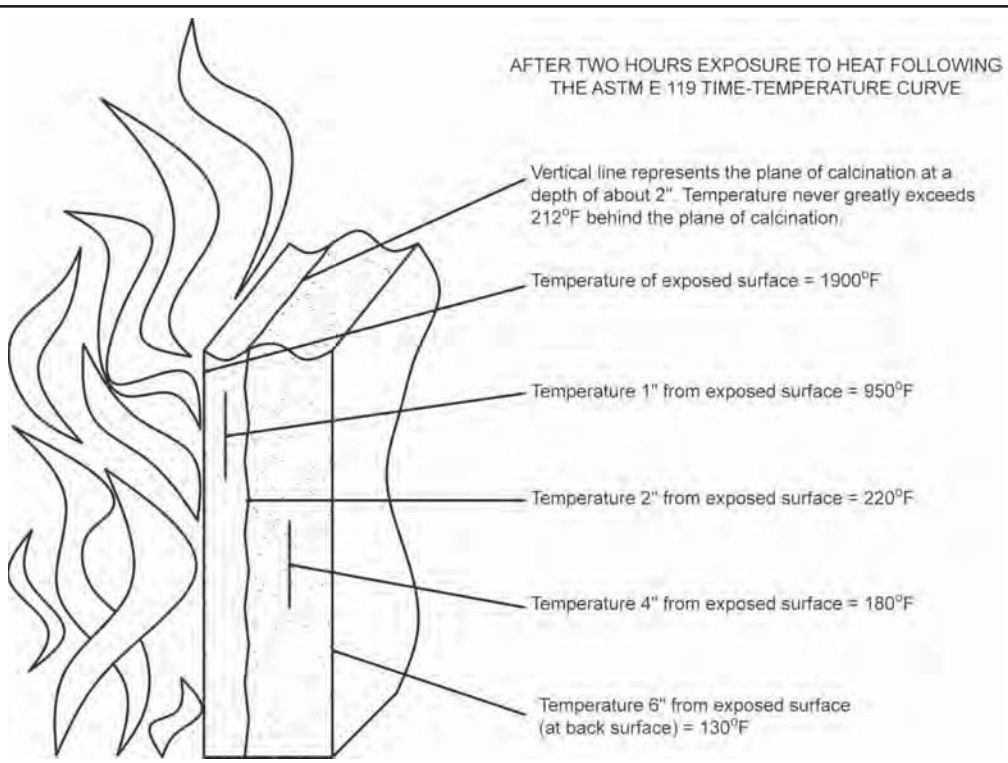

Figure 1
How Gypsum Retards Heat Transmission

cubic feet of aggregate (3 cubic feet where the ratio is given as 1:3). Many fire tests have been conducted to show that 1:2 gypsum-vermiculite mix may be substituted for 1:3 gypsum-vermiculite mix in all fire-resistance rated systems. A 1:2 gypsum-perlite mix may be substituted for 1:3 gypsum-perlite mix in one-hour and two-hour rated systems only. Perlite and vermiculite shall be permitted to be interchanged in one-hour and two-hour rated systems.

Plaster thicknesses are measured from the face of the lath, regardless of the plaster base used.

FIRE RESISTANCE TESTS

All fire-resistance classifications described in this Manual are derived from full-scale fire tests conducted in accordance with the requirements of ASTM E 119 or CAN/ULC-S101 (as amended and in effect on the date of the test) by recognized independent laboratories. Fire-resistance classifications are the results of tests conducted on systems made up of specific materials put together in a specified manner.

There are a number of nationally recognized laboratories capable of conducting tests to establish fire-resistance classifications according to the procedures outlined in ASTM E 119 or CAN/ULC-S101. The conditions under which tests are conducted are thoroughly detailed and the fire-resistance classification is established as the time at which there is excessive temperature rise, passage of flame, or structural collapse. In addition, failure may result because of penetration by the pressurized hose stream required in the fire test procedure for walls.

With reference to all tested systems, ASTM E 119 states:

> It is the intent that classifications shall register performance during the period of exposure and shall not be construed as having determined suitability for use after fire exposure.

Comprehensive research by fire protection experts has determined the average combustible content normally present within any given occupancy. In addition, evacuation times, the time required for the contents to be consumed by fire, and the resulting temperature rise have been quantified. Fire-resistance requirements are established accordingly in building codes and similar regulations.

In ASTM E 119 fire tests, wall, ceiling, column, and beam systems are exposed in a furnace which reaches the indicated average temperatures at the time stated in the standard time-temperature curve (Figure 2) and Appendix X1 of ASTM E 119. The unexposed surface of all systems refers to the surface away from the fire during a test. The exposed surface refers to the surface facing the fire.

WALL AND PARTITION SYSTEMS

All walls and partitions tested and classified are required to be at least 100 square feet in area with no edge dimension less than nine feet. Surface temperatures on the unexposed side of the test specimen are measured at a minimum of nine locations.

When load-bearing walls and partitions are tested, the applied load is required to simulate the working stresses of the design.

Walls and partitions are required to stop flame or hot gases capable of igniting cotton waste. The average temperature of the unexposed surface is not permitted to increase more than 250°F above ambient nor is any individual thermocouple permitted to rise more than 325°F above ambient. A duplicate of the system (rated for one-hour fire resistance or more) is fire tested for one-half the specified fire-resistance period, but no longer than one-hour, after which it is required to withstand the impact, erosion, and cooling effect of a hose stream.

Openings in walls for fire door frames and fire window frames shall be coordinated between the architect, the general contractor, the drywall contractor, and the frame supplier to ensure that installation details for the wall and the frame are considered. The installation instructions supplied with frames vary and shall be followed to comply with local code requirements. All fire door and fire window assemblies are required to be installed in accordance with ANSI/NFPA 80 and subject also to the conditions, limitations, and/or allowances of their certification label and listing.

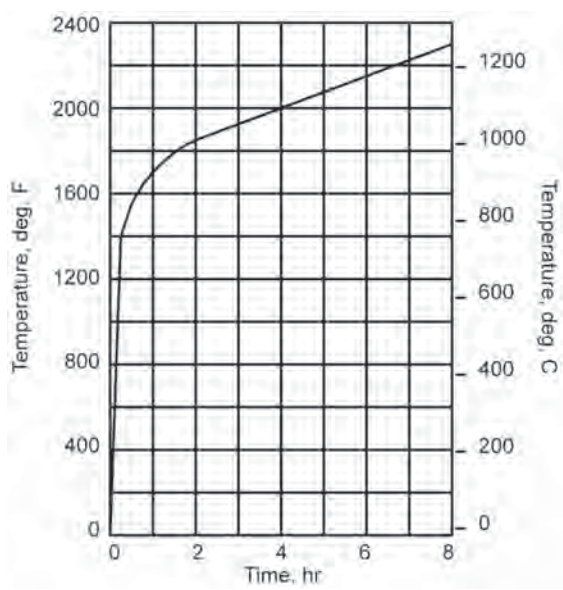

Figure 2
Standard Time-Temperature Curve
(ASTM E 119)

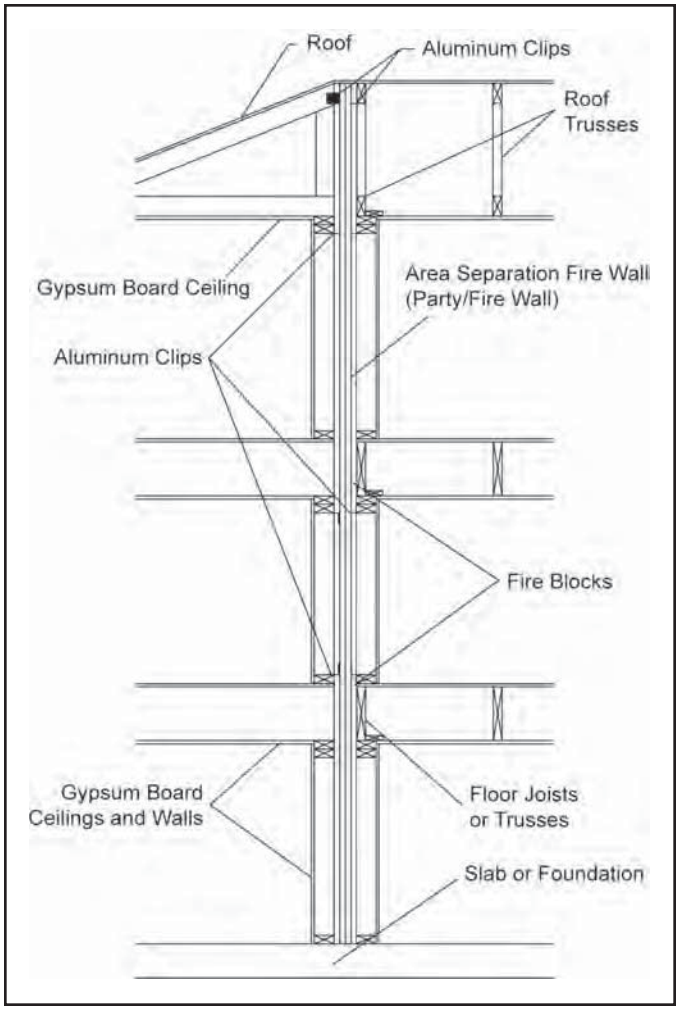

Figure 3
Typical Gypsum Board Area Separation Fire Wall Construction

AREA SEPARATION FIRE WALLS (PARTY/FIRE WALLS)

Fire-resistance rated gypsum board systems (solid and cavity types) can serve as area separation fire walls (also known as party walls or fire walls) between adjacent wood frame and steel frame dwelling units such as townhouses, condominiums, and apartments; and in commercial and institutional buildings. These walls are erected one floor at a time, beginning at the foundation and continuing up to or through the roof. At intermediate floors metal floor/ceiling track shall be installed back-to-back to secure the top of the lower section of the partition to the bottom of the next section being installed.

At intermediate floors and other specified locations the area separation fire walls shall be attached to adjacent wood or steel framing on each side with aluminum clips that soften when exposed to fire (Figure 3). If one side of the structure becomes involved in a fire, the clips on the fire side allow collapse of the structure on that side. The clips on the other side support the area separation fire wall keeping it in place, thereby protecting the adjacent structure. Consult gypsum board manufacturer for clip detail, placement, and height limitations. Openings and through penetrations, including protected openings and penetrations, are not permitted in the area separation fire walls contained in this manual.

FLOOR-CEILING AND ROOF-CEILING SYSTEMS

Floor-ceiling and roof-ceiling systems tested and classified are required to be a minimum of 180 square feet in area with their shortest edge dimension not less than 12 feet. The system is required to sustain the design load throughout the test and not permit the passage of either flame or hot gases capable of igniting cotton waste. Surface temperatures on the unexposed side of the test specimen are measured at a minimum of nine locations. The average temperature of the unexposed surface is not permitted to increase more than 250°F above ambient nor is any individual thermocouple permitted to rise more than 325°F above ambient.

Ceiling Openings

Many fire-resistance rated floor-ceiling systems have been tested with openings through the ceiling membrane for air ducts, electrical outlets, and lighting fixtures.

Building codes permit air duct openings in most ceiling systems when the air duct openings are protected with approved ceiling dampers.

Building codes also permit membrane penetrations in maximum two-hour fire-resistance-rated horizontal systems by steel outlet boxes that do not exceed 16 square inches in area provided the aggregate area of such penetrations does not exceed 100 square inches in any 100 square feet of ceiling area and the annular space between the ceiling membrane and the box does not exceed 1/8 inch.

Many approved recessed lighting fixtures require special protection. Consult the fire test report or listing for the specific system for protection details and the opening area limitation.

PROTECTION SYSTEMS FOR STEEL BEAMS, GIRDERS, AND TRUSSES

Beams are tested with superimposed loads applied to simulate the maximum theoretical dead and live loads permitted by nationally recognized design standards. A fire-resistance rating is established for a system when the test specimen supports the load during the test and meets specific temperature requirements for the prescribed period. Beams, girders, and trusses shall be protected by either (1) a continuous ceiling membrane of either gypsum lath and plaster or gypsum board or (2) enclosing them individually.

Continuous Ceiling Protection

Building codes allow for the use of the gypsum board or gypsum lath and plaster ceilings described in the Floor-Ceiling Systems portion of this Manual for beam or girder protection. The complete floor-ceiling system shall provide no less than the rating required for the structural member being protected.

If the bottom of the beam projects 6 inches or less below the plane of the ceiling, the ceiling is furred down and around the beam (Figure 4). If the projection is greater than 6 inches, the gypsum board or lath and plaster beam protection system shall extend from the ceiling to the floor above. (See Individual Encasement Protection.)

A ceiling used as membrane fireproofing usually consists of either gypsum board or gypsum plaster over gypsum or metal lath. These systems may be either attached directly to or suspended from the primary structural elements. The tested assembly consists of the ceiling membrane, beams, girders, joists, or trusses and the floor or roof deck system above.

Individual Encasement Protection

Individual encasement of beams, girders, and trusses with gypsum lath and plaster or gypsum board (Figure 5) is permitted where one or more of the following conditions exist.

1. When the fire-resistance requirement for the beam, girder, or truss is greater than the fire-resistance requirement for the floor-ceiling or roof-ceiling system being supported. Where there are relatively few three-hour or four-hour protected beams or girders, and only a two-hour floor-ceiling requirement, it is generally uneconomical to use a three-hour or four-hour floor-ceiling system throughout, or
2. When either no ceiling is required or a non-rated ceiling is used, or
3. When the bottom of the beam projects greater than 6 inches below the plane of the ceiling.

When structural members support more than one floor, or a floor and a roof, consult local building codes for requirements.

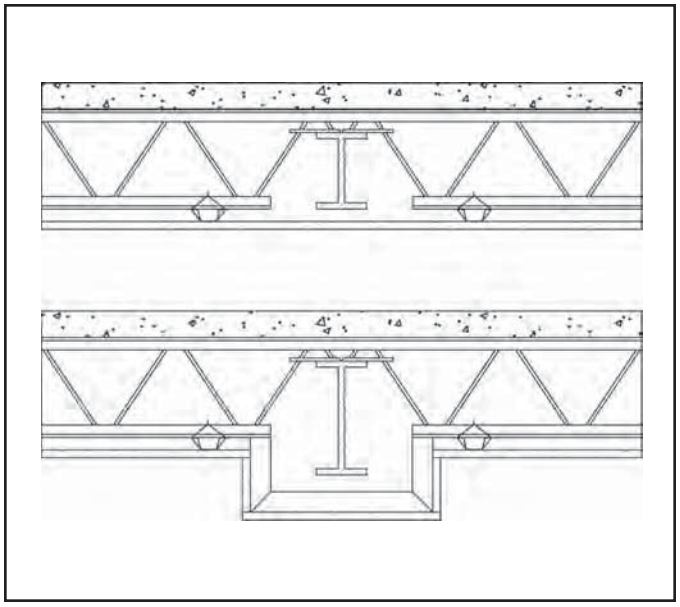

Figure 4
Membrane Protected Steel Beam- Continuous

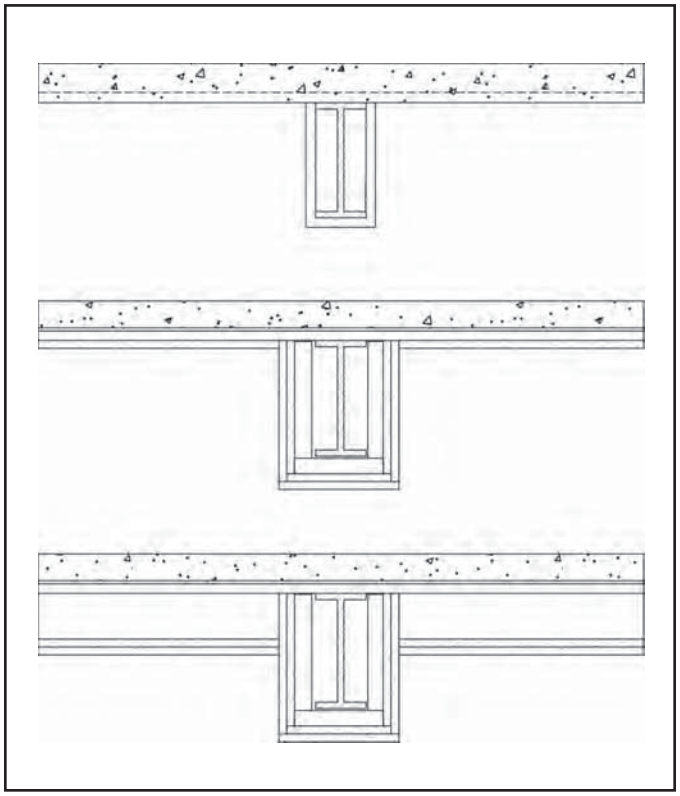

Figure 5
Steel Beam - Individual Encasement Protection

PROTECTION SYSTEMS FOR STEEL COLUMNS

Columns are tested under a temperature limit criteria. The temperature of the steel is measured by not less than four thermocouples at each of four levels. A test is successful when the average temperature of any level does not exceed 1000°F and no individual thermocouple exceeds 1200°F within the prescribed time period.

All column systems in this Manual were tested with the column size specified in the system. Fire-resistance ratings are also applicable to steel columns heavier than those specified.

Typical column protection systems are shown in Figures 6 and 7.

PROTECTION OF WOOD COLUMNS AND BEAMS

Fire-resistance ratings for exposed structural wood elements are typically calculated using either the T.T. Lie method or the National Design Specifications (NDS) Method. There is no widely accepted method for calculating the fire-resistance rating of an individual structural wood column or beam protected with gypsum board applied to its exposed surfaces. In general, fire resistance of the unprotected column or beam is calculated using one of the above methods and the rating of the protected column or beam is estimated by adding 30 min. for a single layer of 5/8 inch (15.9 mm) Type X gypsum board or 60 min. for a double layer of 5/8 inch (15.9 mm) Type X gypsum board.

A discussion of the calculation methods is contained in the following documents:

1. *Calculating the Fire Resistance of Exposed Wood Members*, AWC 10, published by the American Wood Council.
2. *Analytical Methods for Determining Fire Resistance of Timber Members* published by the U.S. Department of Agriculture, Forest Products Laboratory.
3. *Calculation of Fire Resistance of Glued Laminated Timbers*, AITC Technical Note 7, published by American Institute of Timber Construction.

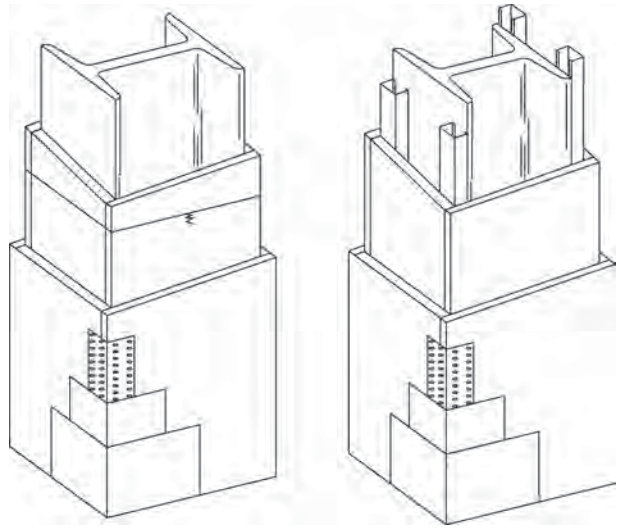

Figure 6
Column Protection -
Gypsum Panel Product

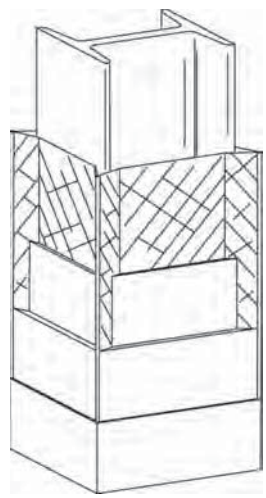

Figure 7
Column Protection -
Metal Lath and Plaster

FIRE BLOCKING

All fire-resistive systems shall be fire blocked in accordance with applicable code requirements.

All penetrations in a fire rated system shall be filled with firestopping material as required by the local code.

SMOKE BARRIERS

Building codes require certain designated wall and ceiling systems to function as "smoke barriers" which are defined in the codes as continuous membranes that resist the passage of smoke. Fire-resistive gypsum systems with perimeters and penetrations sealed to achieve listed STCs also function to resist the passage of smoke.

Minimum one-hour fire-resistance rated gypsum board systems with joints finished in accordance with Level 1 as specified in GA-214 and perimeters, openings, and penetrations sealed as required by the applicable building code satisfy building code requirements for a smoke barrier.

PERIMETER RELIEF AND CONTROL JOINTS

Engineering studies and fire tests have been conducted on perimeter relief and control joint systems. This research demonstrates that the perimeter relief systems in this Manual can be used in most nonload-bearing metal stud partition systems without reducing the fire-resistance rating of the partition. The research also demonstrates that the control joint systems in this Manual can be used in all one-hour or two-hour, load-bearing or nonload-bearing, wood or steel framed, wall and partition systems in this Manual without adversely affecting the fire-resistance rating. The tests were conducted in accordance with ASTM E 119 and utilized perimeter relief systems and control joint systems as detailed herein. Other similar systems are available from individual manufacturers.

See the section under Strain Relief Systems beginning on page 222 for specific systems.

SURFACE BURNING CHARACTERISTICS

The test method used to establish surface burning characteristics is ASTM E 84 or CAN/ULC-S102, commonly referred to as the Tunnel Test. This test measures the relative flame spread and relative amount of smoke generated by the material being tested when compared to inorganic reinforced cement board and red oak flooring. Table V lists typical surface burning characteristics for gypsum products as well as the standard materials referenced in the test method.

Surface burning characteristics are intended to be used as a guide in the selection and use of interior finish materials and are obtained under controlled laboratory conditions.

TABLE V
SURFACE BURNING CHARACTERISTICS

	FLAME SPREAD	SMOKE DEVELOPED
Inorganic Reinforced Cement Board	0	0
Gypsum Plaster	**0**	**0**
Glass Mat Gypsum Substrate for Use as Sheathing	**0**	**0**
Fiber Reinforced Gypsum Panels	**5**	**0**
Gypsum Lath	**10**	**0**
Exterior Gypsum Soffit Board	**15**	**0**
Gypsum Wallboard	**15**	**0**
Gypsum Sheathing	**15**	**0**
Water-Resistant Gypsum Backing Board	**15**	**0**
Red Oak	100	100

SECTION III - SOUND CONTROL

SOUND INSULATION

The first essential for airborne sound insulation using any system is to close off air leaks and/or flanking paths by which noise can go through or around the system. Small cracks or holes will increase the sound transmission at the higher frequencies. This can have a detrimental effect on the overall acoustical performance and the STC, particularly for higher rated systems. Failure to observe special construction and design precautions can reduce the effectiveness of the best planned sound control methods.

Systems shall be airtight. Recessed wall fixtures, such as medicine cabinets or electrical, telephone, television, and intercom outlets, that penetrate the gypsum board shall not be located back-to-back or in the same stud cavity. Any opening for fixtures or pipes shall be cut to the proper size and sealed. The entire perimeter of a sound insulating system shall be made airtight to prevent sound flanking. Flexible sealant or an acoustical gasket shall be used to seal between the STC rated system and all dissimilar surfaces and also between the system and similar surfaces where perimeter relief is required. TAPING GYPSUM BOARD WALL AND WALL-CEILING INTERSECTIONS PROVIDES AN ADEQUATE AIR SEAL AT THESE LOCATIONS. ASTM E 497, *Standard Practice for Installing Sound-Isolating Lightweight Partitions*, provides additional information. Consult the manufacturer of the gypsum board for any special recommendations.

Systems are grouped in ranges according to their Sound Transmission Class (STC) or Field Sound Transmission Class (FSTC). The higher ranges are shown first. All of the sound tests referenced were conducted according to the requirements of either ASTM E 90, for laboratory tests, or ASTM E 336, for field tests.

The STCs and FSTCs in this manual are grouped as follows: 35-39, 40-44, 45-49, etc. A difference of 1 decibel (dB) is generally recognized as imperceptible while a difference of 3 dB is barely perceptible and a difference of 6 dB is clearly perceptible. The designer shall adhere to the specified materials and construction details for STC and FSTC rated systems, particularly in plaster systems, because substitution of lightweight aggregates for sand, or reduction of the sand proportion, may reduce the rating.

- All openings through the system, and its entire perimeter, shall be sealed airtight.
- Substituting mechanical fasteners for adhesives, or the use of more fasteners, may affect the rating.

Details of sound tests issued by sound testing agencies are on file and a summary is available from the Gypsum Association or the test sponsor.

Figure 8 shows three typical resilient channel configurations. Where resilient channels are included in systems, the resilient channels are shown by a dashed line to distinguish them from rigid furring channels. Figure 9 on page 20 distinguishes between standard construction practices and those practices recommended for improved sound control.

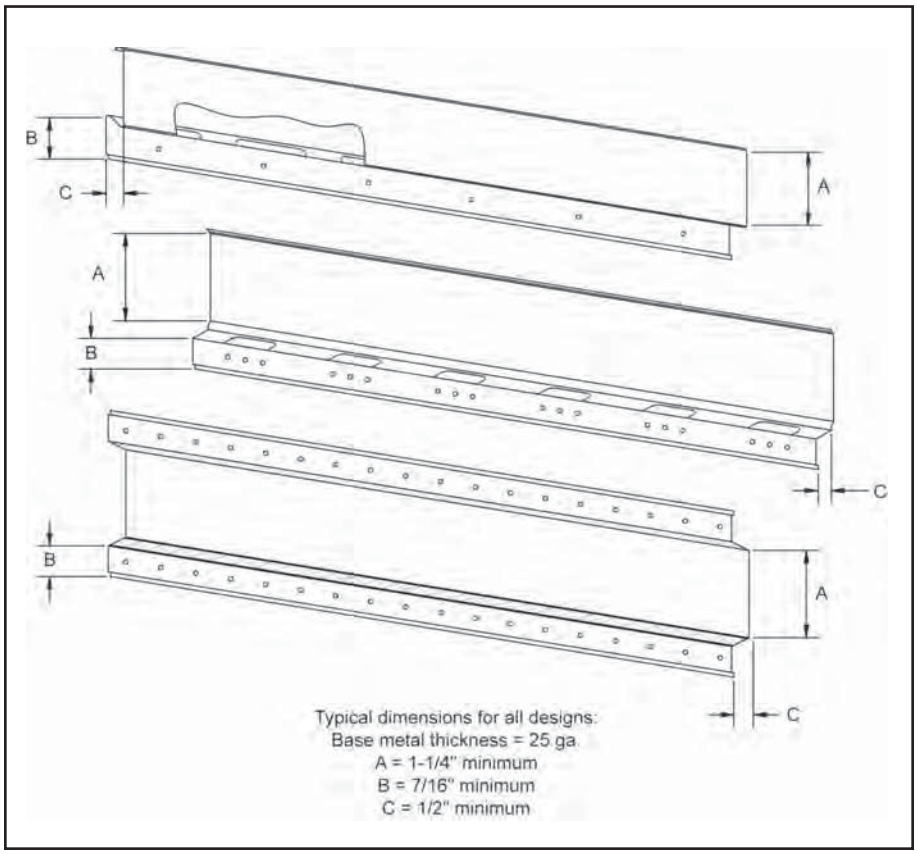

Figure 8
Typical Resilient Furring Channels

Figure 9
Sound Isolation Construction

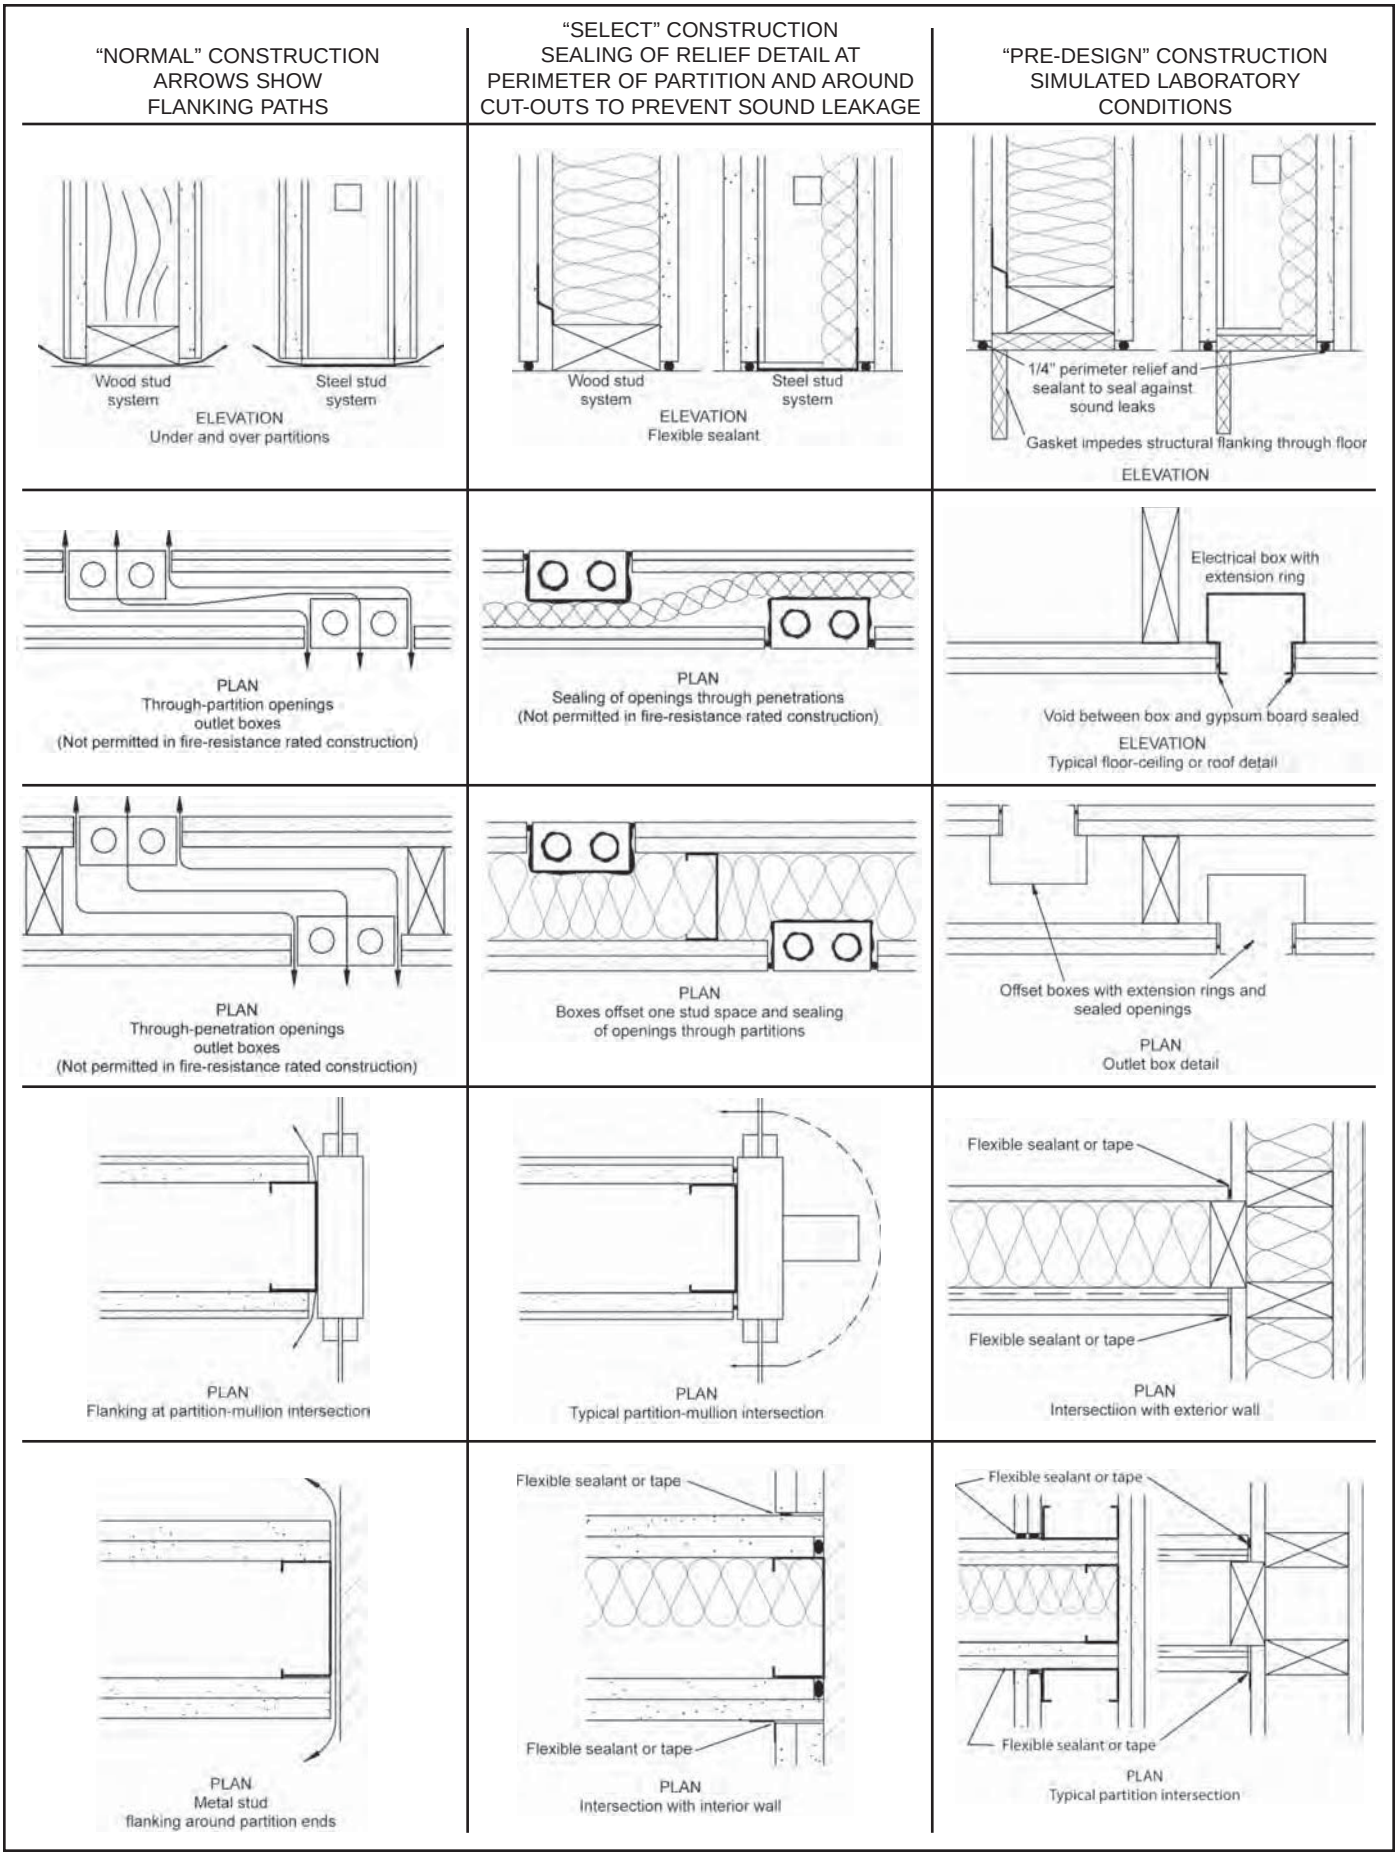

SOUND TRANSMISSION LOSS TESTS

ASTM E 90, *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions*, is the procedure for measuring the sound transmission loss (STL) in a laboratory. The STL is the difference between the sound energy (sound pressure level) in a source room and a receiving room when the two rooms are separated by the system being tested.

ASTM E 336, *Standard Test Method for Measurement of Airborne Sound Insulation in Buildings*, is the procedure to determine the field sound transmission loss (FSTL) between two rooms under field conditions.

The STL or the FSTL is measured at 1/3 octave test frequencies (Hz) as follows and the sound transmission loss curve is plotted:

125	315	800	2000
160	400	1000	2500
200	500	1250	3150
250	630	1600	4000

A system's overall effectiveness in resisting the transmission of airborne sound, whether it is a wall, partition, or floor-ceiling, is reported as a single number derived from an analysis of the STL or FSTL curve. This rating is the Sound Transmission Class (STC) or Field Sound Transmission Class (FSTC). This Manual uses STC/FSTC ranges to make comparing systems more significant.

ASTM E 413, *Classification for Rating Sound Insulation*, is the method used to derive the STC/FSTC from the STL/FSTL curve. Using the rules stated in ASTM E 413, a reference contour is fitted to the sound transmission loss curve. The STC/FSTC is the point where the reference contour crosses the 500 Hz line.

The reference contour, shown by the dashed line in Figure 10, has a flat portion from 4000 Hz to 1250 Hz. It drops 5 dB between 1250 Hz and 400 Hz, and 15 dB between 400 Hz and 125 Hz. In fitting the reference contour to the measured curve, the following conditions are required to be met:

1. The STL curve is not permitted to be greater than 8 dB below the reference contour at any test frequency, and
2. The sum of the dB differences between the points on the reference contour and the corresponding points on the STL curve at each of the test frequencies is not permitted to be greater than 32 dB.

Some of the STC ratings in this Manual were derived according to slightly different standards in use prior to 1970. For instance, ASTM E 90-61T, the previous sound test procedure, called for measurements at 1/2 octave frequencies, and the rules for fitting the standard curve were different.

The smallest dimension of the system tested in accordance with ASTM E 90 is not permitted to be less than 7 feet, 10 inches and the minimum volume for each of the sound source and receiving rooms is 2,825 cubic feet. The system is constructed to separate the source and receiving rooms, which are arranged so that the only significant sound transmission is through the test specimen.

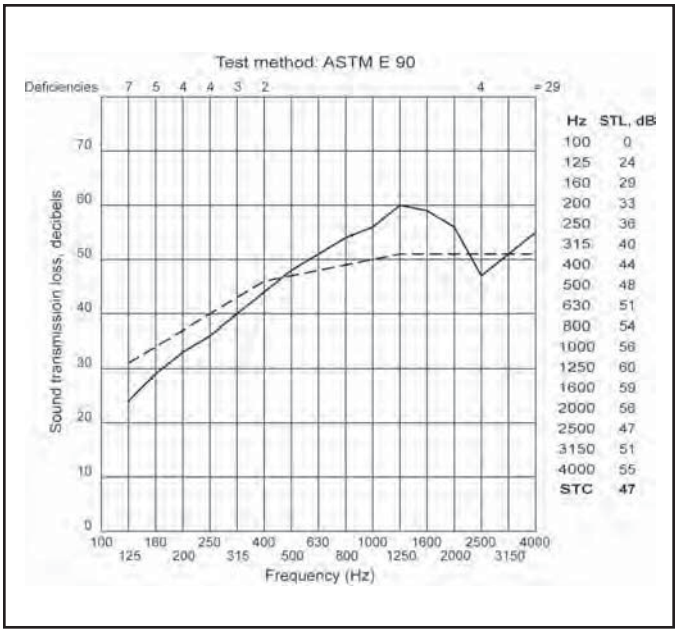

Figure 10
STL Curve

The source room contains one or more sound sources, a diffusing system such as multiple stationary and/or rotating reflectors, and microphones located to adequately sample the sound field in the space. A single microphone on a rotating boom may be optionally used. The receiving room is similarly equipped, except that the sound source(s) is used only to determine the reverberation time for correction purposes. The sound measurements in both rooms are made according to ASTM E 90.

Research by recognized sound test authorities indicates that the STC's on unsymmetrical walls are not affected by sound testing from either side. Therefore, the laboratory sound source side is not indicated for unsymmetrical systems in this Manual.

IMPACT NOISE TEST

To determine the Impact Insulation Classification (IIC) of a floor, a standard ISO impact machine with steel hammers taps on a test floor system installed above a special receiving room. Microphones in the receiving room record the average sound pressure level produced by the tapping machine at 1/3 octave frequency bands between 100 and 3150 Hz. These measured levels are then normalized to a standard room absorption. The method used is described in ASTM E 492, *Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine*.

The IIC is determined by comparing the normalized impact sound pressure levels at the 16 test frequencies with an IIC reference contour. The reference contour has a flat portion from 100 to 315 Hz, a middle line segment decreasing 5 dB in the interval 315 to 1000 Hz, followed by a high frequency line segment decreasing 15 dB in the interval 1000 to 3150 Hz. In fitting the reference contour to the measured sound pressure levels in the receiving room, the following conditions are required to be met:

1. The noise level at any test frequency is not permitted to be greater than 8 dB above the reference contour, and
2. The sum of the dB differences between the points on the reference contour and the corresponding points on the curve of the normalized impact noise levels at each of the test frequencies is not permitted to be greater than 32 dB.

The IIC for the specimen is the difference between 110 and the value on the normalized impact noise level scale (i.e., ordinate scale) at 500 Hz of the lowest contour for which the above conditions are fulfilled.

The IIC listings for floor-ceiling systems in this Manual are for bare floors (no floor covering) and for the addition of a carpet over a separate pad, which is identified as "C&P."

Although any carpet, with or without a pad, will improve the IIC, a heavy wool carpet over a good quality pad will make a significant improvement, as illustrated for FC 5300 on page 174. The addition of a 44 oz. woven loop pile carpet over a 40 oz. hair felt pad increased the IIC from 38 to 63. The IIC (C&P) listings in this Manual are for the carpet and pad described above for FC 5300 unless otherwise noted. The use of other types of carpets, both with and without pads, will result in increases in the IIC, and in some instances may equal that achieved by use of the aforementioned carpet and pad.

NOTES

SECTION IV - FIRE RESISTANCE AND SOUND CONTROL SYSTEMS

INDEX TO SYSTEMS BY STC RATING

NONCOMBUSTIBLE WALLS & PARTITIONS

STC	GA FILE NO.
65 - 69	WP 5050
	WP 5051
	WP 5060
60 - 64	WP 1450
	WP 1451
	WP 1452
	WP 1453
	WP 1454
	WP 2945
	WP 5000
	WP 5001
	WP 5005
	WP 5006
	WP 5070
	WP 5071
55 - 59	WP 1009
	WP 1011
	WP 1012
	WP 1013
	WP 1014
	WP 1015
	WP 1017
	WP 1018
	WP 1470
	WP 1502
	WP 1503
	WP 1504
	WP 1505
	WP 1506
	WP 1510
	WP 1515
	WP 1520
	WP 1521
	WP 1522
	WP 1523
	WP 1524
	WP 2750
	WP 2800
	WP 2960
	WP 2961
	WP 2963
	WP 2964
	WP 2965
	WP 2966
	WP 5007
	WP 5105

STC	GA FILE NO.
50 - 54	WP 1021
	WP 1022
	WP 1023
	WP 1041
	WP 1047
	WP 1048
	WP 1049
	WP 1050
	WP 1051
	WP 1052
	WP 1053
	WP 1055
	WP 1056
	WP 1057
	WP 1058
	WP 1530
	WP 1545
	WP 1546
	WP 1548
	WP 1555
	WP 1556
	WP 1560
	WP 1561
	WP 1565
	WP 1570
	WP 2921
	WP 2922
	WP 2924
	WP 2925
	WP 2970
	WP 5015
	WP 5017
	WP 5130
	WP 5910
	WP 6525

STC	GA FILE NO.
45 - 49	WP 0700
	WP 1070
	WP 1071
	WP 1072
	WP 1073
	WP 1074
	WP 1076
	WP 1077
	WP 1078
	WP 1079
	WP 1081
	WP 1082
	WP 1083
	WP 1084
	WP 1085
	WP 1090
	WP 1615
	WP 1616
	WP 1625
	WP 1630
	WP 1632
	WP 1635
	WP 6010
	WP 6020
	WP 6025
	WP 6040
	WP 6070
40 - 44	WP 1204
	WP 1206
	WP 1240
	WP 1290
	WP 1296
	WP 1714
	WP 1716
	WP 6130
	WP 6135
	WP 6152
35 - 39	WP 1311
	WP 1330
	WP 1340
	WP1350
	WP 1370
	WP 1380
	WP 1390
	WP 1400
	WP 1830
	WP 1841
	WP 1870
	WP 6240
	WP 6250
	WP 6254
30 - 34	WP 1930

STEEL FRAMED EXTERIOR WALLS

STC	GA FILE NO.
55 - 59	WP 7920

INDEX TO SYSTEMS BY STC RATING

WOOD FRAMED WALLS & PARTITIONS

STC	GA FILE NO.
60 - 64	WP 3010
	WP 5450
55 - 59	WP 3110
	WP 3810
	WP 3812
	WP 3820
	WP 3825
	WP 5508
	WP 5509
	WP 5510
	WP 5520
50 - 54	WP 3005
	WP 3239
	WP 3240
	WP 3241
	WP 3242
	WP 3243
	WP 3244
	WP 3245
	WP 3246
	WP 3247
	WP 3251
	WP 3260
	WP 3261
	WP 3910
	WP 5530
45 - 49	WP 3330
	WP 3340
	WP 3341
	WP 3343
	WP 3344
	WP 3360
	WP 3370
	WP 5512
40 - 44	WP 3380
	WP 3430
	WP 3431
	WP 3436
	WP 3441
	WP 4135
	WP 4136
	WP 5515
35 - 39	WP 3510
	WP 3520
30 - 34	WP 3605
	WP 3614
	WP 3615
	WP 3620

SHAFT WALLS

STC	GA FILE NO.
50 - 54	WP 7051
	WP 7052
	WP 7053
	WP 7054
	WP 7054.4
	WP 7056
	WP 7057
	WP 7058
	WP 7059
	WP 7060
	WP 7061
	WP 7062
	WP 7064
	WP 7065.2
	WP 7065.4
	WP 7065.5
	WP 7400
	WP 7422
45 - 49	WP 6800
	WP 7068
	WP 7071
	WP 7072
	WP 7073
	WP 7076
	WP 7077
	WP 7078
	WP 7079
	WP 7080
	WP 7082
	WP 7083
	WP 7084
	WP 7095
	WP 7096
	WP 7097
	WP 7098
	WP 7099
	WP 7454
40 - 44	WP 6850
	WP 6851
	WP 6855
	WP 6904
	WP 6905
35 - 39	WP 7008
	WP 7118
	WP 7119
	WP 7125
30 - 34	WP 7210

AREA SEPARATION FIRE WALLS

STC	GA FILE NO.
65 - 69	ASW 0800
	ASW 0810
60 - 64	ASW 0980
	ASW 0985
	ASW 0997
	ASW 0998
	ASW 0999
	ASW 1000
	ASW 1003
	ASW 1004
	ASW 1006
50 - 54	ASW 1100
	ASW 1105
	ASW 1111
45 - 49	ASW 1205
	ASW 1206
	ASW 1207
	ASW 1215

NONCOMBUSTIBLE FLOOR-CEILINGS

STC	GA FILE NO.
60 - 64	FC 1800
55 - 59	FC 1900
	FC 1901
	FC 1902
50 - 54	FC 1105
	FC 2030
	FC 3012

STEEL FRAMED FLOOR-CEILINGS WOOD FLOOR

STC	GA FILE NO.
50 - 54	FC 4340
45 - 49	FC 4370
35 - 39	FC 4490

WOOD FRAMED FLOOR-CEILINGS

STC	GA FILE NO.
60 - 64	FC 5011
	FC 5012
55 - 59	FC 5102
	FC 5103
	FC 5104
	FC 5105
	FC 5107
	FC 5109
50 - 54	FC 5111
	FC 5112
	FC 5115
	FC 5116
	FC 5119
	FC 5120
45 - 49	FC 5240
	FC 5241
	FC 5242
	FC 5250
40 - 44	FC 5300
	FC 5310
35 - 39	FC 5406
	FC 5407
	FC 5408
	FC 5410
	FC 5415
	FC 5420
	FC 5470
	FC 5490

NOTE: Some systems appearing in previous editions have been deleted and are not included in this edition. In addition, several new systems have been added to this edition. The following lists may be helpful.

NEW SYSTEMS

WP 0700	WP 1503	WP 3614	WP 7058	WP 8204	FC 5753	CM 2457
WP 1009	WP 1504	WP 3646	WP 7059	WP 8206	RC 2503	CM 2603
WP 1011	WP 1555	WP 3825	WP 7065.2	WP 8418	RC 2504	CM 2604
WP 1012	WP 1556	WP 5000	WP 7065.4	ASW 0810	RC 2610	CM 2804
WP 1013	WP 1561	WP 5001	WP 7065.5	ASW 0997	RC 2611	CM 2805
WP 1014	WP 1948	WP 5007	WP 7068	ASW 1111	RC 2753	CM 3402
WP 1017	WP 1949	WP 5040	WP 7264	FC 1291	CM 1002	CM 3602
WP 1018	WP 1950	WP 5050	WP 7265	FC 2192	CM 1003	SRS 1101
WP 1047	WP 1951	WP 5051	WP 7400	FC 4990	CM 1403	SRS 1201
WP 1048	WP 1952	WP 5240	WP 7422	FC 5102	CM 1404	SRS 1401
WP 1056	WP 2750	WP 5450	WP 7492	FC 5103	CM 1453	SRS 2101
WP 1057	WP 2932	WP 5508	WP 7920	FC 5119	CM 1454	SRS 2201
WP 1058	WP 2966	WP 5509	WP 8008	FC 5504	CM 1603	SRS 5101
WP 1074	WP 2996	WP 6851	WP 8133	FC 5505	CM 1604	SRS 5102
WP 1418	WP 3005	WP 6855	WP 8134	FC 5514.4	CM 1852	SRS 5103
WP 1419	WP 3239	WP 6904	WP 8135	FC 5515.3	CM 1853	SRS 5104
WP 1420	WP 3246	WP 7024	WP 8136	FC 5524	CM 2018	SRS 7101
WP 1452	WP 3247	WP 7024.2	WP 8161	FC 5525	CM 2019	SRS 7201
WP 1453	WP 3251	WP 7024.3	WP 8162	FC 5526	CM 2403	SRS 7202
WP 1454	WP 3261	WP 7054	WP 8163	FC 5527	CM 2404	SRS 8101
WP 1502	WP 3344	WP 7054.4	WP 8164	FC 5528	CM 2456	SRS 8201

DELETED SYSTEMS

WP 3514	WP 7117	ASW 1201
WP 7001	WP 7256	FC 5520
WP 7069	WP 7258	CM 3400
WP 7070	WP 7452	CM 3600
WP 7074	WP 7453	
WP 7081	ASW 1002	

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 0700

PROPRIETARY

1/2 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, PROPRIETARY STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 3 5/8" 25 ga steel studs 24" o.c. with 1" Type S drywall screws 8" o.c.

Vertical joionts centered over studs and staggered one stud cavity on opposite sides. Horizontal joints need not be staggered or backed.

Sound tested with horizontal resilient furring channels 24" o.c. and 3 1/2" glass fiber insulation friction fit in stud space; and with gypsum board applied to studs with screws spaced 8" o.c. at vertical joints and 12" o.c. in the field and with gypsum board applied to channels with screws spaced 12" o.c. **(NLB)**

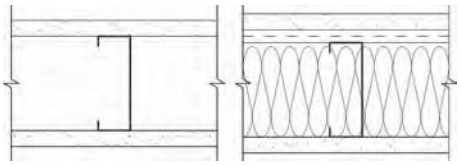

Thickness: 4 7/8 " (Fire)
5 3/8 " (Sound)
Approx. Weight: 7 psf
Fire Test: UL R1319, 11NK03873, 4-15-11, UL Design U407
Sound Test: RAL TL11-089, 5-23-11

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® 30

GA FILE NO. WP 1009

PROPRIETARY*

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X paper faced or glass mat faced gypsum panel product (sound board) applied parallel to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at floor and ceiling runners and intermediate studs.

Joints staggered 24" on each side and on opposite sides. Sound tested with studs space 16" o.c. and with 3 1/2" glass fiber friction fit in stud space. **(NLB)**



Thickness: 4 7/8 "
Approx. Weight: 5 psf
Fire Test: UL R6937, 06NK17962, 2-17-07; 09NK05706, 4-13-09; U465
Sound Test: OL 11-0606, 6-15-11

PROPRIETARY GYPSUM BOARD

Temple-Inland - 5/8" Type X ComfortGuard Sound Deadening Gypsum Board

GA FILE NO. WP 1011

PROPRIETARY*

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, GYPSUM PANEL PRODUCT, STEEL STUDS

One layer 5/8" proprietary gypsum board applied parallel to ONE SIDE of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at floor and ceiling runners and intermediate studs.

OPPOSITE SIDE: One layer 5/8" proprietary gypsum panel product applied parallel to studs with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at floor and ceiling runners and intermediate studs.

Joints staggered 24" on opposite sides. Sound tested with 3 1/2" glass fiber insulation friction fit in stud space. **(LOAD-BEARING)**

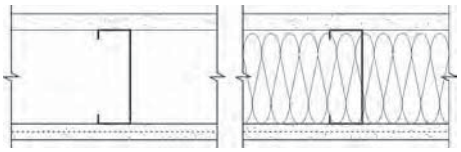

Thickness: 4 7/8"
Approx. Weight: 5 psf
Fire Test: UL R3660, 10CA25812, 8-17-10, UL Design U465
Sound Test: OL 10-1002, 10-18-10

PROPRIETARY GYPSUM PANEL PRODUCT

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type X Gypsum Board
- 5/8" SilentFX™

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1012

PROPRIETARY*

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM PANEL PRODUCT, STEEL STUDS

One layer 5/8" proprietary gypsum panel product applied parallel to each side of 3 5/8" 20 ga steel studs 16" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at floor and ceiling runners and intermediate studs.

Joints staggered 16" on opposite sides. Sound tested with 3 1/2" glass fiber insulation friction fit in stud space. **(LOAD-BEARING)**

PROPRIETARY GYPSUM PANEL PRODUCT

CertainTeed Gypsum Inc. - 5/8" SilentFX™

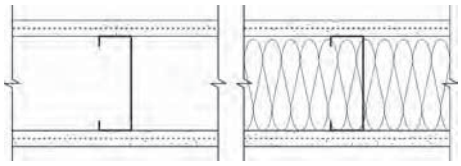

Thickness: 4 7/8"
Approx. Weight: 6 psf
Fire Test: UL R3660, 10CA25812, 8-17-10, UL Design U465
Sound Test: OL 11-0639, 6-27-11

GA FILE NO. WP 1013

PROPRIETARY

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, PROPRIETARY STEEL STUDS

Proprietary resilient sound isolation clip and 7/8" hat channel 24" o.c. attached at right angles to ONE SIDE of 3 5/8" steel studs 24" o.c. with #8 wafer head screws. One layer 5/8" proprietary type X gypsum wallboard applied parallel to channels with 1" Type S drywall screws 8" o.c. at vertical joints and intermediate studs and 12" o.c. at top and bottom runner. Glass fiber insulation, 6 1/4" thick, compressed and friction fit in stud space.

OPPOSITE SIDE: One layer 5/8" proprietary type X gypsum wallboard applied at right angles to studs with 1" Type S drywall screws 8" o.c. at vertical joints and intermediate studs and 12" o.c. at top and bottom runner.

Joints staggered 24" on opposite sides. **(NLB)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type X

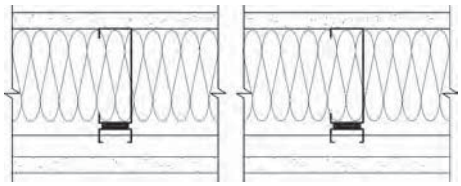

Thickness: 5 3/8 "
Approx. Weight: 5 psf
Fire Test: UL R14196, 09CA11604, 2-13-10, UL Design V489, System A
Sound Test: RAL TL10-270, 8-11-10

GA FILE NO. WP 1014

PROPRIETARY

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, PROPRIETARY STEEL STUDS

Resilient channels 24" o.c. attached at right angles to ONE SIDE of 3 5/8" steel studs 24" o.c. with 1/2" Type S-12 drywall screws. **Base** layer 5/8" proprietary type X gypsum wallboard applied at right angles to channels with 1" Type S drywall screws 8" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied at right angles to channels with 1 5/8" Type S drywall screws 16" o.c. Glass fiber insulation, 3 1/2" thick, friction fit in stud space.

OPPOSITE SIDE: One layer 5/8" proprietary type X gypsum wallboard applied parallel to studs with 1" Type S drywall screws 8" o.c.

Joints staggered 24" between layers and on opposite sides. **(NLB)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type X

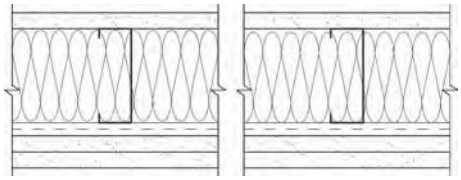

Thickness: 5 3/8 "
Approx. Weight: 5 psf
Fire Test: Based on UL R14196, 09CA11604, 2-13-10, UL Design V489, System A
Sound Test: RAL TL10-169, 7-15-11

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1015 — GENERIC

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/4" gypsum wallboard applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/16" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 1 1/2" mineral fiber insulation, 3.0 pcf, friction fit in stud space. **(NLB)**

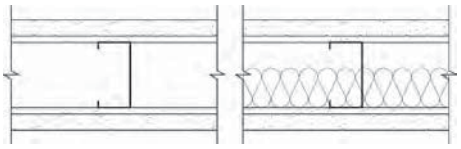

Thickness: 4 1/4"
Approx. Weight: 8 psf
Fire Test: See WP 1051 (FM WP 152-1, 1-22-69)
Sound Test: CK 684-14, 8-13-68

GA FILE NO. WP 1017 — PROPRIETARY*

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL STUDS

Base layer 5/8" proprietary type X paper faced or glass mat faced gypsum panel product applied parallel to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at wall perimeter and intermediate studs. **Face** layer 5/8" proprietary type X paper faced or glass mat faced gypsum panel product (sound board) applied parallel to ONE SIDE with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 3 1/2" glass fiber friction fit in stud space. **(NLB)**

PROPRIETARY GYPSUM BOARD

Temple-Inland	-	5/8" Type X
	-	5/8" Type X ComfortGuard Sound Deadening Gypsum Board



Thickness: 5 1/2"
Approx. Weight: 8 psf
Fire Test: See WP 1350 (FM WP-45, 6-19-68; OSU T-1770, 8-61; ULC 79T484, 79T500, 79T497, 8-21-81, ULC Design W415)
Sound Test: OL08-0912, 9-4-08

GA FILE NO. WP 1018 — PROPRIETARY*

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL STUDS

Base layer 5/8" proprietary type X paper faced or glass mat faced gypsum panel product applied parallel to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at floor and ceiling runners and intermediate studs. **Face** layer 5/8" proprietary type X paper faced or glass mat faced gypsum panel product (sound board) applied parallel to ONE SIDE with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 3" mineral fiber insulation, 2.5 pcf, friction fit in stud space. **(NLB)**

PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland	-	5/8" Type X ComfortGuard Sound Deadening Gypsum Board
	-	5/8" Type X



Thickness: 4 7/8"
Approx. Weight: 8 psf
Fire Test: UL R6937; 06NK17962, 2-17-07; 09NK05706, 4-13-09; UL Design U465
Sound Test: OL 11-0607, 6-14-11

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1021 — GENERIC

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 1/2" type X plain or predecorated gypsum wallboard applied parallel to ONE SIDE of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 3/8" adhesive beads at intermediate studs.

OPPOSITE SIDE: **Base** layer 1/2" type X gypsum wallboard applied parallel to studs with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs. **Face** layer 1/2" type X plain or predecorated gypsum wallboard applied parallel to studs with 1 5/8" Type S drywall screws 8" o.c. at vertical joints and 5/8" adhesive beads at intermediate studs.

Joints staggered 24" each layer and side. Sound tested with 3 1/2" glass fiber insulation friction fit in stud space and all layers screw attached without adhesive. **(NLB)**

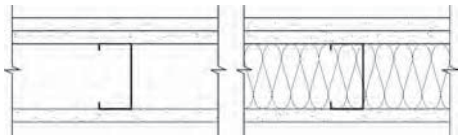

Thickness: 4"
Approx. Weight: 7 psf
Fire Test: FM WP 66, 12-8-66
Sound Test: RAL TL88-55, 2-18-88

GA FILE NO. WP 1022 — PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to ONE SIDE of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs and wall perimeter.

OPPOSITE SIDE: **Base** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to studs with 1" Type S drywall screws 12" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to studs with 1 5/16" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs and wall perimeter.

Joints staggered 24" each layer and side. Sound tested with 3" glass fiber insulation friction fit in stud space. **(NLB)**

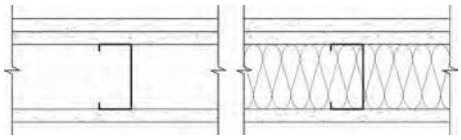

Thickness: 4"
Approx. Weight: 7 psf
Fire Test: FM WP-733, 12-3-84
Sound Test: See WP 1021 (RAL TL88-55, 2-18-88)

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

GA FILE NO. WP 1023 — PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

One layer 1/2" proprietary type X gypsum wallboard applied at right angles to ONE SIDE of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs. Studs attached to floor and ceiling runners with Type S pan head screws. 2 3/4" glass fiber insulation, 0.30 pcf, friction fit in stud space.

OPPOSITE SIDE: **Base** layer 1/2" proprietary type X gypsum wallboard applied at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard applied at right angles to studs with 1 5/8" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs and wall perimeter. **Face** layer may include a 12" wide filler strip at midheight.

Vertical joints staggered 24" each layer and side. Horizontal joints staggered 24" each layer and side, or minimum 12" when filler strip is used. **(NLB)**



Thickness: 5 5/8"
Approx. Weight: 7 psf
Fire Test: WHI-495-0614, 6-20-84; WHI-495-0615, 6-21-84; WHI-495-0620, 7-20-84
Sound Test: See WP 1021 (RAL TL88-54, 2-17-88)

PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC - 1/2" ToughRock® Fireguard C® Gypsum Board

Temple-Inland - 1/2" TG-C

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1041

PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, FIBER-CEMENT BOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard applied parallel or at right angles to each side of 3 5/8" 20 ga steel studs 24" o.c. with 1" Type S-12 drywall screws 24" o.c. **Face** layer 1/4" proprietary fiber-cement board applied parallel or at right angles to studs with 1 5/8" No. 8 ribbed bugle head screws, 0.323" heads, 8" o.c. Joints offset 24" from base layer joints. Face layer joints taped and finished.

Joints staggered 24" on opposite sides. **(NLB)**

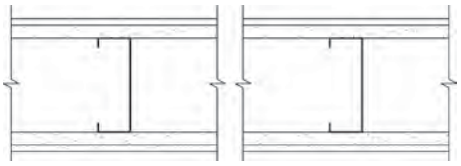

Thickness: 5 1/8"
Approx. Weight: 8 psf
Fire Test: OPL 11710-105199, 8-3-99
Sound Test: ASL AS-TL1510, 8-11-99

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 1/2" CertainTeed® Type C Gypsum Board

GA FILE NO. WP 1047

PROPRIETARY

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, PROPRIETARY STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and intermediate studs and 12" o.c. at top and bottom runner. Glass fiber insulation, 3 1/2" thick, friction fit in stud space

Joints staggered 24" on opposite sides.

Sound tested with horizontal resilient furring channels 24" o.c. on one side. **(NLB)**



Thickness: 4 7/8 " (Fire)
5 3/8 " (Sound)
Approx. Weight: 5 psf
Fire Test: UL R14196, 09CA11604, 2-13-10, UL Design V489, System A
Sound Test: RAL TL11-168, 7-14-11

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type X

GA FILE NO. WP 1048

PROPRIETARY

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, PROPRIETARY STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard applied parallel to each side of 3 5/8" proprietary steel studs 24" o.c. with 1 1/4" Type S drywall screws 8" o.c. at vertical joints and wall perimeter and 12" o.c. at intermediate studs.

Joints staggered 24" on opposite sides.

Sound tested with horizontal resilient furring channels 24" o.c. and 3 5/8" glass fiber insulation friction fit in stud space. **(NLB)**



Thickness: 4 7/8 " (Fire)
5 3/8 " (Sound)
Approx. Weight: 5 psf
Fire Test: UL R14196, 07NK11544, 8-6-07, UL Design V450
Sound Test: RAL TL08-284, 10-7-08

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type X

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1049 — PROPRIETARY

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, PROPRIETARY STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard applied parallel to each side of 3 5/8" proprietary steel studs 24" o.c. with 1 1/4" Type S drywall screws 8" o.c. at vertical joints and wall perimeter and 12" o.c. at intermediate studs.

Joints staggered 24" on opposite sides.

Sound tested with horizontal resilient furring channels 24" o.c. and 3 5/8" glass fiber insulation friction fit in stud space. **(NLB)**

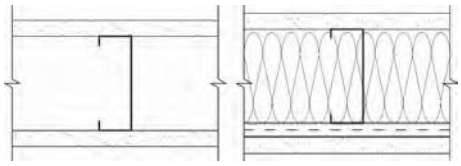

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board

Thickness: 4 7/8 " (Fire)
5 3/8 " (Sound)
Approx. Weight: 6 psf
Fire Test: UL R3501, 06NK12955, 7-18-06, UL Design V450
Sound Test: RAL TL05-080, 4-13-05

GA FILE NO. WP 1050 — PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/4" proprietary gypsum wallboard applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. **Face** layer 1/2" proprietary type X plain or predecorated gypsum wallboard or gypsum veneer base applied parallel to each side with 3/4" beads of laminating compound 12" o.c. to full field of face layer and 1 3/8" Type S drywall screws 8" o.c. at floor and ceiling runners only.

Joints staggered 24" each layer and side. Sound tested with 2" glass fiber insulation friction fit in stud space. **(NLB)**

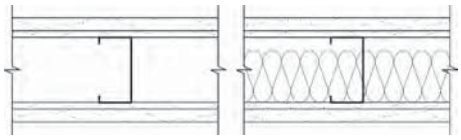

PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC - 1/4" ToughRock® Sound Deadening Gypsum Board
- 1/2" ToughRock® Fireguard C® Gypsum Board

Temple-Inland - 1/4" Temple-4 Sound Deadening Board
- 1/2" TG-C

Thickness: 4"
Approx. Weight: 7 psf
Fire Test: UL R2717-53, 54; 9-4-68, UL Design U410; ULC Design W400
Sound Test: G&H BW-17FT, 8-8-66

GA FILE NO. WP 1051 — GENERIC

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/4" gypsum wallboard applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1/4" beads of laminating compound 2" o.c. to full field of face layer and 1 5/8" Type S drywall screws 8" o.c. at floor and ceiling runners only.

Joints staggered 24" each layer and side. Sound tested with 2" glass fiber insulation friction fit in stud space and face layers screw attached without adhesive. **(NLB)**

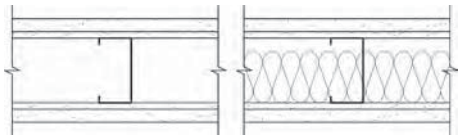

Thickness: 4"
Approx. Weight: 7 psf
Fire Test: FM WP 152-1, 1-22-69
Sound Test: NGC 2318, 8-19-68

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1052 — GENERIC

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at wall perimeter and intermediate studs. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to ONE SIDE with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 3 1/2" glass fiber friction fit in stud space. **(NLB)**

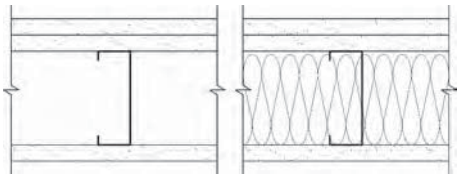

Thickness: 5 1/2"
Approx. Weight: 8 psf
Fire Test: See WP 1350 (FM WP-45, 6-19-68; OSU T-1770, 8-61; ULC 79T484, 79T500, 79T497, 8-21-81, ULC Design W415)
Sound Test: NRCC 817-NV, 2-3-81

GA FILE NO. WP 1053 — GENERIC

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 3/8" square edge regular gypsum wallboard or backing board applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. **Face** layer 1/2" type X plain or predecorated gypsum wallboard or gypsum veneer base applied parallel to each side with 3/4" wide beads of laminating compound 12" o.c. to full field of face layer and 1 3/8" Type S drywall screws 8" o.c. at floor and ceiling runners only.

Joints staggered 24" each layer and side. Sound tested with 3 1/2" glass fiber insulation friction fit in stud space. **(NLB)**

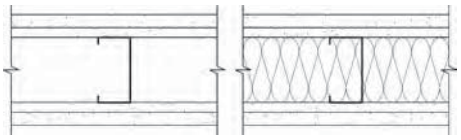

Thickness: 4 1/4"
Approx. Weight: 7 psf
Fire Test: ULC 74T184, 4-10-75, ULC Design W402
Sound Test: CK 8104.02, 2-3-81

GA FILE NO. WP 1055 — PROPRIETARY

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 3/8" square edge regular gypsum wallboard or backing board applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. **Face** layer 5/8" proprietary type X plain or predecorated gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with laminating compound and 1 1/4" Type S drywall screws 8" o.c. at floor and ceiling runners only.

Horizontal joints on opposite sides need not be staggered or backed. Sound tested with 3 1/2" glass fiber insulation friction fit in stud space. **(NLB)**

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Canada Inc. - 5/8" CertainTeed® Type X Gypsum Board

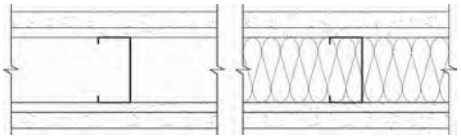

Thickness: 4 1/2"
Approx. Weight: 7 psf
Fire Test: UL R3660, 07NK21428, 2-14-08, ULC Design W402
Sound Test: CK 8104.02, 2-3-81

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1056

PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 1 5/8" Type S drywall screws 16" o.c. Face layer horizontal joints need not be staggered or backed, or offset from base layer joints. Horizontal joints on opposite sides need not be staggered or backed. **(NLB)**

Sound tested with 3 1/2" glass fiber insulation in stud cavity and screws space 24" o.c. in the base layer and 12" o.c. in the face layer.

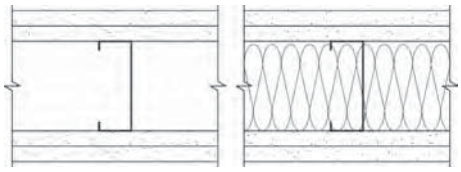

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® 30

Thickness: 6 1/8"
Approx. Weight: 7 psf
Fire Test: UL R1319, 11NK13873, 4-15-11, UL Design U407
Sound Test: RAL TL11-080, 5-23-11

GA FILE NO. WP 1057

PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side of 3 1/2" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at the edges and 12" o.c. at intermediate studs when applied parallel to framing or 8" o.c. at the ends and intermediate studs when applied at right angles to framing.

Vertical joints centered over studs and staggered one stud cavity on opposite sides. Horizontal joints on opposite sides need not be staggered or backed. **(NLB)**

Sound tested with 3 5/8" studs, 3 1/2" glass fiber insulation in stud cavity, and an second layer of 5/8" proprietary type X gypsum wallboard applied to ONE SIDE with screws 12" o.c.

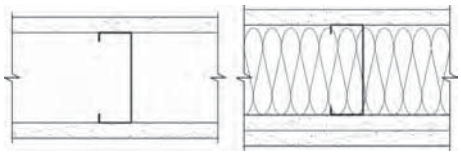

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® X

Thickness: 6 1/8"
Approx. Weight: 7 psf
Fire Test: UL R1319, 11NK08543, 6-17-11, UL Design U419
Sound Test: RAL TL11-069, 5-23-11

GA FILE NO. WP 1058

PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 3 5/8" proprietary steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at the edges and 12" o.c. at intermediate studs when applied parallel to framing or 8" o.c. at the ends and intermediate studs when applied at right angles to framing.

Vertical joints centered over studs and staggered one stud cavity on opposite sides. Horizontal joints need not be staggered or backed. **(NLB)**

Sound tested with 3 5/8" studs, 3 1/2" glass fiber insulation in stud cavity, resilient channels 24" o.c. on ONE SIDE, and gypsum board applied to channels with screws 12" o.c.

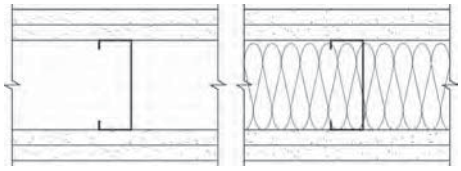

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® X

Thickness: 4 7/8" (Fire)
5 3/8" (Sound
Approx. Weight: 7 psf
Fire Test: UL R1319, 10CA37600, 12-3-10, UL Design U419
Sound Test: RAL TL11-072, 5-23-11

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1070 — GENERIC

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs. 2" mineral fiber insulation, 2.5 pcf, friction fit in stud space. Also fire tested with 1 1/2" mineral fiber insulation, 3.0 pcf, stapled to board in stud space.

Joints staggered 24" on opposite sides. **(NLB)**

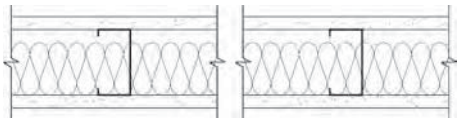

Thickness:	3 1/2"
Approx. Weight:	5 psf
Fire Test:	FM WP 51-1, 9-22-66; OSU T-3362, 11-23-65
Sound Test:	RAL TL69-42, 10-17-68

GA FILE NO. WP 1071 — PROPRIETARY*

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION

One layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs and wall perimeter. 2" mineral fiber insulation, 3.0 pcf, friction fit in stud space.

Vertical joints staggered 24" on each side and on opposite sides. Horizontal joints need not be staggered. **(NLB)**

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

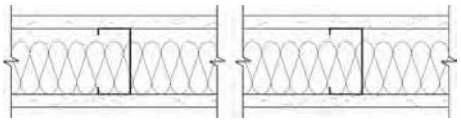

Thickness:	3 1/2"
Approx. Weight:	5 psf
Fire Test:	UL R3501, 93NK22748, 9-15-93, UL Design V401; FM WP-731, 9-12-84
Sound Test:	See WP 1070 (RAL TL69-42, 10-17-68)

GA FILE NO. WP 1072 — GENERIC

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at floor and ceiling runners and intermediate studs.

Joints staggered 24" on each side and on opposite sides. Sound tested with 3 1/2" glass fiber friction fit in stud space. **(NLB)**



Thickness:	4 7/8 "
Approx. Weight:	6 psf
Fire Test:	See WP 1350 (FM WP-45, 6-19-68; OSU T-1770, 8-61; ULC 79T484, 79T500,79T497, 8-12-81, ULC Design W415)
Sound Test:	NRCC 816-NV, 2-3-81

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1073 | **PROPRIETARY*** | **1 HOUR FIRE** | **45 to 49 STC SOUND**

GLASS MAT GYPSUM SUBSTRATE, STEEL STUDS, GLASS FIBER INSULATION

One layer 1/2" proprietary glass mat water-resistant gypsum backing board applied parallel to each side of 2 1/2" steel studs 16" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs and wall perimeter. 3 1/2" glass fiber insulation, 0.526 pcf, friction fit in stud space.

Joints staggered 16" on opposite sides and covered with 10 x 10 mesh glass tape and tile adhesive. **(NLB)**

PROPRIETARY GYPSUM PANEL PRODUCT

Georgia Pacific Gypsum LLC - 1/2" DensShield® Tile Backer

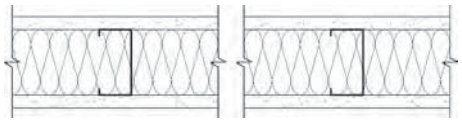

Thickness: 3 1/2"
Approx. Weight: 5 psf
Fire Test: CTC 1897-1655, 1-11-88
Sound Test: See WP 1070 (RAL TL69-42, 10-17-68)

GA FILE NO. WP 1074 | **PROPRIETARY*** | **1 HOUR FIRE** | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum board applied parallel or at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c.

Horizontal joints on opposite sides need not be staggered or backed. Sound tested with 3 1/2" glass fiber insulation in stud space. **(NLB)**

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" AirRenew® Gypsum Board

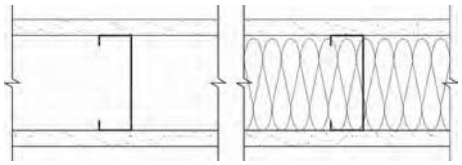

Thickness: 4 7/8"
Approx. Weight: 5 psf
Fire Test: UL R3660, 07NK21428, 2-14-08, UL Design U465
Sound Test: NGC 2006048, 1-31-07

GA FILE NO. WP 1076 | **PROPRIETARY*** | **1 HOUR FIRE** | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1 1/4" Type S drywall screws 8" o.c. at wall perimeter and 12" o.c. at vertical joints and with 1 1/4" Type S drywall screws 12" o.c. or continuous 1/4" beads of adhesive at intermediate studs. 2 3/4" glass fiber insulation, 0.65 pcf, friction fit in stud space.

Joints staggered 24" on opposite sides. **(NLB)**

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Canada Inc. - 5/8" CertainTeed® Type X Gypsum Board
Georgia Pacific Gypsum LLC - 5/8" ToughRock® Fireguard® Gypsum Board

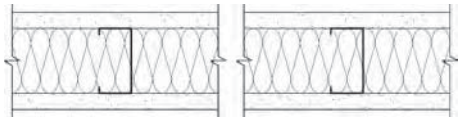

Thickness: 3 3/4"
Approx. Weight: 6 psf
Fire Test: ULC 78T55, 1-9-79, ULC Design W409
Sound Test: DRC 70-2-2, 1-6-70

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1077

PROPRIETARY*

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1 1/4" Type S drywall screws 8" o.c. Glass fiber insulation, 2 3/4", 0.65 pcf, friction fit in stud space.

Horizontal joints on opposite sides need not be staggered or backed. **(NLB)**

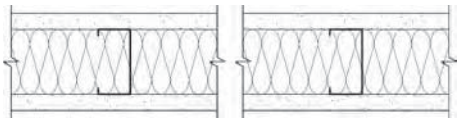

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Canada Inc. - 5/8" CertainTeed® Type X Gypsum Board

Thickness: 3 3/4"
Approx. Weight: 6 psf
Fire Test: UL R15187, 07NK21428 2-14-08, ULC Design W409
Sound Test: DRC 70-2-2, 1-6-70

GA FILE NO. WP 1078

PROPRIETARY*

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard applied parallel to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at studs and 12" o.c. at floor runners.

Horizontal edge and butt joints on opposite sides of studs need not be staggered. Sound tested with 3" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board

Thickness: 4 7/8"
Approx. Weight: 6 psf
Fire Test: UL R3501, 08NK09662 6-19-08, UL Design V438
Sound Test: NGC 2386, 8-4-70

GA FILE NO. WP 1079

PROPRIETARY*

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. Mineral fiber insulation partially or completely filling stud space.

Horizontal joints on opposite sides need not be staggered or backed. **(NLB)**

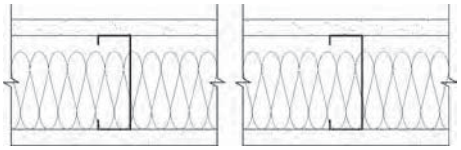

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type X Gypsum Board

Thickness: 4 7/8"
Approx. Weight: 5 psf
Fire Test: UL R15187, 07NK21428 2-14-08, UL Design V417
Sound Test: NGC 2006048, 1-31-07

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1081

PROPRIETARY*

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard or glass mat gypsum substrate applied parallel to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at floor and ceiling runners and intermediate studs. Optional horizontal resilient channel 24" o.c applied to studs with one 1/2" Type S-12 pan head screw at each stud intersection.

Stagger joints 24" on opposite sides. Sound tested with 3" mineral fiber, 2.5 pcf, in stud space. **(NLB)**

PROPRIETARY GYPSUM PANEL PRODUCTS

American Gypsum Company LLC	-	5/8" FireBloc® Type X
CertainTeed Gypsum Canada Inc.	-	5/8" CertainTeed® Type X Gypsum Board
CertainTeed Gypsum Inc.	-	5/8" GlasRoc® Diamondback™ Tilebacker Type X Gypsum Panels
Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard® Gypsum Board
Lafarge North America Inc.	-	5/8" Firecheck® Type X
National Gypsum Company	-	5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board
PABCO Gypsum	-	5/8" FLAME CURB® Type X
Temple-Inland	-	5/8" Type X
United States Gypsum Company	-	5/8" SHEETROCK® Brand Abuse-Resistant FIRECODE® Core Gypsum Panels

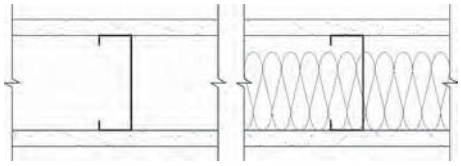

Thickness: 4 7/8"
Approx. Weight: 5 psf
Fire Test: UL R1319, 94NK40598, 11-30-94; UL R3660, 07NK18571, 11-2-07; UL R15187, 02NK31412, 7-17-02; UL Design U465
Sound Test: USG-960709, 7-18-96; RAL-TL99-103, 6-28-99; RAL-TL99-160, 9-3-99; NGC 2006048, 1-31-07

GA FILE NO. WP 1082

PROPRIETARY*

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION, CEMENTITIOUS BACKER UNIT

One layer 5/8" proprietary type X gypsum wallboard or veneer base applied parallel to ONE SIDE of 3 5/8" 25 ga steel studs 16" o.c. with 1 1/4" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. to intermediate studs. 3" mineral fiber insulation batts, 2.5 pcf, in stud space.

OPPOSITE SIDE: One layer 1/2" proprietary cementitious backer units applied parallel or at right angles to studs with 1 1/4" Type S wafer head screws 8" o.c.

Vertical joints staggered 16" on opposite sides. **(NLB)**

PROPRIETARY GYPSUM BOARD

National Gypsum Company	-	5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board

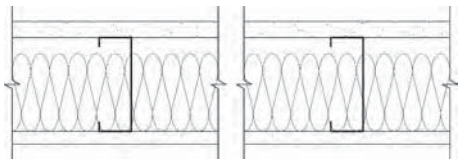

Thickness: 4 3/4"
Approx. Weight: 6 psf
Fire Test: ITS J99-04001, 11-16-98 & 2-5-99, ITS Design NGC/WA 60-01; UL R22158, 05CA15728, 5-23-05, UL Design V452
Sound Test: NGC 2099015, 8-19-99

GA FILE NO. WP 1083

PROPRIETARY*

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard, gypsum veneer base, or glass mat gypsum substrate applied at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c.

Horizontal joints on opposite sides need not be staggered or backed. Sound tested with 3 1/2" glass fiber insulation in stud space. **(NLB)**

PROPRIETARY GYPSUM PANEL PRODUCTS

CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type X Gypsum Board
Georgia Pacific Gypsum LLC	-	5/8" DensArmor Plus® Fireguard® Interior Panel
National Gypsum Company	-	5/8" Gold Bond® Brand e²XP® Interior Extreme® Gypsum Panels



Thickness: 4 7/8"
Approx. Weight: 5 psf
Fire Test: UL R3660, 07NK21428, 2-14-08; UL R3501, 07NK17992, 12-12-07; UL Design U465
Sound Test: NGC 2006048, 1-31-07; NGC 2386, 8-4-70; RAL TL99-103, 6-28-99

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1084 — PROPRIETARY*

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side of 3 5/8" proprietary steel studs 24" o.c. with 1" Type S drywall screws 8" o.c.

Horizontal joints on opposite sides need not be staggered or backed. Sound tested with 3 1/2" glass fiber insulation in stud space. **(NLB)**

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type X Gypsum Board

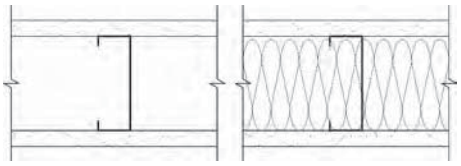

Thickness: 4 7/8"
Approx. Weight: 5 psf
Fire Test: UL R3660, 07NK08880, 7-27-07; UL R3660, 10NK14500,10-29-10; UL Designs V450 & V486
Sound Test: RAL-TL07-357, 11-7-07

GA FILE NO. WP 1085 — PROPRIETARY*

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM PLASTER, GYPSUM LATH, STEEL STUDS

7/16" proprietary 1:2 gypsum-sand basecoat plaster and 1/16" lime gauging plaster finish applied over one layer 3/8" proprietary type X gypsum lath applied perpendicular to each side of 2 1/2" steel studs 16" o.c. with 1" Type S drywall screws 8" o.c.

Sound tested with 1" mineral fiber insulation stapled to one side in stud space. **(NLB)**

PROPRIETARY GYPSUM LATH

United States Gypsum Company - 3/8" ROCKLATH® Plaster Base FIRECODE® Core

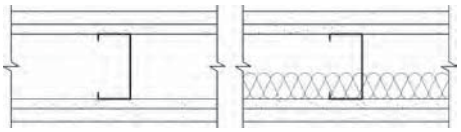

Thickness: 4 1/4"
Approx. Weight: 15 psf
Fire Test: UL R1319, 12-12-90, UL Design U488
Sound Test: CK 664-18, 4-6-66

GA FILE NO. WP 1090 — GENERIC

1 HOUR FIRE | **45 to 49 FSTC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/4" gypsum wallboard applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. at vertical joints and 36" o.c. at intermediate studs. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. **(NLB)**



Thickness: 3 1/8"
Approx. Weight: 7 psf
Fire Test: UC, 12-28-65
Field Sound Test: ACI 7-1152019c, 12-29-65

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1204 | GENERIC | 1 HOUR FIRE | 40 to 44 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 3 1/2" 20 ga steel studs 24" o.c. with 1 5/8" Type S-12 drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S-12 drywall screws 12" o.c. Studs attached to each side of floor and ceiling runners by welding or with 1/2" Type S-12 pan head screws.

Joints staggered 24" each layer and side.

Bracing: Lateral bracing spaced not over 40" o.c. shall be 1" by 18 ga steel straps attached to each side or channel bracing attached to each stud with a clip angle. For studs with holes or punch-outs in the web the "Q" factor shall be determined by means of stub column tests. Tested at 100 percent of design load. (Passed 90 minute fire test.) **(LOAD-BEARING)**

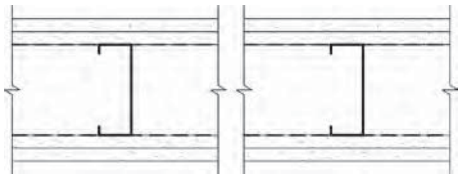

Thickness: 5 1/2"
Approx. Weight: 9 psf
Fire Test: UL NC 505-1, 7-29-82, UL Design U425
Sound Test: See WP 1615 (NGC 2250, 1-3-68)

GA FILE NO. WP 1206 | GENERIC | 1 HOUR FIRE | 40 to 44 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 3 1/2" 20 ga steel studs 24" o.c. with 1" Type S-12 drywall screws 12" o.c. Studs attached to each side of floor and ceiling runners by welding or with 1/2" Type S-12 pan head screws.

Joints staggered 24" on opposite sides.

Bracing: Lateral bracing spaced not over 40" o.c. shall be 1" by 18 ga steel straps attached to each side or channel bracing attached to each stud with a clip angle. For studs with holes or punch-outs in the web the "Q" factor shall be determined by means of stub column tests. Tested at 100 percent of design load. **(LOAD-BEARING)**



Thickness: 4 3/4"
Approx. Weight: 6 psf
Fire Test: UL NC 505-2, 7-29-82, UL Design U425
Sound Test: See WP 1350 (NGC 2385, 7-28-70)

GA FILE NO. WP 1240 | GENERIC | 1 HOUR FIRE | 40 to 44 STC SOUND

GYPSUM VENEER PLASTER, GYPSUM VENEER BASE, STEEL STUDS

One layer 1/2" type X gypsum veneer base applied parallel or at right angles to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs. 1/16" gypsum veneer plaster applied over each side.

Joints staggered 24" on each side and on opposite sides. Sound tested with 3" glass fiber insulation in stud space and with studs 16" o.c. **(NLB)**



Thickness: 3 5/8"
Approx. Weight: 5 psf
Fire Test: UC, 8-5-63; UC, 11-1-63; UC, 5-31-66
Sound Test: G&H NG-269FT, 12-20-65

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1290 — GENERIC

1 HOUR FIRE | **40 to 44 STC SOUND**

GYPSUM PLASTER, GYPSUM LATH, STEEL STUDS

1/2" 1:2 gypsum-sand plaster applied over 1/2" plain gypsum lath applied at right angles to each side of 2 1/2" steel studs 24" o.c. with 1" Type S screws, 3 per stud per lath width, or 12 ga wire clips. End joint clips at lath corners. **(NLB)**

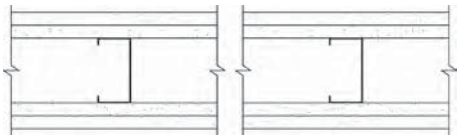

Thickness: 4 1/2"
Approx. Weight: 15 psf
Fire Test: FM WP-53, 11-29-66
Sound Test: NGC 2061, 10-24-66

GA FILE NO. WP 1296 — PROPRIETARY*

1 HOUR FIRE | **40 to 44 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION, FIBER-CEMENT BOARD

One layer 5/8" proprietary type X gypsum wallboard applied parallel to ONE SIDE of 3 5/8" steel studs 16" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs. 3 1/2" mineral fiber insulation, 3.0 pcf, friction fit in stud space.

OPPOSITE SIDE: One layer 7/16" proprietary fiber-cement board applied parallel to studs with 1" No. 8-18 x 0.323" head diameter ribbed bugle head screws 6" o.c. **(NLB)**

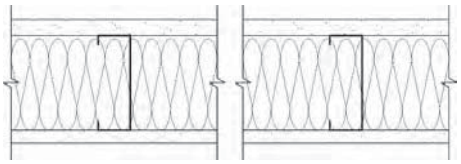

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type X Gypsum Board

Thickness: 4 3/4"
Approx. Weight: 7.5 psf
Fire Test: OPL 11710-92783, 2-13-92
Sound Test: See WP 1350 (NGC 2385, 7-28-70)

GA FILE NO. WP 1311 — PROPRIETARY*

1 HOUR FIRE | **35 to 39 STC SOUND**

SOLID GYPSUM WALLBOARD

One layer 1/2" regular gypsum wallboard or gypsum veneer base applied parallel to each side of 1" x 24" proprietary type X gypsum panels with laminating compound combed over the entire contact surface and 1 5/16" Type S screws 24" o.c. horizontally and vertically. 1" gypsum coreboard panels attached to 25 ga 1" x 2 1/4" high "L" runners along floor and ceiling lines with two 1 5/16" Type S screws at top and bottom. Wallboard layers attached to "L" runners with 1 7/8" Type S screws 12" o.c.

Joints staggered 12" each layer and side. **(NLB)**



PROPRIETARY GYPSUM BOARD

National Gypsum Company - 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

Thickness: 2"
Limiting Height: 11'0"
Approx. Weight: 8 psf
Fire Test: FM WP-671, 6-28-82
Sound Test: Based on NGC 2359, 11-18-69

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1330

GENERIC

1 HOUR FIRE | **35 to 39 STC SOUND**

SEMI-SOLID GYPSUM WALLBOARD, GYPSUM STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 6" wide gypsum studs 24" o.c. with 1" Type G drywall screws 20" o.c. and with laminating compound. Gypsum studs fabricated from 2 or 3 layers of 1/2" or 5/8" laminated gypsum panels. Fire tested with 1" thick gypsum studs.

Sound tested with 5/8" thick gypsum studs. **(NLB)**



Thickness:	Varies
Limiting Height:	12'0"
Approx. Weight:	8 psf
Fire Test:	UL R2717-19, -21, 6-3-57, UL Design U510; ULC Design W502
Sound Test:	Based on G&H BW-8FT, 8-1-62

GA FILE NO. WP 1340

GENERIC

1 HOUR FIRE | **35 to 39 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at edges and 12" o.c. at intermediate studs.

Joints staggered 24" on opposite sides. **(NLB)**



Thickness:	2 7/8"
Approx. Weight:	6 psf
Fire Test:	OSU T-3296, 10-1-65
Sound Test:	RAL TL64-244, 5-8-64

GA FILE NO. WP 1350

GENERIC

1 HOUR FIRE | **35 to 39 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at floor and ceiling runners and intermediate studs.

Joints staggered 24" on opposite sides. **(NLB)**



Thickness:	4 7/8"
Approx. Weight:	6 psf
Fire Test:	FM WP-45, 6-19-68; OSU T-1770, 8-61; ULC 79T484, 79T500, 79T497, 8-12-81, ULC Design W415
Sound Test:	NGC 2005004, 6-15-05 RAL TL06-114, 4-11-06

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1370

GENERIC

1 HOUR FIRE | **35 to 39 STC SOUND**

GYPSUM PLASTER, GYPSUM LATH, STEEL STUDS

1/2" 1:2 gypsum-sand plaster applied over 3/8" type X gypsum lath applied at right angles to each side of 2 1/2" steel studs 24" o.c. with two 1" Type S drywall screws at each stud and two butt joint clips per lath at lath ends. **(NLB)**

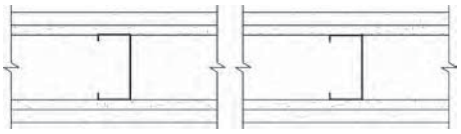

Thickness: 4 1/4"
Approx. Weight: 14 psf
Fire Test: UC, 12-21-65
Sound Test: RAL TL63-268, 6-4-63

GA FILE NO. WP 1380

GENERIC

1 HOUR FIRE | **35 to 39 STC SOUND**

SOLID GYPSUM PLASTER, METAL LATH, METAL CHANNEL

2" solid 1:1 1/2 gypsum-sand plaster applied over 2.5 lb. metal lath wire tied 6" o.c. to one side of 3/4" cold rolled channel studs 16" o.c. embedded in the plaster. **(NLB)**



Thickness: 2"
Limiting Height: 12'6"
Approx. Weight: 18 psf
Fire Test: OSU T-129, 3-16-48
Sound Test: BMS 144/523, 2-25-55;
NBS Monograph 77, 11-30-64

GA FILE NO. WP 1390

GENERIC

1 HOUR FIRE | **35 to 39 STC SOUND**

SOLID GYPSUM PLASTER, METAL LATH

1" 1:2 gypsum-sand plaster applied over each side of 3/8" rib metal lath to form 2" solid studless wall. **(NLB)**



Thickness: 2"
Limiting Height: 10'0"
Approx. Weight: 18 psf
Fire Test: OSU T-162, 4-26-51
Sound Test: BMS 144/527, 2-25-55;
NBS Monograph 77, 11-30-64

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1400

GENERIC

1 HOUR FIRE

35 to 39 STC SOUND

GYPSUM PLASTER, METAL LATH, STEEL STUDS

5/8" 1:2-1:3 gypsum-sand plaster applied over 3.4 lb. metal lath wire tied 6" o.c. to each side of 1 5/8" open or punched web steel studs 16" o.c. **(NLB)**



Thickness: 3 1/8 "
Approx. Weight: 18 psf
Fire Test: OSU T-1511, 9-23-60
Sound Test: RAL TL61-2, 9-8-60

GA FILE NO. WP 1411

PROPRIETARY*

1 HOUR FIRE

GYPSUM PANEL PRODUCTS, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard or gypsum panels applied parallel to each side of 3 5/8" proprietary steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and at wall perimeter and 12" o.c. at intermediate studs.

Joints staggered 24" on opposite sides. **(NLB)**

PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC - 5/8" DensArmor Plus® Fireguard® Interior Panel
Lafarge North America Inc. - 5/8" Firecheck® Type X



Thickness: 4 7/8"
Approx. Weight: 5 psf
Fire Test: UL R18482, 06NK25122, 1-23-07, UL Designs V450 & V486

GA FILE NO. WP 1412

PROPRIETARY*

1 HOUR FIRE

GYPSUM PANEL PRODUCTS, RESILIENT CHANNELS, STEEL STUDS

Resilient channels 16" o.c. attached at right angles to ONE SIDE of 3 5/8" proprietary steel studs 24" o.c. with 1/2" Type S-12 drywall screws. One layer 5/8" proprietary type X gypsum wallboard or gypsum panels applied at right angles to channels with 1" Type S drywall screws 8" o.c. at horizontal joints and at wall perimeter and 12" o.c. at intermediate channels.

OPPOSITE SIDE: One layer 5/8" proprietary type X gypsum wallboard or gypsum panels applied at right angles to studs with 1" Type S drywall screws 8" o.c. at vertical joints and at wall perimeter and 12" o.c. at intermediate studs.

Vertical joints staggered 24" on opposite sides. **(NLB)**

PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC - 5/8" DensArmor Plus® Fireguard® Interior Panel



Thickness: 4 7/8"
Approx. Weight: 5 psf
Fire Test: UL R14196, 07NK11544, 8-6-07, UL Design V450

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1413

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 3 1/2", 25 ga steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at edges and 12" o.c. at intermediate studs when applied parallel to framing or 8" o.c. at ends and at intermediate studs when applied at right angles to framing.

Vertical joints centered over studs and staggered one stud cavity on opposite sides. Horizontal joints on opposite sides need not be staggered or backed. **(NLB)**



Thickness: 4 3/4"
Approx. Weight: 7 psf
Fire Test: UL R1319, 05NK17682, 8-22-05, UL Design U419

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels

GA FILE NO. WP 1414

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 3 5/8" proprietary steel studs 24" o.c. with 1" Type S drywall screws 8" o.c.

Horizontal joints on opposite sides need not be staggered or backed. **(NLB)**



Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: UL R1319, 05NK17682, 8-22-05, UL Design U419

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels

GA FILE NO. WP 1415

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, GLASS MAT GYPSUM SUBSTRATE, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard applied parallel to ONE SIDE of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at floor and ceiling runners and intermediate studs. Optional resilient channel (not shown) 24" o.c. applied to studs with one 1/2" Type S-12 pan head screw at each stud.

OPPOSITE SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate applied parallel to studs with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at floor and ceiling runners and intermediate studs.

Joints staggered 24" on opposite sides. **(NLB)**



Thickness: 4 7/8"
Approx. Weight: 6 psf
Fire Test: UL R6937, 06NK17962, 2-19-08; UL R3501, 07NK17992, 12-12-07; UL Design U465

PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC
- 5/8" DensArmor Plus® Fireguard® Interior Panel
- 5/8" ToughRock® Fireguard® Gypsum Board

National Gypsum Company
- 5/8" Gold Bond® Brand e²XP® Interior Extreme® Gypsum Panels
- 5/8" Gold Bond® Brand e²XP® Tile Backer FIRE-SHIELD® Gypsum Panels

Temple-Inland
- 5/8" GreenGlass Type X
- 5/8" Type X

Contact the manufacturer for more detailed information on proprietary products.

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1416

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 3 5/8" proprietary steel studs 24" o.c. with 1 1/4" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at floor and ceiling runners and intermediate studs.

Joints staggered on opposite sides. **(NLB)**

PROPRIETARY GYPSUM BOARD

Temple-Inland - 5/8" Type X



Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: WFCi 07024, 6-5-07; WFCi 08067, 9-12-08

GA FILE NO. WP 1417

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION, CEMENTITIOUS BACKER UNIT

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to ONE SIDE of 3 1/2" 20 ga steel studs 16" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs. 3" mineral fiber insulation batts, 2 pcf, in stud space. For load-bearing, studs attached to each side of floor and ceiling runners by welding or with 1/2" Type S-12 pan head screws.

OPPOSITE SIDE: One layer 1/2" proprietary cementitious backer units applied parallel or at right angles to studs with 1 1/4" Type S-12 wafer head screws 8" o.c. Joints staggered and covered with glass fiber mesh tape. **(NLB)**

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels



Thickness: 4 5/8"
Approx. Weight: 7 psf
Fire Test: UL R12262, 96NK4276, 5-1-96, UL Design U404

GA FILE NO. WP 1418

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

One layer 1/2" proprietary type X gypsum wallboard applied parallel or at right angles to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at wall perimeter and intermediate studs. Mineral fiber insulation, 1 1/2" thick, 2.5 pcf, friction fit in stud space.

Vertical joints staggered 24" on opposite sides. Horizontal joints on opposite sides need not be staggered. **(NLB)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 1/2" FireBloc® Type C
Temple-Inland - 1/2" TG-C



Thickness: 3 1/2"
Approx. Weight: 5 psf
Fire Test: UL R14196, 09CA11604, 2-13-10, UL Design V489, System B

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1419 — PROPRIETARY* — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard applied parallel to ONE SIDE of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. Laminating compound applied to surface of base layer with a 1/4" x 1/4" notched trowel. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel to studs with 1 5/8" Type S drywall screws 12" o.c., starting with a 6" offset from the bottom of the gypsum board.

As an alternate to laminating compound, a third (middle) layer of 5/8" proprietary type X gypsum wallboard applied parallel to studs with 1 5/8" Type S drywall screws 24" o.c. and face layer applied as described above with 2 1/4" Type S screws.

Vertical joints staggered 24" between layers. **(NLB)**

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board



Thickness: 5 to 5 1/2"
Approx. Weight: 5 to 7 psf
Fire Test: UL R3501, 09NK18004, 4-20-10, UL Design V497

GA FILE NO. WP 1420 — PROPRIETARY* — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 3 1/2", 20 ga steel studs 24" o.c. with 1" Type S-12 drywall screws 12" o.c. when applied parallel to framing or 8" o.c. when applied at right angles to framing.

Vertical joints centered over studs and staggered one stud cavity on opposite sides. Horizontal joints on opposite sides need not be staggered or backed. **(LOAD-BEARING)**

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® X



Thickness: 4 3/4"
Approx. Weight: 7 psf
Fire Test: UL R1319, 10CA37600, 12-3-10, UL Design U423

GA FILE NO. WP 1450 — PROPRIETARY* — 2 HOUR FIRE — 60 to 64 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side of 1 5/8" proprietary steel studs 24" o.c. with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to studs with 1 5/8" Type S drywall screws 16" o.c. Face layer horizontal joints offset not less than 12" from base layer horizontal joints.

Horizontal joints on opposite sides need not be staggered or backed. **(NLB)**

Sound tested with 3 5/8" proprietary steel studs, resilient channels, and 3 1/2" glass fiber insulation in stud cavity.

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type X Gypsum Board

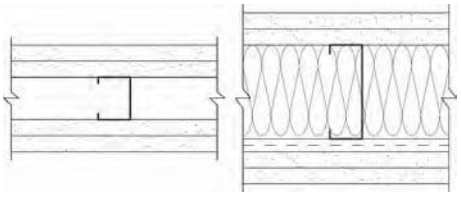

Thickness: 4 1/8" (Fire)
6 5/8" (Sound)
Approx. Weight: 12 psf
Fire Test: UL R3660, 07NK08880, 7-27-07; UL R3660, 10NK14500,10-29-10; UL Designs V450 & V486
Sound Test: RAL TL07-359, 11-8-07

Contact the manufacturer for more detailed information on proprietary products.

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1451

PROPRIETARY*

2 HOUR FIRE | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side of 2 1/2" proprietary steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Face** layer 5/8" type X gypsum wallboard applied parallel or at right angles to each side with 1 5/8" Type S drywall screws 16" o.c. Face layer horizontal joints offset 12" from base layer horizontal joints. When face layer is applied at right angles to framing locate first screw 1 1/4" from board edge and locate second screw 2" from board edge.

Sound tested with horizontal resilient furring channels 24" o.c. and glass fiber insulation in stud cavity. **(NLB)**

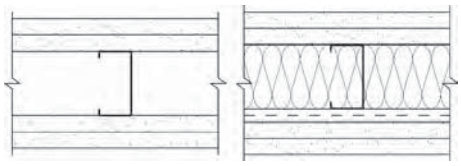

Thickness: 5" (Fire)
5 1/2" (Sound)
Approx. Weight: 9 psf
Fire Test: UL R3501, 07NK12306, 8-24-07, UL Design V450
Sound Test: RAL TL05-081, 4-14-05

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board

GA FILE NO. WP 1452

PROPRIETARY

2 HOUR FIRE | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, PROPRIETARY STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to 2 1/2" steel studs 24" o.c. channels with 1" Type S drywall screws 12" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" between layers. Horizontal joints need not be staggered on opposite sides.

Sound tested with resilient channels 24" o.c. on ONE SIDE and 3 1/2" glass fiber insulation friction fit in stud space. **(NLB)**



Thickness: 5" (fire)
5 1/2" (sound)
Approx. Weight: 10.5 psf
Fire Test: UL R14196, 09CA11604, 2-13-10, UL Design V489, System D
Sound Test: RAL TL10-356, 10-28-10

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type X

GA FILE NO. WP 1453

PROPRIETARY

2 HOUR FIRE | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, PROPRIETARY STEEL STUDS

Proprietary resilient sound isolation clip and 7/8" hat channel 24" o.c. attached at right angles to ONE SIDE of 3 5/8" 20 ga steel studs 24" o.c. with #8 wafer head screws. **Base** layer 5/8" proprietary type X gypsum wallboard applied parallel to channels with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel to channels with 1 5/8" Type S drywall screws 16" o.c. Joints offset 12" between layers. Glass fiber insulation, 3 1/2" thick, friction fit in stud space

OPPOSITE SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard applied parallel to studs with 1" Type S-12 drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel to studs with 1 5/8" Type S-12 drywall screws 16" o.c. Joints offset 12" between layers.

Sound tested with 6 1/4" thick glass fiber insulation compressed and friction fit in stud space. **(NLB)**

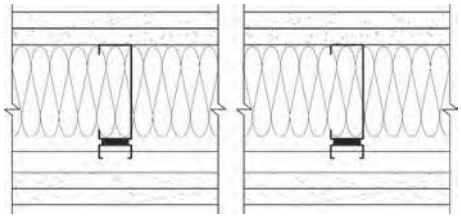

Thickness: 7"
Approx. Weight: 10.5 psf
Fire Test: UL R14196, 09CA11604, 2-13-10, UL Design V489, System D
Sound Test: RAL TL05-011a, 1-18-05

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type C

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1454

PROPRIETARY*

2 HOUR FIRE | **60 to 64 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL STUDS

Base layer 5/8" proprietary type X paper faced or glass mat faced gypsum panel product applied parallel or at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Face** layer 5/8" proprietary type X paper faced or glass mat faced gypsum panel product applied parallel to ONE SIDE with 1 5/8" Type S drywall screws 12" o.c.

OPPOSITE SIDE: **Face** layer 5/8" proprietary type X paper faced or glass mat faced gypsum panel product (sound board) applied parallel to studs with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 3 1/2" glass fiber insulation in stud cavity. **(NLB)**

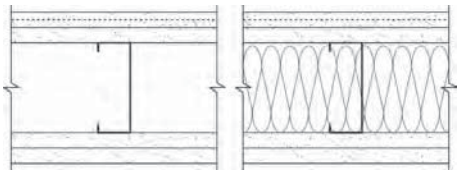

Thickness: 6 1/8"
Approx. Weight: 12 psf
Fire Test: See WP 1548 (WHI-495-0236, 1-30-80)
Sound Test: OL 08-0913, 9-4-08

PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland	-	5/8" Type X
	-	5/8" Type X ComfortGuard Sound Deadening Gypsum Board

GA FILE NO. WP 1470

PROPRIETARY*

2 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, STEEL STUDS, MINERAL FIBER INSULATION

Resilient channels 24" o.c. attached at right angles to ONE SIDE of 3 1/2" 20 ga steel studs 24" o.c. with one 1/2" Type S-12 drywall screw at each stud. **Base** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. 3" mineral fiber insulation, 2 pcf, friction fit in stud space.

OPPOSITE SIDE: **Base** layer 1/2" proprietary type X gypsum wallboard applied parallel with 1" Type S-12 drywall screws 24" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1 5/8" Type S-12 drywall screws 12" o.c.

Joints staggered 24" each layer and side. **(NLB)**

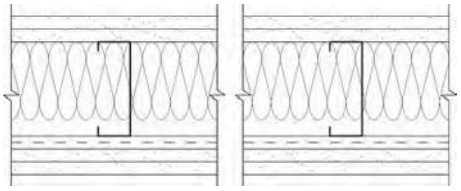

Thickness: 6"
Approx. Weight: 12 psf
Fire Test: UL R1319-141 through 145, 2-11-87, UL Design U454
Sound Test: RAL TL83-214, 9-1-83

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	-	1/2" CertainTeed® Type C Gypsum Board
CertainTeed Gypsum Canada Inc.	-	1/2" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	1/2" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	1/2" Firecheck® Type C
National Gypsum Company	-	1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
Temple-Inland	-	1/2" TG-C
United States Gypsum Company	-	1/2" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

GA FILE NO. WP 1502

PROPRIETARY*

2 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard base applied parallel or at right angles to each side with 1 5/8" Type S drywall screws 12" o.c. Face layer vertical joints offset not less than 12" from base layer horizontal joints.

Horizontal joints on opposite sides need not be staggered or backed. Sound tested with 3 1/2" glass fiber insulation in stud cavity. **(NLB)**

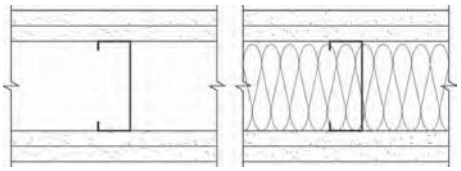

Thickness: 6 1/8"
Approx. Weight: 10 psf
Fire Test: UL R14196, 09CA11604, 2-13-10, UL Design V489, System D
Sound Test: RAL TL08-286, 10-9-08

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® Type X

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1503

PROPRIETARY | **2 HOUR FIRE** | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Resilient channels 16" o.c. attached at right angles to ONE SIDE of 2½" proprietary steel studs 24" o.c. with ½" Type S-12 drywall screws. One layer ⅝" proprietary type X gypsum wallboard applied parallel to channels with 1" Type S drywall screws 8" o.c. at horizontal joints and 12" o.c. at intermediate channels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to the framing. **Second** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1⅝" Type S drywall screws 12" o.c. **Face** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 2⅜" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to framing.

Horizontal joints offset minimum 6" between layers. Vertical joints staggered 24" each layer and side.

Sound tested with 2½" unfaced glass fiber insulation friction fit in stud space. **(NLB)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company, LLC - ⅝" FireBloc® Type X

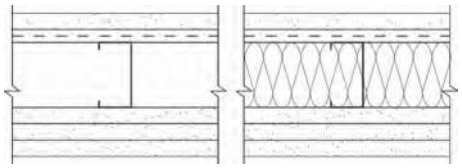

Thickness: 5"
Approx. Weight: 8.5 psf
Fire Test: UL R14196 (R2717), 09NK12599, 9-6-09; UL R2717, 09NK16538, 1-21-10; UL Design U421
Sound Test: RAL TL10-278, 8-19-10

GA FILE NO. WP 1504

PROPRIETARY* | **2 HOUR FIRE** | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer ⅝" proprietary type X gypsum board applied parallel or at right angles to each side of 3⅝" steel studs 24" o.c. with 1" Type S drywall screws 16" o.c. **Face** layer ⅝" proprietary type X gypsum board applied parallel or at right angles to each side with 1⅝" Type S drywall screws 16" o.c. Face layer horizontal joints offset not less than 12" from base layer horizontal joints.

Horizontal joints on opposite sides need not be staggered or backed. Sound tested with 3½" glass fiber insulation in stud cavity. **(NLB)**

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.
- (base layer) ⅝" CertainTeed® Type X Gypsum Board
- (face layer) ⅝" AirRenew® Gypsum Board

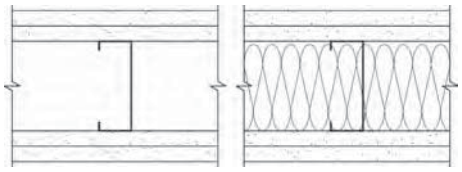

Thickness: 6⅛"
Approx. Weight: 10 psf
Fire Test: UL R3660, 07NK21428, 2-14-08, UL Design U411
Sound Test: NGC 2006049, 1-31-07

GA FILE NO. WP 1505

PROPRIETARY* | **2 HOUR FIRE** | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer ½" proprietary type X gypsum wallboard applied at right angles to each side of 2½" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. **Face** layer ⅝" proprietary type X gypsum wallboard applied parallel to each side with vertical joints midway between studs. **Face** layer attached to **base** layer only with 1½" Type G drywall screws 12" o.c. at vertical joints and centerline of face layer gypsum board. ⅜" to ½" diameter adhesive beads around the perimeter of face board, 2" from each edge and end, and in the form of an X joining the corners of the perimeter beads, are optional.

Joints staggered 24" each layer and side. Sound tested with adhesive attachment and 2½" glass fiber insulation friction fit in stud space. **(NLB)**

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Canada Inc.
- ½" CertainTeed® Type C Gypsum Board
- ⅝" CertainTeed® Type X Gypsum Board

Georgia Pacific Gypsum LLC
- ½" ToughRock® Fireguard C® Gypsum Board
- ⅝" ToughRock® Fireguard® Gypsum Board

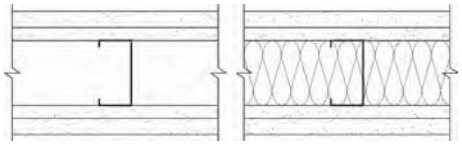

Thickness: 4¾"
Approx. Weight: 10 psf
Fire Test: ULC 75T208, 11-20-75, ULC Design W404
Sound Test: DRC 70-18-2, 2-16-70

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1506 — PROPRIETARY*

2 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 1 5/8" Type S drywall screws 16" o.c. at studs and 12" o.c. at top and bottom track. Face layer horizontal joints offset not less than 12" from base layer horizontal joints. Mineral fiber insulation in stud cavity

Horizontal joints on opposite sides need not be staggered or backed **(NLB)**

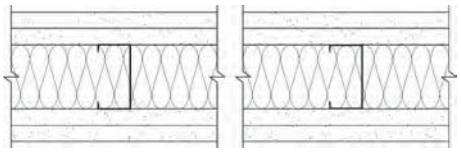

Thickness: 5"
Approx. Weight: 8.25 psf
Fire Test: UL R3660, 07NK21428, 2-14-08
UL Design V419
Sound Test: NGC 2006049, 1-31-07

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type X Gypsum Board

GA FILE NO. WP 1510 — GENERIC

2 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 32" o.c. 2" glass fiber insulation, 0.9 pcf, stapled to one side in stud space.

Face layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to ONE SIDE with 1 5/8" Type S drywall screws 12" o.c. at edges and 24" o.c. at intermediate studs.

OPPOSITE SIDE: **Second** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1 5/8" Type S drywall screws 12" o.c. **Face** layer 1/4" or 3/8" regular gypsum wallboard laminated parallel to studs with 3/4" daubs of adhesive spaced 12" o.c. each direction.

Joints staggered 24" each layer and side. **(NLB)**

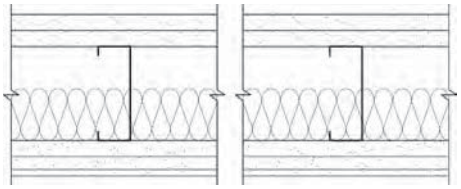

Thickness: 6 1/4" - 6 3/8" Varies
Approx. Weight: 11 psf
Fire Test: UL R3660-1, 8-21-68, UL Design U403
Sound Test: RAL TL69-118, 12-16-68

GA FILE NO. WP 1515 — PROPRIETARY*

2 HOUR FIRE | **55 to 59 FSTC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION, CEMENTITIOUS BACKER UNIT, CERAMIC TILE

Base layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 3 5/8" 20 ga steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. 3" proprietary mineral fiber insulation, 2.0 pcf, friction fit in stud space. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to ONE SIDE with 1 5/8" Type S drywall screws 12" o.c. Joints offset 24" o.c. from base layer joints.

OPPOSITE SIDE: **Face** layer 1/2" proprietary cementitious backer unit applied at right angles with 1 5/8" Type S-12 wafer head screws 8" o.c. Vertical joints offset 24" from base layer vertical joints. Joints covered with glass fiber mesh tape. Ceramic tile, 1/4" thick, joints grouted, installed with latex-modified portland cement mortar or ANSI A136.1 Type I organic adhesive. **(NLB)**

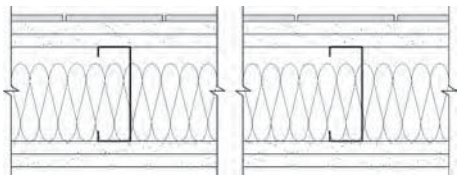

Thickness: 5 7/8"
Approx. Weight: 14 psf
Fire Test: UL R11270-1, -2, 1-21-85, UL Design U443
Field Sound Test: SA-851016, 10-14-85

PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC - 1/2" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc. - 1/2" Firecheck® Type C
National Gypsum Company - 1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
Temple-Inland - 1/2" TG-C
United States Gypsum Company - 1/2" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1520 | PROPRIETARY* | 2 HOUR FIRE | 55 to 59 STC SOUND

GYPSUM WALLBOARD, RESILIENT CHANNELS, STEEL STUDS, MINERAL FIBER INSULATION

Resilient channels 24" o.c. attached at right angles to ONE SIDE of 3½" 20 ga steel studs 24" o.c. with one ½" Type S-12 drywall screw at each stud. **Base** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1" Type S drywall screws 24" o.c. **Face** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1⅝" Type S drywall screws 12" o.c. 3" mineral fiber insulation, 2 pcf, friction fit in stud space.

OPPOSITE SIDE: One layer ½" proprietary type X gypsum wallboard applied parallel to studs with 1" Type S-12 drywall screws 12" o.c.

Joints staggered 24" each layer and side. **(NLB)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	½" FireBloc® Type C
CertainTeed Gypsum Inc.	-	½" CertainTeed® Type C Gypsum Board
CertainTeed Gypsum Canada Inc.	-	½" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	½" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	½" Firecheck® Type C
National Gypsum Company	-	½" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
Temple-Inland	-	½" TG-C
United States Gypsum Company	-	½" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

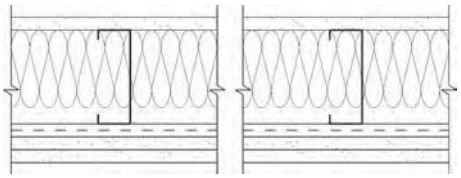

Thickness: 5½"
Approx. Weight: 9 psf
Fire Test: UL R1319-141 through 145, 2-11-87, UL Design U453
Sound Test: RAL TL83-215, 9-2-83

GA FILE NO. WP 1521 | GENERIC | 2 HOUR FIRE | 55 to 59 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer ½" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 3⅝" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Face** layer ½" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1⅝" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 3½" glass fiber friction fit in stud space. **(NLB)**

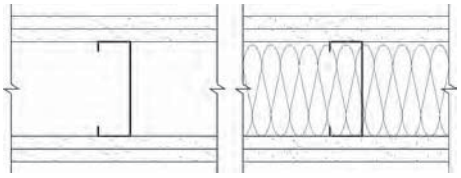

Thickness: 5⅝"
Approx. Weight: 9 psf
Fire Test: See WP 1545 (UC, 9-7-64; ULC 80T499, 3-26-81, ULC Design W414)
Sound Test: NRCC 815-NV, 2-3-81

GA FILE NO. WP 1522 | GENERIC | 2 HOUR FIRE | 55 to 59 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer ⅝" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 3⅝" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Face** layer ⅝" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with 1⅝" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 3½" glass fiber friction fit in stud space. **(NLB)**

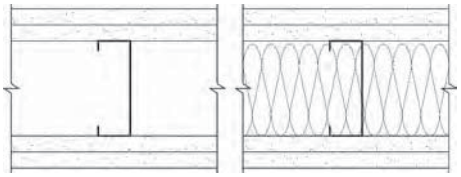

Thickness: 6⅛"
Approx. Weight: 12 psf
Fire Test: See WP 1548 (WHI-495-0236 & 237, 1-30-80)
Sound Test: NRCC 818-NV, 2-3-81

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1523

PROPRIETARY*

2 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 1 5/8" Type S drywall screws 16" o.c. Face layer horizontal joints offset not less than 12" from base layer horizontal joints.

Horizontal joints on opposite sides need not be staggered or backed. Sound tested with 3 1/2" glass fiber insulation in stud cavity. **(NLB)**

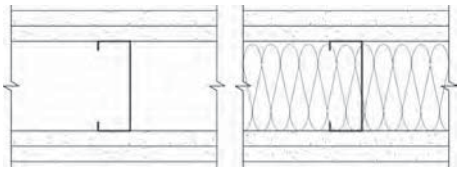

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Canada Inc. - 5/8" CertainTeed® Type X Gypsum Board

Thickness: 6 1/8"
Approx. Weight: 10 psf
Fire Test: UL R3660, 07NK21428, 2-14-08, ULC Design W414
Sound Test: NGC 2006049, 1-31-07

GA FILE NO. WP 1524

PROPRIETARY*

2 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 1 5/8" Type S drywall screws 16" o.c. Face layer horizontal joints offset not less than 12" from base layer horizontal joints.

Horizontal joints on opposite sides need not be staggered or backed. Sound tested with 3 1/2" glass fiber insulation in stud cavity. **(NLB)**

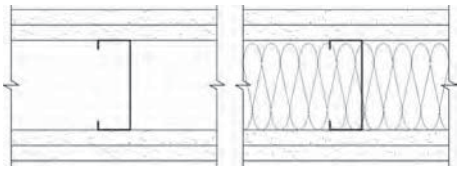

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type X Gypsum Board
Georgia Pacific Gypsum LLC - 5/8" ToughRock® Fireguard® Gypsum Board

Thickness: 6 1/8"
Approx. Weight: 10 psf
Fire Test: UL R3660, 07NK21428, 2-14-08, UL Design U411
Sound Test: NGC 2006049, 1-31-07

GA FILE NO. WP 1530

GENERIC

2 HOUR FIRE | **50 to 54 FSTC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 1 1/2" mineral fiber insulation stapled in stud space. **(NLB)**



Thickness: 3 5/8"
Approx. Weight: 9 psf
Fire Test: UC, 12-7-64
Field Sound Test: ACI 1131a, 7-14-64

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1545

GENERIC

2 HOUR FIRE

50 to 54 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 1 1/2" mineral fiber insulation friction fit in stud space. **(NLB)**

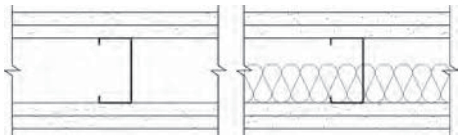

Thickness: 4 1/2"
Approx. Weight: 9 psf
Fire Test: UC, 9-7-64; ULC 80T499, 3-26-81, ULC Design W414
Sound Test: CK 654-40, 9-7-65

GA FILE NO. WP 1546

GENERIC

2 HOUR FIRE

50 to 54 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 2 1/2" glass fiber friction fit in stud space. **(NLB)**

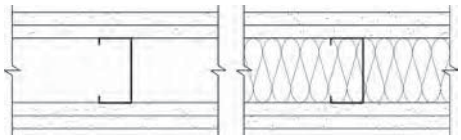

Thickness: 4 1/2"
Approx. Weight: 9 psf
Fire Test: See WP 1545 (UC, 9-7-64; ULC 80T499, 3-26-81, ULC Design W414)
Sound Test: NRCC 798-NV, 2-2-81

GA FILE NO. WP 1548

GENERIC

2 HOUR FIRE

50 to 54 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 2 1/2" glass fiber insulation friction fit in stud space. **(NLB)**

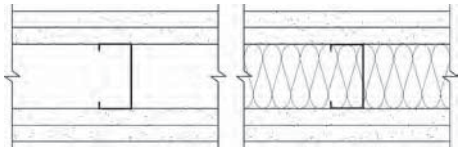

Thickness: 5"
Approx. Weight: 12 psf
Fire Test: WHI-495-0236 & 237, 1-30-80
Sound Test: WHI-218-1, 6-11-80

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1555 — PROPRIETARY

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to ONE SIDE of 2 1/2" proprietary steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to the framing.

OPPOSITE SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to the framing. **Second** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1 5/8" Type S drywall screws 12" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 2 3/8" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to framing.

Horizontal joints offset minimum 6" between layers. Vertical joints staggered 24" each layer and side.

Sound tested with gypsum board on single layer side applied parallel to studs and with 2 1/2" unfaced glass fiber insulation friction fit in stud space. **(NLB)**

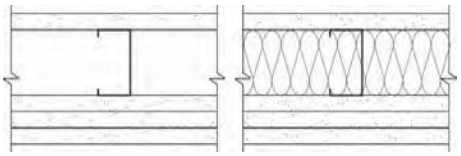

Thickness: 5"
Approx. Weight: 8.5 psf
Fire Test: UL R14196 (R2717), 09NK12599, 9-6-09; UL R2717, 09NK16538, 1-21-10; UL Design U421
Sound Test: RAL TL10-196, 6-9-10

PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC - 5/8" ToughRock® Fireguard® Gypsum Board

GA FILE NO. WP 1556 — PROPRIETARY

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to ONE SIDE of 2 1/2" proprietary steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to the framing.

OPPOSITE SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to the framing. **Second** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1 5/8" Type S drywall screws 12" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 2 3/8" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to framing.

Horizontal joints offset minimum 6" between layers. Vertical joints staggered 24" each layer and side.

Sound tested with 2 1/2" unfaced glass fiber insulation friction fit in stud space. **(NLB)**

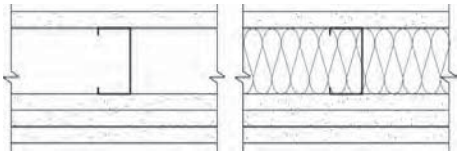

Thickness: 5"
Approx. Weight: 8.5 psf
Fire Test: UL R14196 (R2717), 09NK12599, 9-6-09; UL R2717, 09NK16538, 1-21-10; UL Design U421
Sound Test: RAL TL10-279, 8-19-10

PROPRIETARY GYPSUM BOARD

American Gypsum Company, LLC - 5/8" FireBloc® Type X

GA FILE NO. WP 1560 — GENERIC

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM VENEER PLASTER, GYPSUM VENEER BASE, STEEL STUDS

Base layer 1/2" type X gypsum veneer base applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. at vertical joints and intermediate studs. **Face** layer 1/2" type X gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 12" o.c. at vertical joints and intermediate studs. 3/32" gypsum veneer plaster applied over each side.

Joints staggered 24" each layer and side. Sound tested with 1" mineral fiber insulation stapled in stud space. **(NLB)**

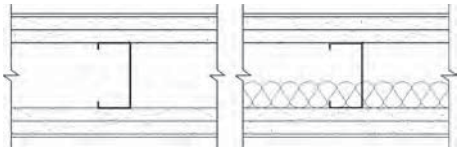

Thickness: 4 3/4"
Approx. Weight: 10 psf
Fire Test: UL R5085-7, R4142, 12-1-66 (Rev. 1-16-80), UL Design U424
Sound Test: CK 654-66, 12-29-65

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1561 | PROPRIETARY* | 2 HOUR FIRE | 50 to 54 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 1 5/8" Type S drywall screws 16" o.c. Face layer horizontal joints need not be staggered or backed, or offset from base layer joints. Horizontal joints on opposite sides need not be staggered or backed. **(NLB)**

Sound tested with 3 1/2" glass fiber insulation in stud cavity.

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® X

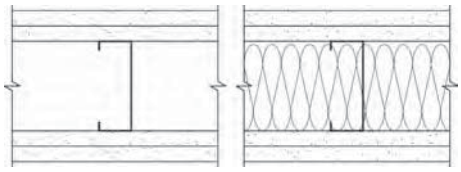

Thickness: 6 1/8"
Approx. Weight: 7 psf
Fire Test: UL R1319, 11NK08543, 6-17-11, UL Design U419
Sound Test: RAL TL11-176, 5-23-11

GA FILE NO. WP 1565 | PROPRIETARY* | 2 HOUR FIRE | 50 to 54 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION, CEMENTITIOUS BACKER UNIT

Base layer 1/2" proprietary type X gypsum wallboard or veneer base applied parallel to each side of 3 5/8" 25 ga steel studs 16" o.c. with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard or veneer base applied parallel to ONE SIDE with 1 5/8" Type S drywall screws 12" o.c. 3" mineral fiber insulation batts, 2.5 pcf, in stud space.

OPPOSITE SIDE: **Face** layer 1/2" proprietary cementitious backer units applied parallel to studs with 1 5/8" Type S wafer head screws 8" o.c.

Joints staggered 16" each layer and side. **(NLB)**

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board



Thickness: 5 5/8"
Approx. Weight: 8 psf
Fire Test: ITS J98-32931, 12-11 & 2-5-99, ITS Design NGC/WA 120-01; UL R22158, 05CA15728, 5-23-05, UL Design V452
Sound Test: NGC 2099016, 8-23-99

GA FILE NO. WP 1570 | PROPRIETARY* | 2 HOUR FIRE | 50 to 54 FSTC SOUND

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION

One layer 3/4" proprietary type X gypsum wallboard applied parallel to each side of 3 1/2" steel studs 24" o.c. with 1 1/4" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs. 3" proprietary mineral fiber insulation, 2.0 pcf, friction fit in stud space.

Joints staggered 24" on opposite sides. **(NLB)**

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 3/4" SHEETROCK® Brand ULTRACODE® Core Gypsum Panels



Thickness: 5"
Approx. Weight: 7 psf
Fire Test: UL R1319, 91NK16132, 11-18-91, UL Design U491
Field Sound Test: USG-910617, 6-26-91

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1615 — GENERIC — 2 HOUR FIRE — 45 to 49 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. **(NLB)**

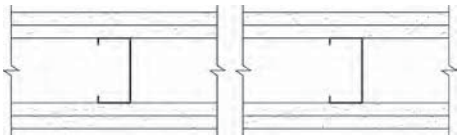

Thickness: 4 1/2"
Approx. Weight: 9 psf
Fire Test: UC, 9-7-64; ULC 80T499, 3-26-81, ULC Design W414
Sound Test: NGC 2250, 1-3-68

GA FILE NO. WP 1616 — GENERIC — 2 HOUR FIRE — 45 to 49 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs. **Face** layer 5/8" plain or predecorated type X gypsum wallboard or gypsum veneer base applied parallel to each side laminating compound combed over entire surface. Metal base and top retainer channels.

Joints staggered 24" each layer and side. **(NLB)**

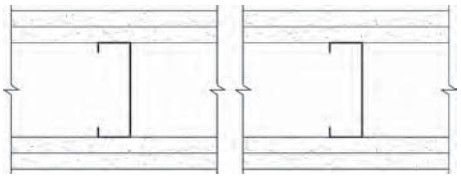

Thickness: 6 1/8"
Approx. Weight: 10 psf
Fire Test: UL R1319-31, 6-2-60, UL Design U411
Sound Test: NGC 2005005, 6-15-05 RAL TL06-115, 4-12-06

GA FILE NO. WP 1625 — PROPRIETARY* — 2 HOUR FIRE — 45 to 49 STC SOUND

GYPSUM PLASTER, GYPSUM LATH, METAL LATH, STEEL STUDS

One layer 3/8" thick proprietary gypsum lath applied at right angles to each side of 2 1/2" 20 ga steel studs 16" o.c. with 1" Type S drywall screws 8" o.c. Mineral fiber batts (optional) in stud space. 3.4 lb self furring diamond mesh metal lath applied to each side over gypsum lath with 1" Type S screws. 3/4" 1:2 gypsum-sand plaster with a lime gauging plaster finish applied over each side.

Sound tested with 2" mineral fiber stapled in stud space. **(NLB)**

PROPRIETARY GYPSUM LATH

United States Gypsum Company - 3/8" ROCKLATH® FIRECODE® Core Plaster Base

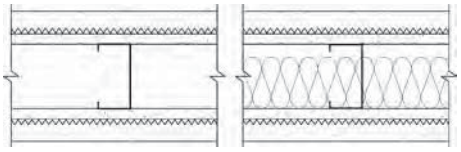

Thickness: 4 3/4"
Approx. Weight: 16 psf
Fire Test: UL R1319, 2-28-90, UL Design U484
Sound Test: CK 664-17, 4-1-66; CK 664-18, 4-6-66

Contact the manufacturer for more detailed information on proprietary products.

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1630 | GENERIC | 2 HOUR FIRE | 45 to 49 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. at vertical joints and wall perimeter and 36" o.c. at intermediate studs. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 4" wide strips of drywall laminating adhesive 2" from board edges and 4" off board centerline and 1 3/4" Type S drywall screws 12" o.c. at wall perimeter and 16" o.c. at intermediate studs.

Joints staggered 24" each layer and side. **(NLB)**

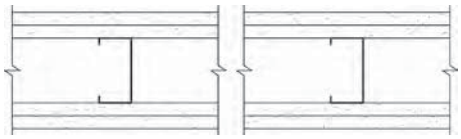

Thickness: 4 1/2"
Approx. Weight: 9 psf
Fire Test: OSU T-3218, 9-17-65
Sound Test: NGC 2111, 2-6-67

GA FILE NO. WP 1632 | PROPRIETARY* | 2 HOUR FIRE | 45 to 49 STC SOUND

GYPSUM WALLBOARD, GLASS MAT GYPSUM BOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" proprietary glass mat water-resistant gypsum backing board applied parallel to each side with 1 5/8" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs and wall perimeter.

Joints staggered 24" each layer and side and covered with 10 x 10 mesh glass tape and tile adhesive. **(NLB)**

PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC - 1/2" DensShield® Tile Backer
- 1/2" ToughRock® Fireguard C® Gypsum Board

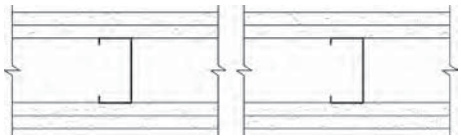

Thickness: 4 1/2"
Approx. Weight: 9 psf
Fire Test: CTC 1894-1530, 1-15-88
Sound Test: See WP 1615 (NGC 2250, 1-3-68)

GA FILE NO. WP 1635 | GENERIC | 2 HOUR FIRE | 45 to 49 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 3 1/2" 20 ga steel studs 24" o.c. with 1" Type S-12 drywall screws 12" o.c. **Second** layer ½" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S-12 drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with 1 7/8" Type S-12 drywall screws 12" o.c. and 1 1/2" Type G screws 12" o.c. midway between studs. Studs attached to each side of floor and ceiling runners by welding or with 1/2" Type S-12 panhead screws.

Joints staggered 24" each layer and side.

Bracing: Lateral bracing spaced not over 40" o.c. shall be 1" by 18 ga steel straps attached to each side or channel bracing attached to each stud with a clip angle. For studs with holes or punch-outs in the web the "Q" factor shall be determined by means of stub column tests. Tested at 100 percent of design load. **(LOAD-BEARING)**

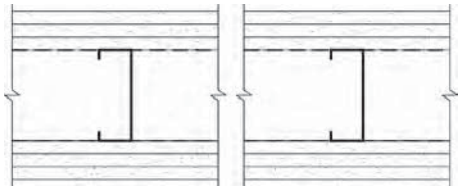

Thickness: 6 1/2"
Approx. Weight: 11 psf
Fire Test: UL NC 505-4, 7-29-82, UL Design U425
Sound Test: Estimated

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1714 | GENERIC | 2 HOUR FIRE | 40 to 44 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to 2 1/2" 18 ga steel studs 16" o.c. with 1" Type S-12 drywall screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S-12 drywall screws 12" o.c. Studs attached to each side of floor and ceiling runners by welding.

Joints staggered 16" each layer and side.

Bracing: Lateral bracing on each side shall be 3/4" cold rolled channel at 1/3 points screw attached with 1/2" Type S-12 drywall screws. Tested at 100 percent of design load. **(LOAD-BEARING)**

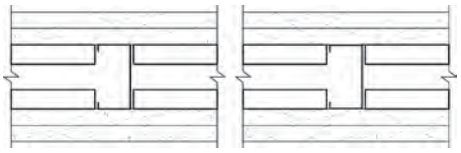

Thickness: 5"
Approx. Weight: 10 psf
Fire Test: FM WP 199-2, 1-25-71
Sound Test: See WP 1615 (NGC 2250, 1-3-68)

GA FILE NO. WP 1716 | GENERIC | 2 HOUR FIRE | 40 to 44 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 3 1/2" 20 ga steel studs 24" o.c. with 1" Type S-12 drywall screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S-12 drywall screws 12" o.c. Studs attached to each side of floor and ceiling runners by welding or with 1/2" Type S-12 panhead screws.

Joints staggered 24" each layer and side.

Bracing: Lateral bracing spaced not over 40" o.c. shall be 1" by 18 ga steel straps attached to each side or channel bracing attached to each stud with a clip angle. For studs with holes or punch-outs in the web the "Q" factor shall be determined by means of stub column tests. **Tested at 80 percent of design load. (LIMITED LOAD-BEARING)**

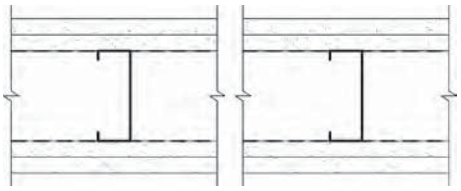

Thickness: 6"
Approx. Weight: 10 psf
Fire Test: UL NC 505-6, 7-29-82, UL Design U425
Sound Test: See WP 1615 (NGC 2250, 1-3-68)

GA FILE NO. WP 1830 | GENERIC | 2 HOUR FIRE | 35 to 39 STC SOUND

SEMI-SOLID GYPSUM WALLBOARD, GYPSUM STUDS

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" x 6" type X gypsum board studs 24" o.c. with laminating compound combed over entire surface of gypsum studs and 2" Type G drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side with laminating compound combed over entire contact surface, 2" Type G drywall screws 24" o.c. at gypsum studs and 1 1/2" Type S drywall screws 24" o.c. at floor and ceiling channels.

Joints staggered 24" each layer and side. **(NLB)**



Thickness: 3 5/8"
Limiting Height: 14'0"
Approx. Weight: 10 psf
Fire Test: UC, 2-8-62
Sound Test: See WP 1330 (Based on G&H BW-8FT, 8-1-62)

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1841

PROPRIETARY*

2 HOUR FIRE | **35 to 39 STC SOUND**

SOLID GYPSUM WALLBOARD

One layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1" x 24" proprietary type X gypsum panels with laminating compound combed over the entire contact surface and 1 5/16" Type S screws 24" o.c. horizontally and vertically. 1" gypsum coreboard panels attached to 25 ga 1" x 2 1/4" high "L" runners along floor and ceiling lines with two 1 5/16" Type S screws at top and bottom. Wallboard layers attached to "L" runners with 1 7/8" Type S screws 12" o.c.

Joints staggered 12" on opposite sides. **(NLB)**



PROPRIETARY GYPSUM BOARD

National Gypsum Company
- 1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Wallboard
- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

Thickness: 2"
Limiting Height: Refer to manufacturer
Approx. Weight: 8 psf
Fire Test: UL R3501, 92NK28896, 6-4-93, UL Design U525; FM WP-668, 6-28-82
Sound Test: Based on NGC 2359, 11-18-69

GA FILE NO. WP 1870

PROPRIETARY*

2 HOUR FIRE | **35 to 39 STC SOUND**

SOLID GYPSUM WALLBOARD, PROTECTED STEEL H MEMBERS

Two 1" x 24" proprietary type X gypsum panels installed vertically between floor and ceiling runners and friction fit into "H" members 24" o.c. One layer 1/2" x 6" wide strips proprietary type X gypsum wallboard applied to each side over steel flanges and runners with 1" Type S drywall screws 12" o.c. **(NLB)**



PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC
- 1/2" ToughRock® Fireguard C® Gypsum Board
- 1" DensGlass® Shaftliner

Thickness: 3"
Approx. Weight: 9.5 psf
Fire Test: WHI 495-0743, 1-28-86; WHI 495-0744, 1-30-86; CTC 1869-0438, 9-22-87
Sound Test: Estimated

GA FILE NO. WP 1930

GENERIC

2 HOUR FIRE | **30 to 34 STC SOUND**

SOLID GYPSUM PLASTER, METAL CHANNEL, METAL LATH

2 1/2" solid 1:2 or 1:3 gypsum-perlite plaster applied over 3.4 lb metal lath wire tied 6" o.c. to one side of 3/4" cold rolled channel studs 16" o.c. embedded in the plaster. **(NLB)**



Thickness: 2 1/2"
Limiting Height: 12'0"
Approx. Weight: 12 psf
Fire Test: UL R3453, 2-13-52
Sound Test: See WP 1380 (BMS 144/523, 2-25-55; NBS Monograph 77, 11-30-64)

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1941

PROPRIETARY*

2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION

One layer 3/4" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 3 1/2" 20 ga steel studs 24" o.c. with 1 1/4" Type S drywall screws 8" o.c. at vertical edges and either 12" o.c. at intermediate studs when applied parallel to studs or 8" o.c. at intermediate studs when applied at right angles to studs. 3" mineral fiber insulation, 3.0 pcf, friction fit in stud space.

Vertical joints staggered 24" on opposite sides. **(NLB)**



Thickness: 5"
Approx. Weight: 7 psf
Fire Test: UL R1319, 91NK16132, 11-18-91 (rev. 12-15-92), UL Design U491; UL R1319, 96NK11081, 4-3-97, UL Design U419

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 3/4" SHEETROCK® Brand ULTRACODE® Core Gypsum Panels

GA FILE NO. WP 1942

PROPRIETARY*

2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION, CEMENTITIOUS BACKER UNITS

Base layer 5/8" proprietary type X gypsum wallboard or gypsum sheathing applied parallel or at right angles to one side of 3 1/2" 20 ga steel studs 16" o.c. with 1" Type S drywall screws 12" o.c. **Face** layer 1/2" or 5/8" proprietary cememtitious backer units applied parallel or at right angles to studs with 1 5/8" corrosion resistant Type S-12 wafer-head screws 8" o.c. 3" mineral fiber insulation, 3.0 pcf, friction fit in stud space.

OPPOSITE SIDE: **Base** layer 5/8" proprietary type X gypsum board or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum board or gypsum veneer base applied parallel or at right angles to studs with 1 5/8" Type S drywall screws 16" o.c.

Vertical joints staggered 16" each layer and side, horizontal joints staggered 12" each layer and side. **(NLB)**



Thickness: 5 7/8"
Approx. Weight: 10 psf
Fire Test: UL R12262, 98NK38523, 1-27-98 & 98NK4375, 1-26-98, UL Design U404

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels

GA FILE NO. WP 1943

PROPRIETARY*

2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard applied parallel to each side of 3 1/2" 25 ga steel studs 24" o.c. with 1 1/8" Type S drywall screws 8" o.c. at vertical joints and wall perimeter and 12" o.c. at intermediate studs. **Second** layer 5/8" proprietary type X gypsum wallboard applied parallel to studs ONE SIDE ONLY with 1 5/8" Type S drywall screws 12" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel to studs ONE SIDE ONLY with 2 1/4" Type S drywall screws 8" o.c. at vertical joints and wall perimeter and 12" o.c. at intermediate studs.

Vertical joints staggered 24" each layer and side. **(NLB)**



Thickness: 6"
Approx. Weight: 9 psf
Fire Test: UL R3501, 03NK13365, 10-27-03, UL Design V449

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1944

PROPRIETARY*

2 HOUR FIRE

GYPSUM PANEL PRODUCTS, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard or glass mat gypsum substrate applied parallel to each side of 2 1/2" proprietary steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. at top and bottom track and 16" o.c. at studs. **Face** layer 5/8" proprietary type X gypsum wallboard or glass mat gypsum substrate applied parallel to each side of studs with 1 5/8" Type S drywall screws 12" o.c. at top and bottom runner and 16" o.c. at studs. Face layer joints offset 24" from base layer joints.

Joints staggered 24" each layer and side. **(NLB)**



Thickness: 5"
Approx. Weight: 9 psf
Fire Test: UL R14196, 07NK11544, 8-6-07; UL R3501, 07NK17992, 12-12-07; UL Design V450

PROPRIETARY GYPSUM PANEL PRODUCTS

American Gypsum Company LLC	-	5/8" FireBloc® Type X
Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard® Gypsum Board
Lafarge North America Inc.	-	5/8" Firecheck® Type X
National Gypsum Company	-	5/8" Gold Bond® Brand e2XP® Interior Extreme® Gypsum Panels

GA FILE NO. WP 1945

PROPRIETARY*

2 HOUR FIRE

GYPSUM PANEL PRODUCTS, STEEL STUDS, RESILIENT CHANNELS

Resilient channels 16" o.c. attached at right angles to ONE SIDE of 2 1/2" proprietary steel studs 24" o.c. with 1/2" Type S-12 panhead screws. **Base** layer 5/8" proprietary type X gypsum wallboard or glass mat gypsum panels applied at right angles to channels with 1" Type S drywall screws 12" o.c. at top and bottom of the wall and 16" o.c. in the field of the wall. **Face** layer 5/8" proprietary type X gypsum wallboard or glass mat gypsum panels applied at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. at top and bottom of the wall and 16" o.c. in the field of the wall. Face layer joints offset 24" from base layer joints.

OPPOSITE SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard or glass mat gypsum panels applied parallel to studs with 1" Type S drywall screws 12" o.c. at top and bottom runners and 16" o.c. in the field of the wall. **Face** layer 5/8" proprietary type X gypsum wallboard or glass mat gypsum panels applied parallel to studs with 1 5/8" Type S drywall screws 12" o.c. at top and bottom runners and 16" o.c. in the field of the wall. Face layer joints offset 24" from base layer joints.

Joints staggered 24" each layer and side. **(NLB)**



Thickness: 5 1/2"
Approx. Weight: 9 psf
Fire Test: UL R2717, 07NK23006, 3-11-08, UL Design V450

PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard® Gypsum Board

GA FILE NO. WP 1946

PROPRIETARY*

2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to ONE SIDE of 3 1/2", 25 ga steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to framing.

OPPOSITE SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to framing. **Second** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1 5/8" Type S drywall screws 12" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 2 3/8" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to framing. Horizontal joints staggered not less than 6" between layers. When gypsum panels are other then 48" wide, panels are applied at right angles to the framing.

Vertical joints staggered 24" each layer and side. **(NLB)**



Thickness: 6"
Approx. Weight: 8.5 psf
Fire Test: UL R1319, 01NK40260, 12-17-01; UL R1319, 06NK16621, 07-06-06; UL Design U408; ULC Design W451

PROPRIETARY GYPSUM BOARD

United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1947 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM WALLBOARD, STRUCTURAL CEMENT PANELS, GLASS FIBER INSULATION, STEEL STUDS

Base layer 3/4" proprietary structural cement panels applied at right angles to each side of 3 1/2", 20 ga steel studs 16" o.c. with #8 by 1 5/8" self-drilling wing screws 8" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side with #6 by 2" Type S-12 drywall screws 8" o.c. Face layer horizontal joints offset 2" from base layer joints. Glass fiber insulation, 3 1/2" thick, friction fit in stud space. **(LOAD-BEARING)**

ALTERNATE INSTALLATION: Two layers of proprietary structural cement panels applied at the top of the wall with the **base** layer a minimum of 12" wide and the **face** layer a minimum of 10" wide. Remainder of the **face** layer is 5/8" proprietary type X gypsum wallboard applied as described above. Glass fiber insulation as described above. **(LOAD-BEARING)**



Thickness: 6 1/4"
Approx. Weight: 10.5 psf
Fire Test: UL R25352, 07CA23480, 8-27-07; 11NK12862, 10-12-11; UL Design V465

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels

GA FILE NO. WP 1948 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied at right angles to each side with 1 5/8" Type S drywall screws 16" o.c.

Vertical joints centered over studs and staggered one stud cavity on opposite sides of the wall. Horizontal joints on opposite sides need not be staggered or backed. Horizontal edge and butt joints in adjacent layers staggered a minimum of 12". **(NLB)**



Thickness: 4 1/8"
Approx. Weight: 10 psf
Fire Test: UL R2717, 08NK19963, 2-13-09; 09SR4800268, 5-11-09; UL Designs V487 & U411

PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC - 5/8" ToughRock® Fireguard® Gypsum Board

GA FILE NO. WP 1949 — PROPRIETARY — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to ONE SIDE of 2 1/2" proprietary steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to the framing.

OPPOSITE SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to the framing. **Second** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1 5/8" Type S drywall screws 12" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 2 3/8" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to framing.

Horizontal joints offset minimum 12" between layers. Vertical joints staggered 24" each layer and side. **(NLB)**



Thickness: 5"
Approx. Weight: 8.5 psf
Fire Test: UL R14196, 09NK12599, 11-10-09; UL R3660, 10NK14500, 10-29-10; UL Design U421

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type X Gypsum Board
Lafarge North America Inc.	-	5/8" Firecheck® Type X
PABCO Gypsum	-	5/8" FLAME CURB® Type X
Temple-Inland	-	5/8" Type X

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 1950

PROPRIETARY

2 HOUR FIRE

GYPSUM WALLBOARD, RESILIENT CHANNELS, STEEL STUDS

Resilient channels 16" o.c. attached at right angles to ONE SIDE of 2½" proprietary steel studs 24" o.c. with ½" Type S-12 drywall screws. One layer ⅝" proprietary type X gypsum wallboard applied parallel to channels with 1" Type S drywall screws 8" o.c. at horizontal joints and 12" o.c. at intermediate channels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to the framing. **Second** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1⅝" Type S drywall screws 12" o.c. **Face** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 2⅜" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to framing, or 8" o.c. at vertical joints and in the field when applied at right angles to framing.

Horizontal joints offset minimum 12" between layers. Vertical joints staggered 24" each layer and side. **(NLB)**



Thickness: 5½"
Approx. Weight: 8.5 psf
Fire Test: UL R14196, 09NK12599, 11-10-09, UL Design U421

PROPRIETARY GYPSUM BOARD

Lafarge North America Inc.	-	⅝" Firecheck® Type X
PABCO Gypsum	-	⅝" FLAME CURB® Type X
Temple-Inland	-	⅝" Type X

GA FILE NO. WP 1951

PROPRIETARY*

2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer ½" proprietary type X gypsum wallboard applied parallel or at right angles to each side of 1⅝" steel studs 24" o.c. with 1" Type S drywall screws 16" o.c. **Face** layer ½" proprietary type X gypsum wallboard applied parallel or at right angles with 1⅝" Type S drywall screws 16" o.c. Face layer screws offset 8" from base layer screws.

Vertical joints staggered 24" each layer and side. Horizontal joints need not be staggered. **(NLB)**



Thickness: 3⅝"
Approx. Weight: 9 psf
Fire Test: UL R14196, 09CA11604, 2-13-10, UL Design V489, System C

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	½" FireBloc® Type C
Temple-Inland	-	½" TG-C

GA FILE NO. WP 1952

PROPRIETARY*

2 HOUR FIRE

GYPSUM BOARD, STEEL STUDS

Base layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 3½", 20 ga steel studs 24" o.c. with 1" Type S-12 drywall screws 16" o.c. **Face** layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with 1⅝" Type S-12 drywall screws 16" o.c. Face layer horizontal joints need not be staggered or backed from base layer joints, on on opposite sides; a load reduction to 90% when joints are not staggered. **(LOAD-BEARING)**



Thickness: 6⅛"
Approx. Weight: 7 psf
Fire Test: UL R1319, 11NK08543, 6-17-11, UL Design U423

PROPRIETARY GYPSUM BOARD

United States Gypsum Company	-	⅝" SHEETROCK® Brand UltraLight Panels FIRECODE® X

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 2750

PROPRIETARY*

3 HOUR FIRE | **55 to 59 FSTC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Second** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side with 1 5/8" Type S drywall screws 24" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side with 2 5/8" Type S drywall screws 12" o.c.

Vertical Joints staggered 24" each layer and side. Horizontal joints need not be staggered.

Sound tested with 2 1/2" glass fiber insulation friction fit in stud space. **(NLB)**

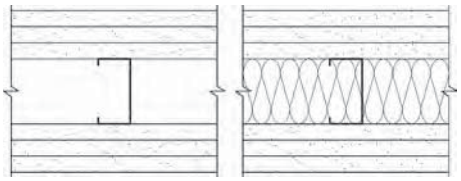

Thickness: 6 1/8"
Approx. Weight: 14 psf
Fire Test: UL R14196, 09CA11604 2-13-10, UL Design V486, system F
Sound Test: RAL TL10-276, 8-17-10

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type X

GA FILE NO. WP 2800

PROPRIETARY*

3 HOUR FIRE | **55 to 59 FSTC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 24" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with 2 1/4" Type S drywall screws 12" o.c. and 1 1/2" Type G drywall screws midway between studs 1" above and below horizontal joints for right angle application.

Joints staggered 24" each layer and side. Sound tested with 1 1/2" mineral fiber insulation friction fit in stud space. **(NLB)**

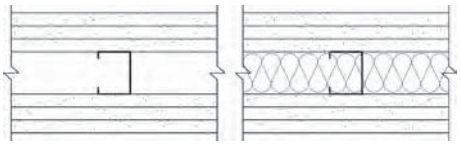

Thickness: 4 5/8"
Approx. Weight: 13 psf
Fire Test: UL R1319-138, 139, 5-27-82, UL Design U435
Field Sound Test: SA-830112, 1-12-83

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 1/2" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

GA FILE NO. WP 2921

PROPRIETARY*

3 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. Joints staggered 24" on opposite sides. **Second** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 30" o.c. and 1 1/2" Type G drywall screws 12" o.c. spaced 1 1/2" from vertical joints. Vertical joints located 8" from studs and staggered 24" on opposite sides. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 2 1/4" Type S drywall screws 12" o.c. and 1 1/2" Type G drywall screws midway between studs 1 1/2" above and below horizontal joints. Joints offset 24" from second layer joints.

Sound tested with 1 1/2" glass fiber insulation friction fit in stud space. **(NLB)**

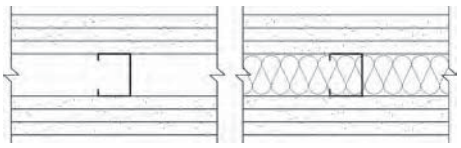

Thickness: 4 5/8"
Approx. Weight: 14 psf
Fire Test: UL R3501, 92NK28896, 9-15-93, UL Design U435; WHI-694-0084, 3-16-83
Sound Test: NGC 2636, 7-21-83

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 2922 — PROPRIETARY* — 3 HOUR FIRE — 50 to 54 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 36" o.c. **Second** layer 1/2" proprietary type X gypsum wallboard applied at parallel or at right angles to each side with 1 5/8" Type S drywall screws 24" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard applied at right angles to each side with 2 1/4" Type S drywall screws 12" o.c. and 1 1/2" Type G drywall screws midway between studs 1 1/2" above and below horizontal joints.

Joints staggered 24" each layer and side. Sound tested with 1 1/2" glass fiber insulation friction fit in stud space. **(NLB)**

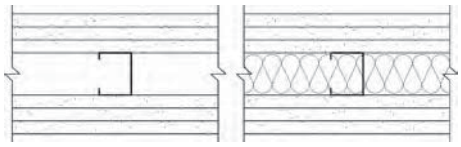

Thickness: 4 5/8"
Approx. Weight: 13 psf
Fire Test: WHI-495-0804, 11-19-86; UL R7094, 10-24-90, UL Design U435
Sound Test: WEAL 87-118, 1-22-87

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	1/2" FireBloc® Type C
CertainTeed Gypsum Inc.	-	1/2" CertainTeed® Type C Gypsum Board
CertainTeed Gypsum Canada Inc.	-	1/2" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	1/2" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	1/2" Firecheck® Type C
PABCO Gypsum	-	1/2" FLAME CURB® Super 'C'™
Temple-Inland	-	1/2" TG-C

GA FILE NO. WP 2924 — PROPRIETARY* — 3 HOUR FIRE — 50 to 54 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. **Second** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 12" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 2 1/4" Type S drywall screws 12" o.c. and 1 1/2" Type G drywall screws 24" o.c. midway between studs and 1 1/4" above and below horizontal joints.

Joints staggered 24" each layer and side. Sound tested with 1 1/2" mineral fiber insulation friction fit in stud space. **(NLB)**

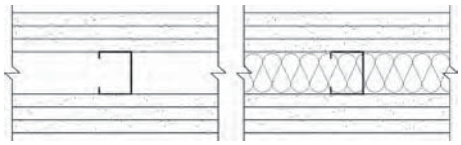

Thickness: 4 5/8"
Approx. Weight: 14 psf
Fire Test: ULC 85T381, 11-14-85, ULC Design W418
Sound Test: NRCC 1073-NV, 6-18-86

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Canada Inc.	-	1/2" CertainTeed® Type C Gypsum Board

GA FILE NO. WP 2925 — PROPRIETARY* — 3 HOUR FIRE — 50 to 54 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Second** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 24" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 2 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" on opposite sides and between layers. Screws offset 6" between layers.

Sound tested with 1 5/8" glass fiber insulation friction fit in stud space. **(NLB)**

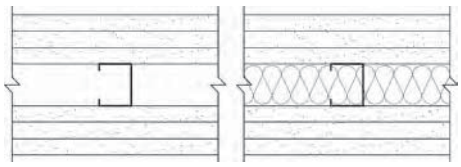

Thickness: 5 3/8"
Approx. Weight: 14 psf
Fire Test: UL R3501, 03NK32889, 10-30-03, UL Design V438
Sound Test: NGC 2636, 7-21-83

PROPRIETARY GYPSUM BOARD

National Gypsum Company	-	5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 2930

PROPRIETARY*

3 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 3/4" proprietary type X gypsum wallboard applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1 1/4" Type S drywall screws 24" o.c. **Face** layer 3/4" proprietary type X gypsum wallboard applied parallel or at right angles to each side with 2 1/4" long Type S drywall screws 12" o.c. and 1 1/2" Type G screws midway between studs along horizontal joints.

Joints staggered 24" each layer and side. **(NLB)**



PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 3/4" SHEETROCK® Brand ULTRACODE® Core Gypsum Panels

Thickness: 4 5/8"
Approx. Weight: 11 psf
Fire Test: UL R1319, 92NK18757, 8-17-92, UL Design U435

GA FILE NO. WP 2931

PROPRIETARY*

3 HOUR FIRE

GYPSUM WALLBOARD, STRUCTURAL CEMENT PANELS, GLASS FIBER INSULATION, STEEL STUDS

Base layer 3/4" proprietary structural cement panels applied at right angles to each side of 3 1/2", 18 ga steel studs 16" o.c. with #8 by 1 5/8" self-drilling wing screws 8" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side with #6 by 2" Type S-12 drywall screws 8" o.c. Face layer horizontal joints offset 2" from base layer joints. Glass fiber insulation, 3 1/2" thick, friction fit in stud space. **(LOAD-BEARING)**

ALTERNATE INSTALLATION: Two layers of proprietary structural cement panels applied at the top of the wall with the **base** layer a minimum of 12" wide and the **face** layer a minimum of 10" wide. Remainder of the **face** layer is 5/8" proprietary type X gypsum wallboard applied as described above. Glass fiber insulation as described above. **(LOAD-BEARING)**



PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels

Thickness: 6 1/4"
Approx. Weight: 10.5 psf
Fire Test: UL R25352, 07NK26195, 3-14-08; 11NK12862, 10-12-11; UL Design V471

GA FILE NO. WP 2932

PROPRIETARY*

3 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard applied parallel or at right angles to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" proprietary type X gypsum wallboard applied parallel or at right angles with 1 5/8" Type S drywall screws 24" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard applied parallel or at right angles with 2 1/4" Type S drywall screws 12" o.c. Screws offset 6" between layers.

Vertical joints staggered 24" on each layer and side. Horizontal joints need not be staggered. **(NLB)**



PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 1/2" FireBloc® Type C
Temple-Inland - 1/2" TG-C

Thickness: 4 5/8"
Approx. Weight: 13 psf
Fire Test: UL R14196, 09CA11604, 2-13-10, UL Design V489, System E

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 2945 — PROPRIETARY* — 4 HOUR FIRE — 60 to 64 FSTC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 48" o.c. **Second** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 48" o.c. **Third** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 2 1/4" Type S drywall screws 48" o.c. **Face** layer 1/2" proprietary gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with 2 5/8" Type S drywall screws 12" o.c. and 1½" Type G screws midway between studs 1" above and below horizontal joints for right angle application.

Joints staggered 24" each layer and side. Sound tested with 1 1/2" mineral fiber insulation friction fit in stud space. **(NLB)**

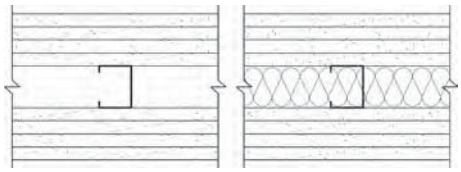

Thickness: 5 5/8"
Approx. Weight: 17 psf
Fire Test: UL R1319-138, -139, 5-27-82, UL Design U435
Field Sound Test: SA-830113, 1-13-83

PROPRIETARY GYPSUM BOARD

United States Gypsum Company	- 1/2" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

GA FILE NO. WP 2960 — PROPRIETARY* — 4 HOUR FIRE — 55 to 59 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 48" o.c. at studs and 24" o.c. at floor and ceiling runners. Joints staggered 24" on opposite sides. **Second** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 12" o.c. Joints aligned with base layer joints. **Third** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 2 1/4" Type S drywall screws 30" o.c. and 1 1/2" Type G drywall screws 12" o.c. spaced 1 1/2" from vertical joints. Vertical joints located 8" from studs and staggered 24" on opposite sides. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 2 5/8" Type S drywall screws 12" o.c. and 1 1/2" Type G drywall screws midway between studs 1 1/2" above and below horizontal joints. Joints offset 24" from third layer joints.

Sound tested with 1 1/2" glass fiber insulation friction fit in stud space. **(NLB)**

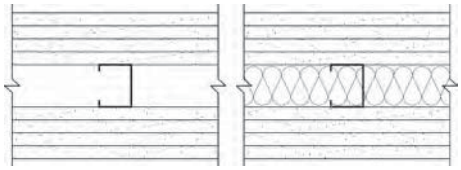

Thickness: 5 5/8"
Approx. Weight: 19 psf
Fire Test: UL R3501, 92NK28896, 9-15-93, UL Design U435; WHI-694-108.1, 6-28-83
Sound Test: NGC 2634, 7-20-83

PROPRIETARY GYPSUM BOARD

National Gypsum Company	- 1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

GA FILE NO. WP 2961 — PROPRIETARY* — 4 HOUR FIRE — 55 to 59 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 48" o.c. **Second** layer 1/2" proprietary type X gypsum wallboard applied parallel to each side with 1 5/8" Type S drywall screws 36" o.c. **Third** layer 1/2" proprietary type X gypsum wallboard applied parallel or at right angles to each side with 2 1/4" Type S drywall screws 24" o.c. and 1 1/2" Type G drywall screws midway between studs 36" o.c. vertically. **Face** layer 1/2" proprietary type X gypsum wallboard applied at right angles to each side with 2 1/2" Type S drywall screws 12" o.c. and 1 1/2" Type G drywall screws midway between studs 1 1/2" above and below horizontal joints.

Joints staggered 24" each layer and side. Sound tested with 1 1/2" glass fiber insulation friction fit in stud space. **(NLB)**

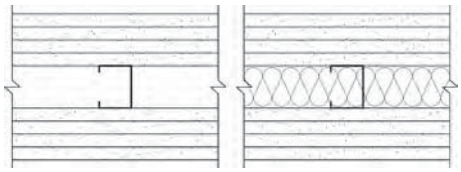

Thickness: 5 5/8"
Approx. Weight: 18 psf
Fire Test: WHI 495-0819, 1-21-87; UL R7094, 10-24-90, UL Design U435
Sound Test: WEAL 87-119, 1-23-87

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	- 1/2" FireBloc® Type C
CertainTeed Gypsum Inc.	- 1/2" CertainTeed® Type C Gypsum Board
CertainTeed Gypsum Canada Inc.	- 1/2" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	- 1/2" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	- 1/2" Firecheck® Type C
PABCO Gypsum	- 1/2" FLAME CURB® Super 'C'™
Temple-Inland	- 1/2" TG-C

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 2963

PROPRIETARY*

4 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. **Second** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 12" o.c. **Third** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 2" Type S drywall screws 12" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to studs with 2 5/8" Type S drywall screws 12" o.c. and 1 1/2" Type G drywall screws 24" o.c. midway between studs and 1 1/4" above and below horizontal joints.

Joints staggered 24" each layer and side. Sound tested with 1 1/2" thick mineral fiber insulation in stud space. **(NLB)**

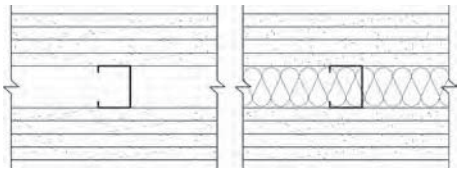

Thickness: 5 5/8"
Approx. Weight: 19 psf
Fire Test: ULC 85T381, 11-14-85, ULC Design W418
Sound Test: NRCC 1074-NV, 6-18-86

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Canada Inc. - 1/2" CertainTeed® Type C Gypsum Board

GA FILE NO. WP 2964

PROPRIETARY*

4 HOUR FIRE | **55 to 59 FSTC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION

Base layer 3/4" proprietary type X gypsum wallboard applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1 1/4" Type S drywall screws 24" o.c. **Face** layer 3/4" proprietary type X gypsum wallboard on each side applied parallel or at right angles to each side with 2 1/4" long Type S drywall screws 12" o.c. and 1 1/2" Type G drywall screws midway between studs along horizontal joints. 2" proprietary mineral fiber insulation batts, 2.0 pcf, in stud space.

Joints staggered 24" each layer and side. **(NLB)**



Thickness: 5 1/2"
Approx. Weight: 11 psf
Fire Test: UL R1319, 91NK16132, 11-18-91, UL Design U490
Field Sound Test: SA-910907, 9-6-91

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 3/4" SHEETROCK® Brand ULTRACODE® Core Gypsum Panels

GA FILE NO. WP 2965

PROPRIETARY*

4 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. Joints staggered 24" on opposite sides. **Second** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 24" o.c. **Third** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 2 5/8" Type S drywall screws 12" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with 3" Type S drywall screws 12" o.c. Screws offset 6" from preceding layer. Joints staggered 24" on opposite siodes and between layers.

Sound tested with 1 5/8" glass fiber insulation friction fit in stud space. **(NLB)**

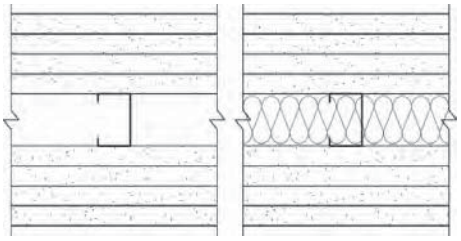

Thickness: 6 5/8"
Approx. Weight: 19 psf
Fire Test: UL R3501, 03NK13364, 1-27-04, UL Design V438
Sound Test: NGC 2634, 7-20-83

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 2966 | **PROPRIETARY*** | **4 HOUR FIRE** | **55 to 59 FSTC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Second** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side with 1 5/8" Type S drywall screws 24" o.c. **Third** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side with 2 5/8" Type S drywall screws 24" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side with 3" Type S drywall screws 12" o.c. Screws in each layer offset 6" from screws in preceding layer.

Vertical Joints staggered 24" each layer and side. Horizontal joints need not be staggered.

Sound tested with 2 1/2" glass fiber insulation friction fit in stud space. **(NLB)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type X

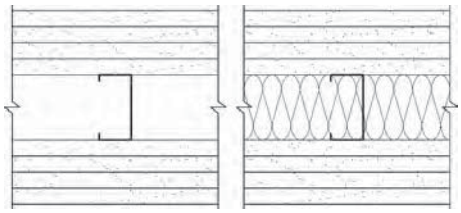

Thickness: 7 1/2"
Approx. Weight: 19 psf
Fire Test: UL R14196, 09CA11604 2-13-10, UL Design V486, system H
Sound Test: RAL TL10-277, 8-18-10

GA FILE NO. WP 2970 | **PROPRIETARY*** | **4 HOUR FIRE** | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 48" o.c. at studs and 24" o.c. at floor and ceiling runners. Joints staggered 24" on opposite sides. **Second** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 12" o.c. Joints aligned with base layer joints. **Third** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 2 1/4" Type S drywall screws 30" o.c. and 1 1/2" Type G drywall screws 12" o.c. spaced 1 1/2" from vertical joints. Vertical joints offset 8" from studs and staggered 24" on opposite sides. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 2 5/8" Type S drywall screws 12" o.c. and 1 1/2" Type G drywall screws midway between studs 1 1/2" above and below horizontal joints. Joints offset 24" from third layer joints. **(NLB)**

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

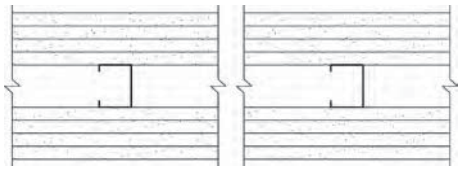

Thickness: 5 5/8"
Approx. Weight: 19 psf
Fire Test: UL R3501, 92NK28896, 9-15-93, UL Design U435; WHI-694-108.1, 6-28-83
Sound Test: NGC 2633, 7-18-83

GA FILE NO. WP 2995 | **PROPRIETARY*** | **4 HOUR FIRE**

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION

Base layer 3/4" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to 3 1/2" 20 ga steel studs 16" or 24" o.c. with 1 1/4" Type S-12 drywall screws 24" o.c. **Face** layer 3/4" proprietary type X gypsum wallboard or veneer base applied parallel or at right angles to studs with 2 1/4" Type S-12 drywall screws 12" o.c. and 1 1/2" Type G drywall screws located midway between studs and 1" from gypsum board edges at horizontal joints. 3" mineral fiber insulation, 3.0 pcf, friction fit in stud space.

Vertical joints staggered one stud cavity each layer and side, horizontal joints staggered 12" each layer and side. **(LOAD-BEARING)**

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 3/4" SHEETROCK® Brand ULTRACODE® Core Gypsum Panels



Thickness: 6 1/2"
Approx. Weight: 14 psf
Fire Test: UL R1319, 98NK36210, 2-24-99, UL Design U490

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, NONCOMBUSTIBLE

GA FILE NO. WP 2996 | **PROPRIETARY*** | **4 HOUR FIRE**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" proprietary type X gypsum wallboard applied parallel or at right angles to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 48" o.c. at studs and 24" o.c. at top and bottom runner. **Second** layer 1/2" proprietary type X gypsum wallboard applied parallel or at right angles with 1 5/8" Type S drywall screws 12" o.c. **Third** layer 1/2" proprietary type X gypsum wallboard applied parallel or at right angles with 2 1/4" Type S drywall screws 12" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard applied parallel or at right angles with 2 5/8" Type S drywall screws 12" o.c.

Vertical joints staggered 24" on each layer and side. Horizontal joints need not be staggered. **(NLB)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	1/2" FireBloc® Type C
Temple-Inland	-	1/2" TG-C



Thickness: 5 5/8"
Approx. Weight: 19 psf
Fire Test: UL R14196, 09CA11604, 2-13-10, UL Design V489, System G

This Space Left Blank

Contact the manufacturer for more detailed information on proprietary products.

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3005 | PROPRIETARY* | 1/2 HOUR FIRE | 50 to 54 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 2 x 4 wood studs 16" o.c. with 1 5/8" Type S drywall screws 12" o.c. Vertical joints centered over studs and staggered one stud cavity on opposite sides. Horizontal joints need not be staggered or backed. **(LOAD-BEARING)**

Sound tested with resilient channels on one side, 3 1/2" glass fiber insulation and a double layer of 5/8" proprietary type X gypsum wallboardapplied with screws spaced 12 o.c.

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® 30

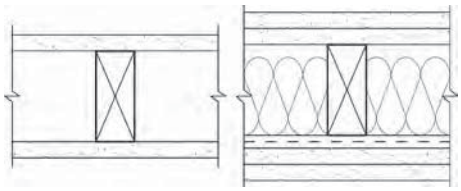

Thickness: 4 3/4" (Fire)
6 1/4" (Sound)
Approx. Weight: 7 psf
Fire Test: UL R1319. 11NK03873, 4-15-11, UL Design U407
Sound Test: RAL TL11-132, 5-23-11

GA FILE NO. WP 3010 | GENERIC | 1 HOUR FIRE | 60 to 64 STC SOUND

GYPSUM WALLBOARD, RESILIENT CHANNELS, GLASS FIBER INSULATION, WOOD STUDS

Resilient channels 24" o.c. attached at right angles to ONE SIDE of 2 x 4 wood studs 16" o.c. with 1" Type S drywall screws. **Base** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1" Type S drywall screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 3/4" daubs of adhesive 12" o.c. vertically and horizontally.

OPPOSITE SIDE: **Base** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to studs with 5d coated nails, 1 5/8" long, 0.086" shank, 15/64" heads, 32" o.c. **Second** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to studs with 8d coated nails, 2 3/8" long, 0.113" shank, 9/32" heads, 12" o.c. **Face** layer 3/8" regular gypsum wallboard applied parallel to studs with 3/4" daubs of adhesive 12" o.c. vertically and horizontally. 2" glass fiber insulation, 0.90 pcf, stapled to three layer side in stud space.

Joints staggered 16" each layer and side. **(LOAD-BEARING)**

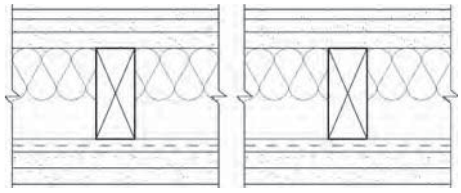

Thickness: 6 7/8"
Approx. Weight: 12 psf
Fire Test: UL R3660-2, 12-3-68, UL Design U313
Sound Test: RAL TL69-117, 12-16-68

GA FILE NO. WP 3110 | GENERIC | 1 HOUR FIRE | 55 to 59 STC SOUND

GYPSUM WALLBOARD, RESILIENT CHANNELS, GLASS FIBER INSULATION, WOOD STUDS

Resilient channels 24" o.c. attached at right angles to ONE SIDE of 2 x 4 wood studs 16" o.c. with 1" Type S drywall screws. **Base** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1" Type S drywall screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 3/4" daubs of adhesive 12" o.c. vertically and horizontally.

OPPOSITE SIDE: **Base** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to studs with 5d coated nails, 1 5/8" long, 0.086" shank, 15/64" heads, 32" o.c. **Second** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to studs with 8d coated nails, 2 3/8" long, 0.113" shank, 9/32" heads, 12" o.c. **Face** layer 1/4" regular gypsum wallboard applied parallel to studs with 3/4" daubs of adhesive 12" o.c. vertically and horizontally. 2" glass fiber insulation, 0.90 pcf, stapled to three layer side in stud space.

Joints staggered 16" each layer and side. **(LOAD-BEARING)**

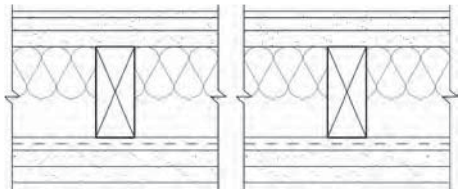

Thickness: 6 3/4"
Approx. Weight: 2 psf
Fire Test: UL R3660-2, 12-3-68, UL Design U313
Sound Test: RAL TL69-286, 6-20-68 (Rev. 9-4-68)

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3239

PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 2 x 4 wood studs 16" o.c. with 1 7/8" long, 6d cement coated nails 7" o.c. Vertical joints centered over studs and staggered one stud cavity on opposite sides. Horizontal joints on opposite sides need not be staggered or backed. **(LOAD-BEARING)**

Sound tested with resilient channels 16" o.c. on ONE SIDE, 3 1/2" glass fiber insulation and a double layer of 5/8" proprietary type X gypsum wallboard applied to resilient channels with screws spaced 12 o.c.

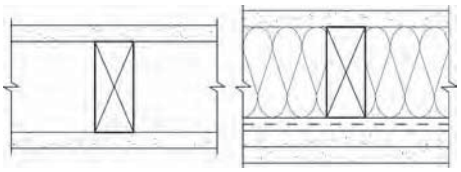

Thickness: 4 3/4" (Fire)
5 5/8" (Sound)
Approx. Weight: 7 psf
Fire Test: UL R1319. 10CA37600, 12-3-10, UL Design U327
Sound Test: RAL TL11-174, 5-23-11

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® X

GA FILE NO. WP 3240

PROPRIETARY*

1 HOUR FIRE | **50 to 54 FSTC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, MINERAL FIBER INSULATION, WOOD STUDS

Resilient channels 24" o.c. attached at right angles to ONE SIDE of 2 x 4 wood studs 16" or 24" o.c. with 1 1/4" Type S drywall screws. One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to channels with 1" Type S drywall screws 12" o.c. End joints backblocked with resilient channels. 3" mineral fiber insulation, 2.0 or 2.3 pcf, in stud space.

OPPOSITE SIDE: One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to studs with 1 1/4" Type W drywall screws 12" o.c.

Vertical joints staggered 48"on opposite sides. Sound tested with studs 16" o.c. and open face of mineral fiber insulation blankets toward resilient channel-side of stud space. **(LOAD-BEARING)**

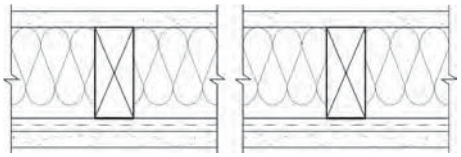

Thickness: 5 1/4"
Approx. Weight: 7 psf
Fire Test: UL R1319-93, 94, 129; 8-10-66; UL Design U311; ULC Design U311
Field Sound Test: BBN 760903, 9-17-76

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

GA FILE NO. WP 3241

PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, MINERAL FIBER INSULATION, WOOD STUDS

Resilient channels 24" o.c. attached at right angles to ONE SIDE of 2 x 4 wood studs 16" or 24" o.c. with 1 1/4" Type S drywall screws. One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to channels with 1" Type S drywall screws 12" o.c. End joints backblocked with resilient channels. 3" mineral fiber insulation, 2.0 or 2.3 pcf, in stud space.

OPPOSITE SIDE: One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to studs with 1 1/4" Type W drywall screws 12" o.c.

Vertical joints staggered 48" on opposite sides. Sound tested with studs 16" o.c. and open face of mineral fiber insulation blankets toward resilient channel-side of stud space. **(LOAD-BEARING)**

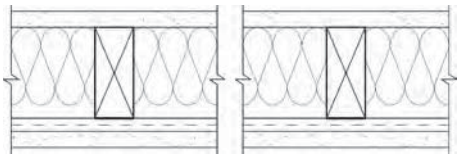

Thickness: 5 1/4"
Approx. Weight: 7 psf
Fire Test: Based on UL R3660-7, 11-12-87; UL R2717-61, 8-18-87; UL Design U311
Sound Test: Estimated

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type C Gypsum Board
CertainTeed Gypsum Canada Inc.	-	5/8" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	5/8" Firecheck® Type C
National Gypsum Company	-	5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	5/8" FLAME CURB® Super 'C'™
Temple-Inland	-	5/8" TG-C

Contact the manufacturer for more detailed information on proprietary products.

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3242 | **GENERIC** | **1 HOUR FIRE** | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, MINERAL OR GLASS FIBER INSULATION, WOOD STUDS

Resilient channels 16" o.c. attached at right angles to ONE SIDE of 2 x 4 wood studs 24" o.c. with 1¼" Type S drywall screws. One layer ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1" Type S drywall screws 8" o.c. with vertical joints located midway between studs. 3" mineral or glass fiber insulation in stud space.

OPPOSITE SIDE: One layer ⅝" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 6d cement coated nails, 1⅞" long, 0.0915" shank, 15/64" heads, 7" o.c.

Vertical joints staggered 24" on opposite sides. **(LOAD-BEARING)**



Thickness: 5⅜"
Approx. Weight: 7 psf
Fire Test: Based on UL R14196, 05NK05371, 2-15-05, UL Design U309
Sound Test: NRCC TL-93-098, IRC-IR-761, 3/98

GA FILE NO. WP 3243 | **GENERIC** | **1 HOUR FIRE** | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, MINERAL OR GLASS FIBER INSULATION, WOOD STUDS

Resilient channels 24" o.c. attached at right angles to ONE SIDE of 2 x 4 wood studs 24" o.c. with 1¼" Type S drywall screws. One layer ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1" Type S drywall screws 8" o.c. with vertical joints located midway between studs. 3" mineral or glass fiber insulation in stud space.

OPPOSITE SIDE: One layer ⅝" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 6d cement coated nails, 1⅞" long, 0.0915" shank, 15/64" heads, 7" o.c.

Vertical joints staggered 24" on opposite sides. **(LOAD-BEARING)**



Thickness: 5⅜"
Approx. Weight: 7 psf
Fire Test: Based on UL R14196, 05NK05371, 2-15-05, UL Design U309
Sound Test: NRCC TL-93-103, IRC-IR-761, 3/98

GA FILE NO. WP 3244 | **GENERIC** | **1 HOUR FIRE** | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, MINERAL OR GLASS FIBER INSULATION, WOOD STUDS

Resilient channels 16" o.c. attached at right angles to ONE SIDE of 2 x 4 wood studs 16" o.c. with 1¼" Type S drywall screws. **Base** layer ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1" Type S drywall screws 8" o.c. with vertical joints located midway between studs. **Face** layer ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1⅝" Type S drywall screws 8" o.c. Face layer joints offset 16" from base layer joints. 3" mineral or glass fiber insulation in stud space.

OPPOSITE SIDE: One layer ⅝" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 6d cement coated nails, 1⅞" long, 0.0915" shank, 15/64" heads, 7" o.c.

Vertical joints staggered 16" on opposite sides. **(LOAD-BEARING)**

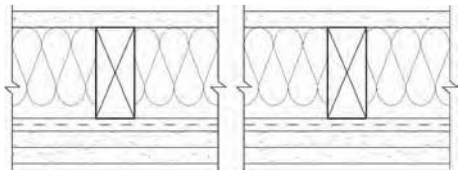

Thickness: 6"
Approx. Weight: 9 psf
Fire Test: Based on UL R14196, 05NK05371, 2-15-05, UL Design U305
Sound Test: NRCC TL-93-118, IRC-IR-761, 3/98

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3245 — GENERIC

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, MINERAL OR GLASS FIBER INSULATION, WOOD STUDS

Resilient channels 24" o.c. attached at right angles to ONE SIDE of 2 x 4 wood studs 16" o.c. with 1¼" Type S drywall screws. One layer ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1" Type S drywall screws 8" o.c. with vertical joints located midway between studs. 3" mineral or glass fiber insulation in stud space.

OPPOSITE SIDE: **Base** layer ⅝" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 6d cement coated nails, 1⅞" long, 0.0915" shank, 15/64" heads, 7" o.c. **Face** layer ⅝" type X gypsum wallboard or gypsum veneer base applied at parallel or at right angles to studs with 8d cement coated nails, 2⅜" long, 8" o.c. Face layer joints offset 16" from base layer joints.

Vertical joints staggered 16" on opposite sides. **(LOAD-BEARING)**

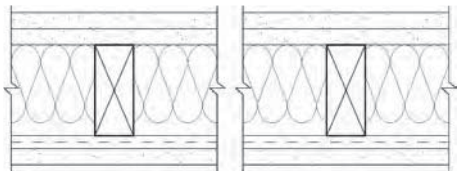

Thickness: 6"
Approx. Weight: 9 psf
Fire Test: Based on UL R14196, 05NK05371, 2-15-05, UL Design U305
Sound Test: NRCC TL-93-116, IRC-IR-761, 3/98

GA FILE NO. WP 3246 — PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, GYPSUM PANEL PRODUCT, WOOD STUDS

One layer ⅝" proprietary gypsum board applied parallel to ONE SIDE of 2 x 4 wood studs 24" o.c. with 6d coated nails, 1⅞" long, 0.0915" shank, ¼" heads, 7" o.c.

OPPOSITE SIDE: One layer ⅝" proprietary gypsum panel product applied parallel to studs with 6d coated nails, 1⅞" long, 0.0915" shank, ¼" heads, 7" o.c.

Joints staggered 24" on opposite sides. Sound tested with 3½" glass fiber insulation friction fit in stud space. **(LOAD-BEARING)**

PROPRIETARY GYPSUM PANEL PRODUCT

CertainTeed Gypsum Inc.	-	⅝" CertainTeed® Type X Gypsum Board
	-	⅝" SilentFX™



Thickness: 4¾"
Approx. Weight: 7 psf
Fire Test: UL R3660, 10CA25812, 8-17-10, UL Design U309
Sound Test: OL 11-0616, 6-20-11

GA FILE NO. WP 3247 — GENERIC

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, MINERAL OR GLASS FIBER INSULATION, WOOD STUDS

Resilient channels 24" o.c. attached at right angles to ONE SIDE of 2 x 4 wood studs 16" o.c. with 1¼" Type S drywall screws. **Base** layer ⅝" type X gypsum wallboard applied parallel to channels with 1" Type S drywall screws 8" o.c. **Face** layer ⅝" type X gypsum wallboard applied at right angles to channels with 1⅝" Type S drywall screws 8" o.c. Face layer joints offset 24" from base layer joints.

OPPOSITE SIDE: One layer ⅝" type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1¼" drywall screws 8" o.c.

Vertical joints staggered on opposite sides.

Sound tested with 3½" glass fiber insulation in stud space. **(LOAD-BEARING)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	⅝" FireBloc® Type X

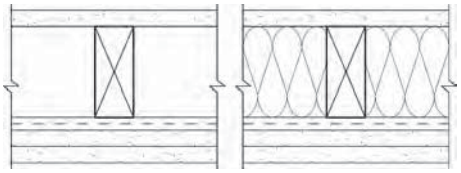

Thickness: 5⅜"
Approx. Weight: 9 psf
Fire Test: UL R14196, 05NK05371, 2-15-05, UL Design U305
Sound Test: RAL TL11-163, 7-12-11

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3251 | **PROPRIETARY*** | **1 HOUR FIRE** | **50 to 54 STC SOUND**

GYPSUM PANEL PRODUCT, WOOD STUDS

One layer 5/8" proprietary paper faced or glass mat faced gypsum panel product (sound board) applied parallel to ONE SIDE of 2 x 4 wood studs 24" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

OPPOSITE SIDE: One layer 5/8" proprietary paper faced or glass mat faced gypsum panel product applied parallel to studs with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Joints staggered 24" on opposite sides. Sound tested with 3 1/2" glass fiber insulation friction fit in stud space. **(LOAD-BEARING)**

PROPRIETARY GYPSUM PANEL PRODUCT

Temple-Inland - 5/8" ComfortGuard Sound Deadening Gypsum Board
- 5/8" Type X



Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: UL R6937, 06NK17962, 2-17-07; 09NK05706, 4-13-09; UL Design U309
Sound Test: OL 08-0910, 9-4-08

GA FILE NO. WP 3260 | **PROPRIETARY*** | **1 HOUR FIRE** | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, GLASS FIBER INSULATION, WOOD STUDS

Base layer 1/4" proprietary gypsum wallboard applied parallel to each side of 2 x 4 wood studs 16" o.c. with 4d coated nails, 1 1/2" long, 0.099" shank, 1/4" heads, 12" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 6" wide strips of laminating compound along the edges and centerline of each board and 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 16" o.c. at top and bottom plates only. 1 1/2" glass fiber insulation, 0.8 pcf, in stud space.

Joints staggered 16" each layer and side. **(LOAD-BEARING)**

PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC - 1/4" ToughRock® Sound Deadening Gypsum Board
- 5/8" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc. - 1/4" Soundcheck®
- 5/8" Firecheck® Type C
National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board



Thickness: 5 3/8"
Approx. Weight: 9 psf
Fire Test: See WP 3340 (UL R2717-52, 9-9-68, UL Design U312; ULC Design W300)
Sound Test: G&H BW-35ST, 4-16-69

GA FILE NO. WP 3261 | **PROPRIETARY*** | **1 HOUR FIRE** | **50 to 54 STC SOUND**

GYPSUM PANEL PRODUCT, WOOD STUDS

One layer 5/8" proprietary type X paper faced or glass mat faced gypsum panel product (sound board) applied parallel to each side of 2 x 4 wood studs 24" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Joints staggered 24" on opposite sides. Sound tested with 3 1/2" glass fiber insulation friction fit in stud space. **(LOAD-BEARING)**

PROPRIETARY GYPSUM PANEL PRODUCT

Temple-Inland - 5/8" Type X ComfortGuard Sound Deadening Gypsum Board



Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: UL R6937, 06NK17962, 2-17-07; 09NK05706, 4-13-09; UL Design U309
Sound Test: OL 11-0608, 6-15-11

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3330 — GENERIC — 1 HOUR FIRE — 45 to 49 STC SOUND

GYPSUM WALLBOARD, WOOD FIBERBOARD, WOOD STUDS

Base layer 1/2" wood fiberboard, 0.82 psf, applied parallel to each side of 2 x 4 wood studs 16" o.c. with 5d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 24" o.c. at vertical joints and intermediate studs and 16" o.c. at top and bottom plates. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 6" wide strips of 1/2" thick beads of laminating adhesive along the perimeter and centerline of each board and 8d coated nails, 2 1/2" long, 0.131" shank, 9/32" heads, 12" o.c. to top and bottom plates, 24" o.c. at vertical joints, and at third-points at intermediate studs.

Joints staggered 24" each layer and side. **(LOAD-BEARING)**

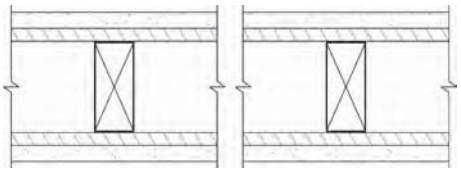

Thickness: 5 7/8"
Approx. Weight: 8 psf
Fire Test: OSU T-3054, 4-3-65
Sound Test: OR 64-73, 9-23-64

GA FILE NO. WP 3340 — PROPRIETARY* — 1 HOUR FIRE — 45 to 49 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

Base layer 1/4" proprietary gypsum wallboard applied parallel to each side of 2 x 4 wood studs 16" o.c. with 4d coated nails, 1 1/2" long, 0.099" shank, 1/4" heads, 12" o.c. Joints staggered 16" on opposite sides. **Face** layer 1/2" proprietary type X plain or predecorated gypsum wallboard or gypsum veneer base applied parallel to each side with 1/2" beads of adhesive 16" o.c. and 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 6" o.c. at top and bottom plates only. Joints offset 24" from base layer joints. **(LOAD-BEARING)**

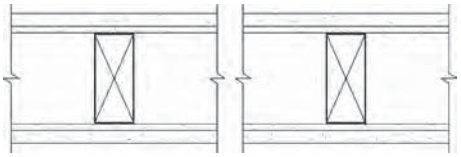

Thickness: 5 1/8"
Approx. Weight: 8 psf
Fire Test: UL R2717-52, 9-9-68, UL Design U312; ULC Design W300
Sound Test: G&H BW-27FT, 7-13-67

PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC	-	1/4" ToughRock® Sound Deadening Gypsum Board
	-	1/2" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	1/4" Soundcheck®
	-	1/2" Firecheck® Type C
National Gypsum Company	-	1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
Temple-Inland	-	1/4" Temple-4 Sound Deadening Board
	-	1/2" TG-C

GA FILE NO. WP 3341 — GENERIC — 1 HOUR FIRE — 45 to 49 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

Base layer 1/4" gypsum wallboard applied parallel to each side of 2 x 4 wood studs 16" o.c. with 4d coated nails, 1 1/2" long, 0.099" shank, 1/4" heads, 12" o.c. Joints staggered 16" on opposite sides. **Face** layer 1/2" type X plain or predecorated gypsum wallboard or gypsum veneer base applied parallel to each side with 1/4" beads of adhesive 2" o.c. and 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 6" o.c. at top and bottom plates only. Offset joints 24" from base layer joints. **(LOAD-BEARING)**



Thickness: 5 1/8"
Approx. Weight: 7 psf
Fire Test: FM WP-147, 1-2-69
Sound Test: NGC 2321, 8-29-68

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3343 | PROPRIETARY* | 1 HOUR FIRE | 45 to 49 STC SOUND

GYPSUM PANEL PRODUCT, WOOD STUDS

One layer 5/8" proprietary gypsum panel product applied parallel to each side of 2 x 4 wood studs 16" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Joints staggered 16" on opposite sides. Sound tested with 3 1/2" glass fiber insulation friction fit in stud space. **(LOAD-BEARING)**

PROPRIETARY GYPSUM PANEL PRODUCT

Temple-Inland - 5/8" Type X ComfortGuard Sound Deadening Gypsum Board



Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: UL R6937, 08NK14525, 11-10-08, UL Design U309
Sound Test: OL 08-0905, 9-3-08

GA FILE NO. WP 3344 | PROPRIETARY* | 1 HOUR FIRE | 45 to 49 STC SOUND

GYPSUM PANEL PRODUCT, WOOD STUDS

One layer 5/8" proprietary paper faced or glass mat faced gypsum panel product (sound board) applied parallel to ONE SIDE of 2 x 4 wood studs 16" o.c. with 1 1/4" Type W drywall screws 8" o.c.

OPPOSITE SIDE: One layer 5/8" proprietary paper faced or glass mat faced gypsum panel product applied parallel to studs with 1 1/4" Type W drywall screws 8" o.c.

Joints staggered 16" on opposite sides. Sound tested with screws spaced 12" o.c. and with 3 1/2" glass fiber insulation friction fit in stud space. **(LOAD-BEARING)**

PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland - 5/8" Type X ComfortGuard Sound Deadening Gypsum Board
- 5/8" Type X



Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: UL R6937, 06NK17962, 2-17-07; 09NK05706, 4-13-09; UL Design U305
Sound Test: OL 08-0907, 9-3-08

GA FILE NO. WP 3360 | GENERIC | 1 HOUR FIRE | 45 to 49 FSTC SOUND

GYPSUM WALLBOARD, WOOD STUDS

Base layer 3/8" gypsum wallboard or gypsum veneer base applied parallel to each side of 2 x 4 wood studs 16" o.c. with 5d coated nails, 1 3/4" long, 0.082" shank, 7/32" heads, 12" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 6" wide strips of laminating compound combed along edges and intermediate studs and 6d finish nails, 2" long, 0.0915" shank, 0.135" heads driven at 45° angle 24" o.c. at intermediate studs.

Joints staggered 16" o.c. each layer and side. **(LOAD-BEARING)**



Thickness: 5 5/8"
Approx. Weight: 8 psf
Fire Test: UC, 2-4-65
Field Sound Test: ACI 7-1152004a, 12-21-64

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3370 | GENERIC | 1 HOUR FIRE | 45 to 49 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of double row of 2 x 4 wood studs 16" o.c. on separate plates 1" apart with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Joints staggered 16" on opposite sides. Horizontal bracing required at mid-height. **(LOAD-BEARING)**

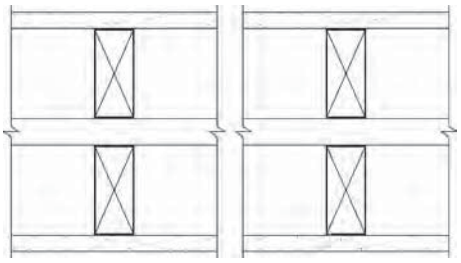

Thickness: 9½"
Approx. Weight: 8 psf
Fire Test: See WP 3605 (UL R1319-4, 6, 6-17-52; UL R2717-39, 1-20-66; UL R3501-52, 3-15-66, UL Design U305; ULC Design W301); UL R4024, 10-31-68
Sound Test: NRCC TL-93-261, IRC-IR-761, 3/98

GA FILE NO. WP 3380 | GENERIC | 1 HOUR FIRE | 40 to 44 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 2 x 4 wood studs 16" o.c. staggered 8" o.c. on 2 x 6 wood plates with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Joints staggered 24" on opposite sides. Horizontal bracing required at mid-height. **(LOAD-BEARING)**

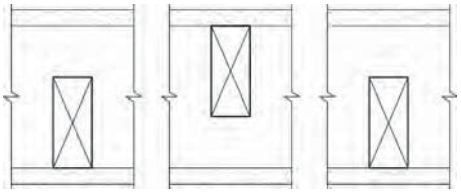

Thickness: 7 3/4"
Approx. Weight: 8 psf
Fire Test: See WP 3605 (UL R1319-4, -6, 6-17-52; UL R2717-39, 1-20-66; UL R3501-52, 3-15-66, UL Design U305; ULC Design W301); UL R4024, 10-31-68
Sound Test: NRCC TL-93-254, IRC-IR-761, 3/98

GA FILE NO. WP 3430 | GENERIC | 1 HOUR FIRE | 40 to 44 STC SOUND

GYPSUM LATH, GYPSUM PLASTER, WOOD STUDS

1/2" 1:2 gypsum-sand plaster applied over 3/8" plain gypsum lath applied at right angles to each side of 2 x 4 wood studs 16" o.c. with 13 ga blued lath nails, 1 1/8" long, 0.0915" shank, 19/64" heads, 4" o.c. **(LOAD-BEARING)**



Thickness: 5 3/8"
Approx. Weight: 15 psf
Fire Test: OSU T-948, 7-17-58; OSU T-1380, 7-5-60
Sound Test: RAL TL58-60, 8-7-58

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3431 | GENERIC | 1 HOUR FIRE | 40 to 44 STC SOUND

GYPSUM LATH, GYPSUM PLASTER, WOOD STUDS

1/2" 1:2 gypsum-sand plaster applied over 3/8" type X gypsum lath applied at right angles to each side of 2 x 4 wood studs 16" o.c. with 13 ga blued lath nails, 1 1/8 " long, 0.0915" shank, 19/64" heads, 5" o.c. **(LOAD-BEARING)**



Thickness: 5 3/8"
Approx. Weight: 15 psf
Fire Test: OSU T-1488, 12-60
Sound Test: RAL TL58-60, 8-7-58

GA FILE NO. WP 3436 | GENERIC | 1 HOUR FIRE | 40 to 44 STC SOUND

GYPSUM LATH, GYPSUM PLASTER, RESILIENT CHANNELS, WOOD STUDS

Resilient channels 16" o.c. attached at right angles to each side of 2 x 4 wood studs 16" o.c. with 5d coated nails, 1 5/8" long, 0.072" shank, 7/32" heads. 1/2" x 3" strips of gypsum wallboard applied on each side at top plate and at mid-height with 5d nails. 1/2" 1:2 or 1:3 gypsum-sand plaster applied over 3/8" type X gypsum lath attached at right angles to channels with 3/4" Type S drywall screws, 3 per lath at each channel, and 5d coated nails, 1 5/8" long, 0.072" shank, 7/32" heads, 3 per lath at top plate.

Horizontal joints staggered 16" and vertical joints 6" on opposite sides. **(LOAD-BEARING)**

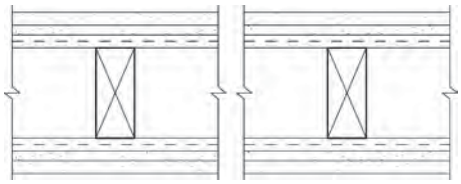

Thickness: 5 7/8"
Approx. Weight: 15 psf
Fire Test: UC, 2-15-66
Sound Test: RAL TL66-299, 8-24-66

GA FILE NO. WP 3441 | PROPRIETARY* | 1 HOUR FIRE | 40 to 44 FSTC SOUND

GYPSUM WALLBOARD, MINERAL FIBER INSULATION, CEMENTITIOUS BACKER UNIT, CERAMIC TILE, WOOD STUDS

One layer 1/2" thick proprietary cementitious backer unit applied parallel or at right angles to 2 x 4 wood studs 16" o.c. with 1 1/2" galvanized roofing nails or 1 5/8" wafer head screws 8" o.c. Ceramic tile, 1/4" thick, joints grouted, installed with latex-modified portland cement mortar or ANSI A136.1 Type I organic adhesive. 3 1/2" mineral fiber insulation, 2.0 pcf, friction fit in stud space.

OPPOSITE SIDE: One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 6d cement coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c. As an alternate, one layer 1/2" thick proprietary cementitious backer unit applied with 1 1/2" galvanized roofing nails or 1 5/8" wafer head screws 8" o.c. and faced with ceramic tile. (FSTC 37 when alternate is used.) **(LOAD-BEARING)**

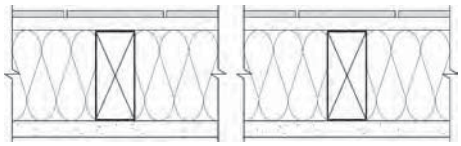

Thickness: 5 1/8"
Approx. Weight: 13 psf
Fire Test: UL R11270, 4-19-85, UL Design U329
Field Sound Test: USG 840314, 3-12-84; USG 840404, 4-4-84

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® Type X
Lafarge North America Inc.	-	5/8" Firecheck® Type X
Temple-Inland	-	5/8" Type X
United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3510 | GENERIC | 1 HOUR FIRE | 35 to 39 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 2 x 4 wood studs 24" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Joints staggered 24" on opposite sides. **(LOAD-BEARING)**

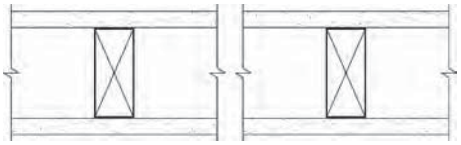

Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: UL R3501-47, -48, 9-17-65, UL Design U309; UL R1319-129, 7-22-70, UL Design U314
Sound Test: NGC 2404, 10-14-70

GA FILE NO. WP 3520 | GENERIC | 1 HOUR FIRE | 35 to 39 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" type X plain or predecorated gypsum wallboard applied parallel to each side of 2 x 4 wood studs 24" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c. at joints and top and bottom plates and 3/8" beads of adhesive at intermediate studs.

Joints staggered 24" on opposite sides. **(LOAD-BEARING)**

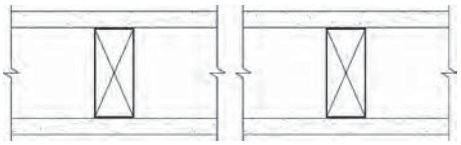

Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: FM WP 90, 8-21-67
Sound Test: G&H NG-246FT, 7-2-65

GA FILE NO. WP 3605 | GENERIC | 1 HOUR FIRE | 30 to 34 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" type X plain or predecorated gypsum wallboard, water-resistant gypsum backing board, or gypsum veneer base applied parallel or at right angles to each side of 2 x 4 wood studs 16" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c. Joints of square edge, bevel edge or predecorated wallboard may be left exposed.

Joints staggered 16" on opposite sides. **(LOAD-BEARING)**

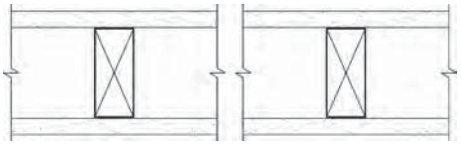

Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: UL R1319-4, -6, 6-17-52; UL R2717-39, 1-20-66; UL R3501-52, 3-15-66, UL Design U305; ULC Design W301
Sound Test: OR 64-8, 2-4-64

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3614 | GENERIC | 1 HOUR FIRE | 30 to 34 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 2 x 4 wood studs 16" o.c. with 1 1/4" Type W drywall screws 12" o.c.

Joints staggered 16" on opposite sides. **(LOAD-BEARING)**

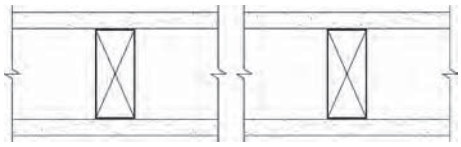

Thickness: 4 3/4"
Approx. Weight: 7 psf
Fire Test: SWRI 01-4511-619[1], 3-94
Sound Test: See WP 3520 (G&H NG-246FT, 7-2-65)

GA FILE NO. WP 3615 | PROPRIETARY* | 1 HOUR FIRE | 30 to 34 STC SOUND

GLASS MAT GYPSUM SUBSTRATE, WOOD STUDS

One layer 5/8" proprietary type X glass mat water-resistant gypsum backing board applied parallel or at right angles to each side of 2 x 4 wood studs 16" o.c. with phosphate coated nails, 1 7/8" long, 1/4" diameter cupped heads, 8" o.c.

Joints staggered 16" on opposite sides and covered with 10x10 mesh glass tape and tile adhesive. **(LOAD-BEARING)**

PROPRIETARY GYPSUM PANEL PRODUCT

Georgia Pacific Gypsum LLC - 5/8" DensShield® Fireguard® Tile Backer

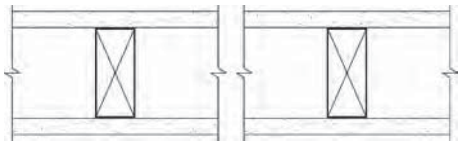

Thickness: 4 3/4"
Approx. Weight: 7 psf
Fire Test: WHI-495-0853, 5-14-87; WHI-495-0854, 5-15-87
Sound Test: See WP 3605 (OR 64-8, 2-4-64)

GA FILE NO. WP 3620 | GENERIC | 1 HOUR FIRE | 30 to 34 STC SOUND

GYPSUM VENEER BASE, GYPSUM VENEER PLASTER, WOOD STUDS

One layer 1/2" type X gypsum veneer base applied at right angles to each side of 2 x 4 wood studs 16" o.c. with 5d etched nails, 1 3/4" long, 0.099" shank, 1/4" heads, 8" o.c. 1/16" gypsum veneer plaster applied over each face.

Vertical joints staggered 16" and horizontal joints 12" on opposite sides. Sound tested without gypsum veneer plaster. **(LOAD-BEARING)**

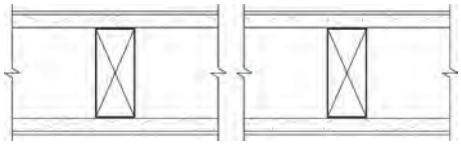

Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: UC, 1-12-66
Sound Test: G&H IBI-35FT, 5-26-64

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3640 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of either 2 x 3 or 2 x 4 wood studs, turned flatwise, 24" o.c. with 6d cement-coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Horizontal joints staggered not less than 12" on opposite sides. **(NLB)**



Thickness: 2 7/8"
Approx. Weight: 7 psf
Fire Test: UL, 9-12-96, UL Design U338

GA FILE NO. WP 3641 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, WOOD STUDS

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of either 2 x 3 or 2 x 4 wood studs, turned flatwise, 24" o.c. with 6d cement-coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with 8d cement-coated nails, 2 3/8" long, 0.113" shank, 9/32" heads, 8" o.c.

Joints offset not less than 12" from base layer joints. **(LOAD-BEARING)**



Thickness: 4 1/8"
Approx. Weight: 12 psf
Fire Test: UL, 9-12-96, UL Design U338

GA FILE NO. WP 3642 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to ONE SIDE of either 2 x 3 or 2 x 4 wood studs, turned flatwise, 24" o.c. with 6d cement-coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Inner layer plywood applied with nails.

Second wall duplicate of first wall and separated by 1" air space. **(NLB)**



Thickness: 5 1/2"
Approx. Weight: 10 psf
Fire Test: UL, 9-12-96, UL Design U339

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3643 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, WOOD STUDS

Base layer 5/8" type X gypsum wallboard applied parallel or at right angles to each side of a double row of either 2 x 3 or 2 x 4 wood studs, turned flatwise, 24" o.c. on separate plates 1" apart with 6d cement-coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c. **Face** layer 5/8" type X gypsum wallboard applied parallel or at right angles to each side with 8d cement-coated nails, 2 3/8" long, 0.113" shank, 9/32" heads, 8" o.c. **(LOAD-BEARING)**

Inner layer plywood applied with nails



Thickness: 6 3/4"
Approx. Weight: 13 psf
Fire Test: UL, 9-12-96, UL Design U339

GA FILE NO. WP 3644 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, WOOD STUDS, MINERAL FIBER INSULATION

One layer 5/8" type X gypsum wallboard applied at right angles to each side of 2 x 4 wood studs 16" o.c. with 2 1/4" Type S or W drywall screws 12" o.c. 3 1/2" mineral fiber insulation, nominal 2.5 pcf, friction fit in stud space.

Vertical joints staggered 16" o.c., horizontal joints staggered 24" o.c., on opposite sides.

Tested at 2,578 lbs per stud or 100 percent of design load. **(LOAD-BEARING)**



Thickness: 4 3/4"
Approx. Weight: 7.5 psf
Fire Test: ITS J20-06170.1, 4-00

GA FILE NO. WP 3645 | PROPRIETARY* | 1 HOUR FIRE

GYPSUM PANEL PRODUCTS, WOOD STUDS

One layer 5/8" thick proprietary type X gypsum board applied parallel or at right angles to ONE SIDE of 2 x 4 wood studs 16" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads 7" o.c.

OPPOSITE SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate applied parallel or at right angles to studs with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Joints staggered 16" on opposite sides. **(LOAD-BEARING)**



Thickness: 4 3/4"
Approx. Weight: 7 psf
Fire Test: UL R6937, 06NK17692, 9-19-08, UL Design U305

PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC	-	5/8" DensArmor Plus® Fireguard® Interior Panel
	-	5/8" ToughRock® Fireguard® Gypsum Board
Temple-Inland	-	5/8" GreenGlass Type X
	-	5/8" Type X

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3646

PROPRIETARY*

1 HOUR FIRE

GYPSUM PANEL PRODUCTS, WOOD STUDS

One layer 5/8" thick proprietary type X gypsum board applied parallel or at right angles to each side of 2 x 4 wood studs 16" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads 7" o.c.

Joints staggered 16" on opposite sides. **(LOAD-BEARING)**

PROPRIETARY GYPSUM PANEL PRODUCTS

CertainTeed Gypsum Inc. - 5/8" AirRenew® Gypsum Board



Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: UL R15187, 02NXK31412, 7-17-02, UL Design U305

GA FILE NO. WP 3660

GENERIC

1 HOUR FIRE

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" type X gypsum wallboard applied at right angles to each side of 2 x 6 wood studs 16" o.c. with 2 1/4" Type S or W drywall screws 7" o.c.

Vertical joints staggered 16" o.c., horizontal joints staggered 24" o.c., on opposite sides.

Tested at 5,156 lbs per stud or 100 percent of design load. **(LOAD-BEARING)**



Thickness: 6 3/4"
Approx. Weight: 8 psf
Fire Test: ITS J99-22441.2, 10-99

GA FILE NO. WP 3661

GENERIC

1 HOUR FIRE

GYPSUM WALLBOARD, WOOD STUDS, MINERAL FIBER INSULATION

One layer 5/8" type X gypsum wallboard applied at right angles to each side of 2 x 6 wood studs 16" o.c. with 2 1/4" Type S or W drywall screws 12" o.c. 5 1/2" mineral fiber insulation, nominal 2.5 pcf, friction fit in stud space.

Vertical joints staggered 16" o.c., horizontal joints staggered 24" o.c., on opposite sides.

Tested at 5,156 lbs per stud or 100 percent of design load. **(LOAD-BEARING)**



Thickness: 6 3/4"
Approx. Weight: 8.5 psf
Fire Test: ITS J99-22441.1, 10-99

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3810 | GENERIC | 2 HOUR FIRE | 55 to 59 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to 2 x 4 wood studs 24" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 16" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles with 8d coated nails, 2 3/8" long, 0.099" shank, 9/32" heads, 8" o.c. Joints offset 24" from base layer joints.

Inner layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to studs with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 8" o.c. Joints in inner layer need not be taped.

Second wall duplicate of first wall and separated by 1" space. Walls independently loaded.

STC 59 with 3 1/2" glass fiber insulation friction fit in stud spaces both sides; STC 57 without glass fiber insulation. **(LOAD-BEARING)**

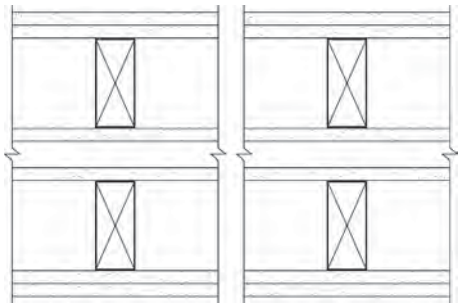

Thickness: 11"
Approx. Weight: 14 psf
Fire Test: FM WP 297, 1-5-73
Sound Test: RAL TL73-215, 7-13-73; RAL TL73-224, 7-30-73

GA FILE NO. WP 3812 | GENERIC | 2 HOUR FIRE | 55 to 59 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to 2 x 4 wood studs 24" o.c. with 6d coated nails, 1 7/8" long, 0.086" shank, 1/4" heads, 16" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to studs over base layer and to top and bottom plates with 8d coated nails, 2 3/8" long, 0.099" shank, 9/32" heads, 8" o.c. Joints offset 24" from base layer joints.

Inner layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 8" o.c. Joints in inner layer need not be taped.

Second wall duplicate of first wall and separated by 1" space. Walls independently loaded. Sound tested with 3 1/2" glass fiber insulation, 0.75 pcf, friction fit in stud spaces. **(LOAD-BEARING)**

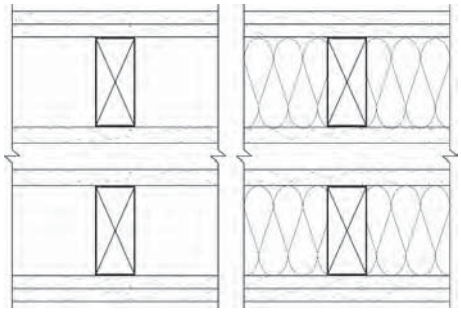

Thickness: 11 1/4"
Approx. Weight: 15 psf
Fire Test: See WP 3810 (FM WP 297, 1-5-73)
Sound Test: Estimated Based on WP 3810 (RAL TL73-215, 7-13-73; RAL TL73-224, 7-30-73)

GA FILE NO. WP 3820 | GENERIC | 2 HOUR FIRE | 55 to 59 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to each side of double row of 2 x 4 wood studs 16" o.c. on separate plates 1" apart with 6d coated nails, 1 7/8" long, 0.085" shank, 1/4" heads, 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 8d coated nails, 2 3/8" long, 0.100" shank, 1/4" heads, 8" o.c.

Joints staggered 16" each layer and side. Sound tested with 3 1/2" glass fiber insulation stapled to studs in stud spaces on one side and with nails for base layer spaced 6" o.c. Horizontal bracing required at mid-height. **(LOAD-BEARING)**

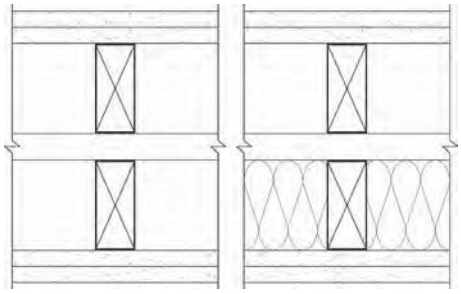

Thickness: 10 3/4"
Approx. Weight: 13 psf
Fire Test: See WP 4135 (FM WP 360, 9-27-74); UL R4024, 10-31-68
Sound Test: NGC 3056, 4-7-70

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 3825

PROPRIETARY*

2 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, WOOD STUDS

Base layer 5/8" type X gypsum wallboard applied at parallel to each side of 2 x 4 wood studs 24" o.c. with 1 1/4" Type S drywall screws 8" o.c. **Face** layer 5/8" type X gypsum wallboard applied parallel to each side with 2" Type S drywall screws 8" o.c.

Joints staggered 24" each layer and side. Sound tested with resilient channels 24" o.c. on one side and and 3 1/2" glass fiber insulation in the stud cavity. **(LOAD-BEARING)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type X

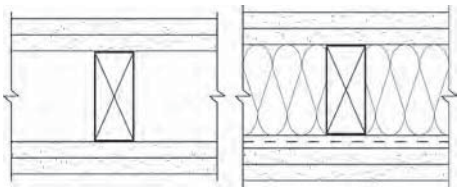

Thickness: 6 1/8"
Approx. Weight: 13 psf
Fire Test: UL R14196, 11NK09957, 7-22-11, UL Design U301
Sound Test: RAL TL11-164, 7-12-11

GA FILE NO. WP 3910

GENERIC

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, WOOD STUDS

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to each side of 2 x 4 wood studs 16" o.c., staggered 8" o.c. on 2 x 6 wood plates, with 6d coated nails, 1 7/8" long, 0.085" shank, 1/4" heads, 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 8d coated nails, 2 3/8" long, 0.113" shank, 9/32" heads, 8" o.c.

Joints staggered 16" each layer and side. Sound tested with nails for base layer spaced 6" o.c. Horizontal bracing required at mid-height. **(LOAD-BEARING)**

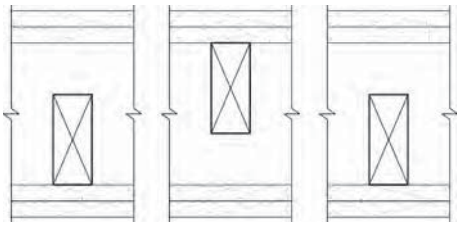

Thickness: 8"
Approx. Weight: 13 psf
Fire Test: See WP 4135 (FM WP 360, 9-27-74); UL R4024, 10-31-68
Sound Test: NGC 2377, 5-19-70

GA FILE NO. WP 4135

GENERIC

2 HOUR FIRE | **40 to 44 STC SOUND**

GYPSUM WALLBOARD, WOOD STUDS

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to each side of 2 x 4 wood studs 24" o.c. with 6d coated nails, 1 7/8" long, 0.085" shank, 1/4" heads, 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 8d coated nails, 2 3/8" long, 0.100" shank, 1/4" heads, 8" o.c.

Joints staggered 24" each layer and side. Sound tested with studs 16" o.c. and with nails for **base** layer spaced 6" o.c. **(LOAD-BEARING)**

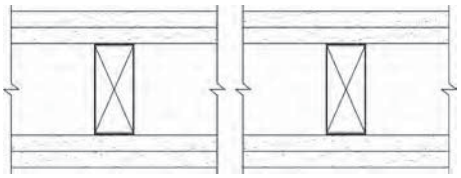

Thickness: 6 1/8"
Approx. Weight: 12 psf
Fire Test: FM WP 360, 9-27-74
Sound Test: NGC 2363, 4-1-70

**Contact the manufacturer for more detailed information on proprietary products.*

WALLS AND INTERIOR PARTITIONS, WOOD FRAMED

GA FILE NO. WP 4136 | **GENERIC** | **2 HOUR FIRE** | **40 to 44 STC SOUND**

GYPSUM WALLBOARD, WOOD STUDS

Base layer 5/8" type X gypsum wallboard or veneer base applied parallel or at right angles to each side of 2 x 4 wood studs 16" o.c. with 1 1/4" Type W drywall screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard or veneer base applied parallel or at right angles to each side with 1 7/8" Type W drywall screws 12" o.c. and offset 6" from screws in base layer.

Joints staggered 16" each layer and side. **(LOAD-BEARING)**

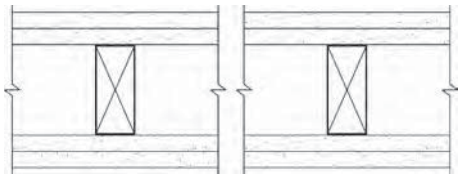

Thickness: 6 1/8"
Approx. Weight: 12 psf
Fire Test: SWRI 01-5920-614, 12-5-94
Sound Test: See WP 4135 (NGC 2363, 4-1-70)

GA FILE NO. WP 4230 | **GENERIC** | **2 HOUR FIRE**

GYPSUM WALLBOARD, WOOD STUDS, MINERAL FIBER INSULATION

Base layer 5/8" type X gypsum wallboard applied at right angles to each side of 2 x 6 wood studs 24" o.c. with 2 1/4" Type S or W drywall screws 24" o.c. **Face** layer 5/8" type X gypsum wallboard applied at right angles to each side with 2 1/4" Type S drywall screws 8" o.c. 5 1/2" mineral fiber insulation, nominal 3 pcf, friction fit in stud space.

Joints staggered 24" each layer and side.

Tested at 5,506 lbs per stud or 100 percent of design load. **(LOAD-BEARING)**



Thickness: 8"
Approx. Weight: 13 psf
Fire Test: ITS J20-06170.3, 12-00

This Space Left Blank

CHASE WALLS, NONCOMBUSTIBLE

GA FILE NO. WP 5000 | **PROPRIETARY*** | **1 HOUR FIRE** | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to ONE SIDE of a double row of 2 1/2" 25 ga steel studs 24" o.c. and not less than 1" apart with 1" Type S drywall screws 8" o.c. when applied at right angles to studs or 8" o.c. along vertical and bottom edges and 12" o.c. at intermediate studs when applied parallel to studs.

OPPOSITE SIDE: One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. when applied at right angles to studs or 8" o.c. along vertical and bottom edges and 12" o.c. at intermediate studs when applied parallel to studs.

Vertical joints centered over studs and staggered one stud cavity on opposite sides of wall. Horizontal joints on opposite sides need not be staggered or backed. Lateral bracing on both sides of the wall not less than 5 feet on center vertically. **(NLB)**

Sound tested with a second layer of 5/8" proprietary type X gypsum wallboard on one side of a double row of 3 5/8" 20 ga steel studs with 3 1/2" glass fiber insulation, 0.5 pcf, friction fit on both sides in cavity.

PROPRIETARY GYPSUM PANEL PRODUCT

Georgia Pacific Gypsum LLC - 5/8" DensArmor Plus® Fireguard® Interior Panel

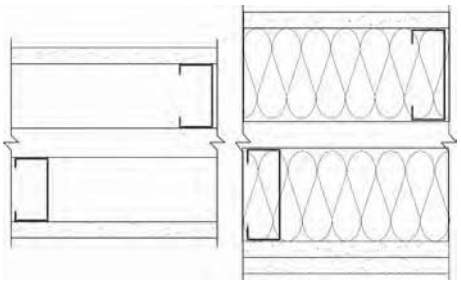

Thickness: 7 1/4" (Fire)
10 1/8" (Sound)
Approx. Weight: 7 psf
Fire Test: UL R2717, 09CA13628, 6-1-09, UL Design V469
Sound Test: RAL TL09-333, 11-19-09

GA FILE NO. WP 5001 | **PROPRIETARY*** | **1 HOUR FIRE** | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to ONE SIDE of a double row of 2 1/2" steel studs either 16" or 24" o.c. and not less than 1" apart with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs.

OPPOSITE SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1 5/8" Type S drywall screws 12" o.c. Face layer vertical joints offset one stud cavity from base layer vertical joints.

Horizontal joints staggered 12" each layer and side.

Sound tested with 3 1/2" glass fiber insulation, 0.5 pcf, on both sides in cavity. **(NLB)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type X

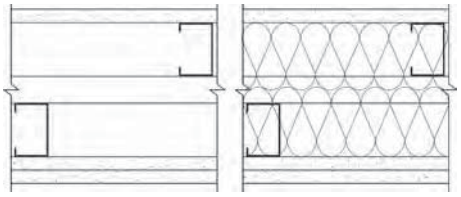

Thickness: Minimum 7 1/4"
Approx. Weight: 7 psf
Fire Test: UL R14196, 09NK18093 3-12-10
UL Design V496
Sound Test: RAL TL10-352, 10-26-10
RAL TL10-354, 10-27-10

**Contact the manufacturer for more detailed information on proprietary products.*

CHASE WALLS, NONCOMBUSTIBLE

GA FILE NO. WP 5005 | PROPRIETARY* | 1 HOUR FIRE | 60 to 64 FSTC SOUND

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION, CEMENTITIOUS BACKER UNIT CERAMIC TILE

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to ONE SIDE of a double row of 1 5/8" 20 ga steel studs 16" o.c. with 1" Type S-12 drywall screws 8" o.c. at edges and 12" o.c. at intermediate studs. 5/8" gypsum board pieces 6" wide located not more than 48" o.c. used as cross braces fastened to stud pairs with two 1" Type S drywall screws at each end of brace. Optionally, 25 ga stud or runner pieces may be used as cross braces and attached with two 1/2" Type S drywall screws at each end. 1 1/2" mineral fiber insulation, 2 pcf, on each side in stud space.

OPPOSITE SIDE: One layer 1/2" proprietary cementitious backer unit applied at right angles to studs with 1 1/4" Type S-12 wafer head screws 8" o.c. Vertical joints staggered and covered with glass fiber mesh tape. Ceramic tile, 1/4" thick, joints grouted, installed with latex-modified portland cement mortar or ANSI A136.1 Type I organic adhesive. **(NLB)**

PROPRIETARY GYPSUM BOARD

Lafarge North America Inc.	-	5/8" Firecheck® Type X
Temple-Inland	-	5/8" Type X
United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels

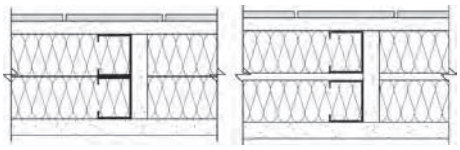

Thickness: Minimum 4 5/8"
Approx. Weight: 10 psf
Fire Test: UL R11270-1, -2, 1-21-85, UL Design U445
Field Sound Test: SA-840515, 5-18-84

GA FILE NO. WP 5006 | PROPRIETARY* | 1 HOUR FIRE | 60 to 64 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to ONE SIDE of a double row of 2 1/2" 20 ga steel studs 16" o.c. and not less than 1" apart with 1" Type S drywall screws 8" o.c. when applied at right angles to studs and 8" at vertical and bottom edges and 12" o.c. at intermediate studs when applied parallel to studs.

OPPOSITE SIDE: One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. when applied at right angles to studs and 8" at vertical and bottom edges and 12" o.c. at intermediate studs when applied parallel to studs.

Vertical joints centered over studs and staggered one stud cavity on opposite sides of studs. Horizontal joints need not be backed by framing. Horizontal joints on opposite sides need not be staggered. Lateral bracing on both sides of the wall not less than 5 feet on center vertically.

Sound tested with a second layer of 5/8" proprietary type X gypsum wallboard on one side ans a double row of 3 5/8" steel studs with 3 1/2" glass fiber insulation, 0.5 pcf, on both sides in cavity. **(NLB)**

PROPRIETARY GYPSUM BOARD

United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels

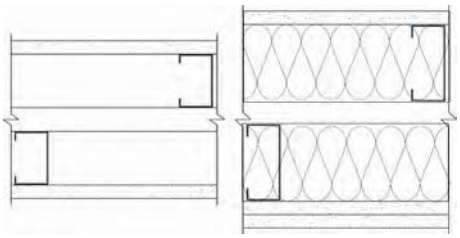

Thickness: Minimum 7 1/4" (Fire)
Minimum 10 1/8" (Sound)
Approx. Weight: 7 psf
Fire Test: UL R1319, 96NK31548, 10-21-96
UL Design U493
Sound Test: USG STC-050817, 8-11-05

GA FILE NO. WP 5007 | PROPRIETARY* | 1 HOUR FIRE | 55 to 59 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side of a double row of 2 1/2" steel studs either 16" or 24" o.c. and not less than 1" apart with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs.

Horizontal joints staggered 12" on opposite sides.

Sound tested with 3 1/2" glass fiber insulation, 0.5 pcf, on both sides in cavity. **(NLB)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® Type X

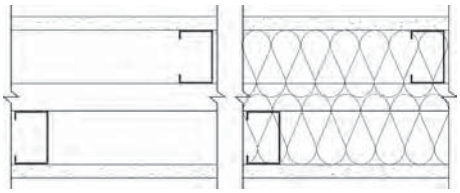

Thickness: Minimum 7 1/4"
Approx. Weight: 7 psf
Fire Test: UL R14196, 09NK18093 3-12-10
UL Design V496
Sound Test: RAL TL10-351, 10-25-10
RAL TL10-353, 10-27-10

**Contact the manufacturer for more detailed information on proprietary products.*

CHASE WALLS, NONCOMBUSTIBLE

GA FILE NO. WP 5015 | **GENERIC** | **1 HOUR FIRE** | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to a double row of 1 5/8" steel studs 24" o.c. and not less than 1" apart with 1" Type S drywall screws 8" o.c. at edges and 12" o.c. at intermediate studs. 5/8" gypsum board pieces 12" long x not less than 4 1/2" wide located at 1/3 points used as cross braces fastened to stud pairs with three 1" Type S drywall screws at each end of brace. Optionally 25 ga stud or runner pieces, not less than 4 1/2" long, may be used as cross braces and attached with two No. 8 x 1/2" self-drilling steel screws at each end. Where total cavity depth exceeds 9 1/2", cross braces shall be fabricated from 25 ga stud or runner pieces.

Joints staggered 24" on opposite sides. Sound tested with 3 1/2" glass fiber insulation stapled to one side in cavity. **(NLB)**

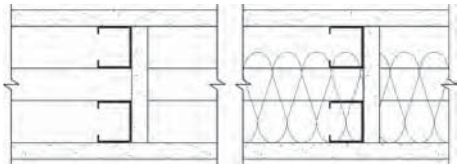

Thickness: 4 1/4"
Approx. Weight: 5 1/2 psf
Fire Test: UL R4024-13, -14, 11-17-76; UL R3660, 04NK28128, 11-18-04; UL Design U420
Sound Test: RAL TL76-155, 6-3-76

GA FILE NO. WP 5017 | **PROPRIETARY*** | **1 HOUR FIRE** | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to ONE SIDE of a double row of 2 1/2" 25 ga steel studs 24" o.c. and not less than 1" apart with 1" Type S drywall screws 8" o.c.

OPPOSITE SIDE: One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. Optional insulation in the cavity.

Vertical joints centered over studs and staggered one stud cavity on opposite sides of studs. Horizontal joints on opposite sides need not be staggered or backed. Lateral bracing on both sides of the wall not less than 5 feet on center vertically.

Sound tested with 3 1/2" glass fiber insulation friction fit on one side in cavity. **(NLB)**

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type X Gypsum Board

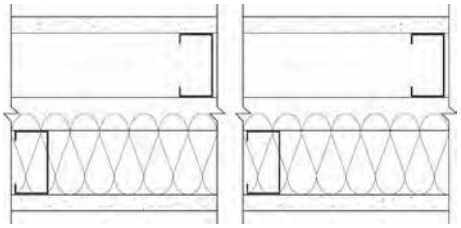

Thickness: Minimum 7 1/4"
Approx. Weight: 7 psf
Fire Test: UL R3660, 06NK13008, 7-7-06; 07SR3014402, 12-18-07; 08CA14331, 6-18-08; UL Design V469
Sound Test: RAL TL06-299, 8-10-06

**Contact the manufacturer for more detailed information on proprietary products.*

CHASE WALLS, NONCOMBUSTIBLE

GA FILE NO. WP 5040

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of a double row of 2 1/2" steel studs either 24" o.c. and not less than 1" apart with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs when applied parallel to studs or 8" o.c. when applied at right angles to studs.

Joints centered over studs and staggered on stud cavity on opposite sides of wall. Horizontal joints need not be staggered or backed. Lateral bracing not less than 5 feet o.c. on both rows of studs. **(NLB)**



Thickness: Minimum 7 1/4"
Approx. Weight: 7 psf
Fire Test: UL R3501, 09NK13630 11-30-09, UL Design V488

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board

GA FILE NO. WP 5050

PROPRIETARY*

2 HOUR FIRE | **65 to 69 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

Base layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to ONE SIDE of a double row of 2 1/2" 25 ga steel studs 24" o.c. and not less than 1" apart with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel to same side of studs with 1 5/8" Type S drywall screws 12" o.c. Face layer vertical joints offset one stud cavity from base layer vertical joints. Face layer horizontal joints offset not less than 6" from base layer horizontal joints.

OPPOSITE SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard base applied parallel to same side of studs with 1 5/8" Type S drywall screws 12" o.c. Face layer vertical joints offset one stud cavity from base layer vertical joints. Face layer horizontal joints offset not less than 6" from base layer horizontal joints.

Vertical joints centered over studs and staggered one stud cavity on opposite sides of studs. Horizontal joints need not be backed by framing. Horizontal joints on opposite sides need not be staggered. Lateral bracing on both sides of the wall not less than 5 feet on center vertically.

Sound tested using a double row of 3 5/8" 18 ga steel studs and 3 1/2" glass fiber insulation, 0.5 pcf, on both sides in cavity. **(NLB)**

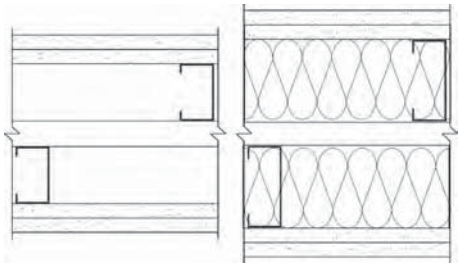

Thickness: Minimum 8 1/2" (Fire)
Minimum 10 3/4" (Sound)
Approx. Weight: 9 psf
Fire Test: UL R2717, 09CA13628, 6-1-09
UL Design V490
Sound Test: RAL TL09-332, 11-6-09

PROPRIETARY GYPSUM PANEL BOARD

Georgia Pacific Gypsum LLC - 5/8" DensArmor Plus® Fireguard® Interior Panel

GA FILE NO. WP 5051

PROPRIETARY*

2 HOUR FIRE | **65 to 69 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

Base layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side of a double row of 2 1/2" steel studs either 16" or 24" o.c. and not less than 1" apart with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1 5/8" Type S drywall screws 12" o.c. Face layer vertical joints offset one stud cavity from base layer vertical joints.

Horizontal joints staggered 12" each layer and side.

Sound tested with 3 1/2" glass fiber insulation, 0.5 pcf, on both sides in cavity. **(NLB)**

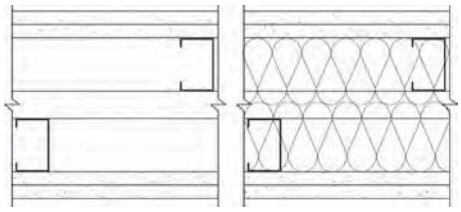

Thickness: Minimum 7 1/4"
Approx. Weight: 7 psf
Fire Test: UL R14196, 09NK18093 3-12-10
UL Design V496
Sound Test: RAL TL10-355, 10-27-10

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type X

**Contact the manufacturer for more detailed information on proprietary products.*

CHASE WALLS, NONCOMBUSTIBLE

GA FILE NO. WP 5060

PROPRIETARY*

2 HOUR FIRE

65 to 69 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to ONE SIDE of a double row of 3 5/8" 18 ga steel studs 16" o.c. and not less than 1" apart with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to same side of studs with 1 5/8" Type S drywall screws 12" o.c. Face layer vertical joints offset one stud cavity from base layer vertical joints. Face layer horizontal joints offset not less than 6" from base layer horizontal joints.

OPPOSITE SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to same side of studs with 1 5/8" Type S drywall screws 12" o.c. Face layer vertical joints offset one stud cavity from base layer vertical joints. Face layer horizontal joints offset not less than 6" from base layer horizontal joints.

Vertical joints centered over studs and staggered one stud cavity on opposite sides of studs. Horizontal joints need not be backed by framing. Horizontal joints on opposite sides need not be staggered. Lateral bracing on both sides of the wall not less than 5 feet on center vertically.

Sound tested using a double row of 3 5/8" steel studs and 3 1/2" glass fiber insulation, 0.5 pcf, on both sides in cavity. **(NLB)**

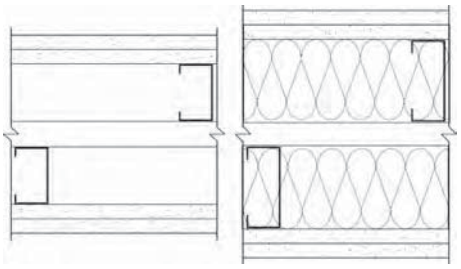

Thickness:	Minimum 8 1/2" (Fire) Minimum 10 3/4" (Sound)
Approx. Weight:	9 psf
Fire Test:	UL R1319, 96NK31548, 10-21-96, UL Design U493
Sound Test:	USG STC-050819, 8-12-05

PROPRIETARY GYPSUM BOARD

United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels

GA FILE NO. WP 5070

PROPRIETARY*

2 HOUR FIRE

60 to 64 FSTC SOUND

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION, CEMENTITIOUS BACKER UNIT, CERAMIC TILE

Base layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel on each side of a double row of 1 5/8" 20 ga steel studs spaced 24" o.c. with 1" Type S-12 drywall screws 24" o.c. 1/2" gypsum board pieces 6" wide located not more than 48" o.c. used as cross braces fastened to stud pairs with two 1" Type S drywall screws at each end of brace. Optionally, 25 ga stud or runner pieces may be used as cross braces and attached with two 1/2" Type S drywall screws at each end. 1 1/2" mineral fiber insulation, 2.0 pcf, on each side in stud space. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to ONE SIDE with 1 5/8" Type S drywall screws 12" o.c. Joints offset 24" from base layer joints.

OPPOSITE SIDE: **Face** layer 1/2" proprietary cementitious backer unit applied at right angles to studs with 1 5/8" Type S-12 wafer head screws 8" o.c. Vertical joints offset 24" from base layer vertical joints. Joints covered with glass fiber mesh tape. Ceramic tile 1/4" thick, joints grouted, installed with latex-modified portland cement mortar or ANSI A136.1 Type I organic adhesive.

Sound tested with 1/4" space between the rows of stud. **(NLB)**

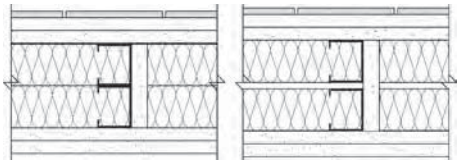

Thickness:	5 1/2" (Fire) 5 3/4" (Sound)
Approx. Weight:	14 psf
Fire Test:	UL R11270, 4-19-85; UL R3660, 02NK35115, 9-15-03; UL Design U444
Field Sound Test:	SA-851102, 11-6-85
Sound Test:	NRCC TL-93-308, 12-2-02

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	-	1/2" CertainTeed® Type C Gypsum Board
Lafarge North America Inc.	-	1/2" Firecheck® Type C
National Gypsum Company	-	1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
Temple-Inland	-	1/2" TC-C
United States Gypsum Company	-	1/2" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

**Contact the manufacturer for more detailed information on proprietary products.*

CHASE WALLS, NONCOMBUSTIBLE

GA FILE NO. WP 5071

PROPRIETARY*

2 HOUR FIRE

60 to 64 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to ONE SIDE of a double row of 2 1/2" 25 ga steel studs 24" o.c. and not less than 1" apart with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to same side of studs with 1 5/8" Type S drywall screws 8" o.c. when applied parallel and 16" o.c. when applied at right angles. Face layer vertical joints offset one stud cavity from base layer vertical joints. Face layer horizontal joints offset not less than 12" from base layer horizontal joints.

OPPOSITE SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to same side of studs with 1 5/8" Type S drywall screws 8" o.c. when applied parallel and 16" o.c. when applied at right angles. Face layer vertical joints offset one stud cavity from base layer vertical joints. Face layer horizontal joints offset not less than 12" from base layer horizontal joints. Optional insulation in the cavity.

Vertical joints centered over studs and staggered one stud cavity on opposite sides of wall. Horizontal joints on opposite sides need not be staggered or backed. Lateral bracing on both sides of the wall not less than 5 feet on center vertically. **(NLB)**

Sound tested with 3 1/2" glass fiber insulation friction fit on one side in cavity.

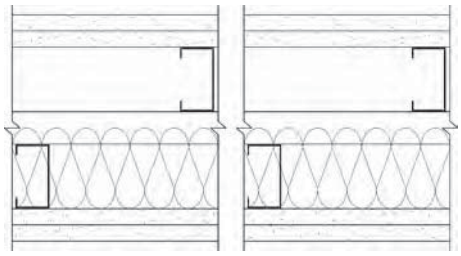

Thickness: Minimum 8 1/2"
Approx. Weight: 9 psf
Fire Test: UL R3660, 06NK13008, 7-7-06; 07SR3014402, 12-18-07; 08CA14331, 6-18-08; UL Design V469
Sound Test: RAL TL06-300, 8-11-06

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type X Gypsum Board

GA FILE NO. WP 5105

GENERIC

2 HOUR FIRE

55 to 59 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to a double row of 1 5/8" steel studs 24" o.c. and not less than 1" apart with 1" Type S drywall screws 8" o.c. at edges and 12" o.c. at intermediate studs. 5/8" gypsum board pieces 12" long by not less than 4 1/2" wide located at 1/3 points used as cross braces fastened to stud pairs with three 1" Type S drywall screws at each end of brace. Optionally 25 ga stud or runner pieces, not less than 4 1/2" long, may be used as cross braces and attached with two No. 8 x 1/2" self-drilling steel screws at each end. Where total cavity depth exceeds 9 1/2", cross braces shall be fabricated from 25 ga stud or runner pieces. **Face** layers 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 8" o.c. at joints and floor and ceiling runners and 12" o.c. at intermediate studs.

Joints staggered 24" each layer and side. Sound tested with 3 1/2" glass fiber insulation in stud cavity on one side. **(NLB)**

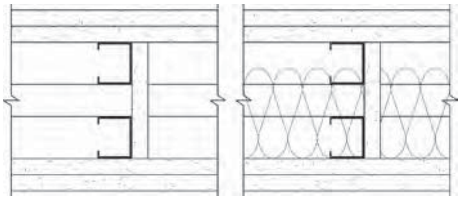

Thickness: 12"
Approx. Weight: 10 psf
Fire Test: UL R4024-13, -14, 11-17-76; UL R3660, 04NK28128, 11-18-04; UL Design U420
Sound Test: RAL TL76-156, 6-11-76

**Contact the manufacturer for more detailed information on proprietary products.*

CHASE WALLS, NONCOMBUSTIBLE

GA FILE NO. WP 5130 | **GENERIC** | **2 HOUR FIRE** | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to a double row of 1 5/8" steel studs 24" o.c. and not less than 1" apart with 1" Type S drywall screws 8" o.c. at edges and 12" o.c. at intermediate studs. 5/8" gypsum board pieces 12" long by not less than 4 1/2" wide located at 1/3 points used as cross braces fastened to stud pairs with three 1" Type S drywall screws at each end of brace. Optionally 25 ga stud or runner pieces, not less than 4 1/2" long, may be used as cross braces and attached with two No. 8 x 1/2" self-drilling steel screws at each end. Where total cavity depth exceeds 9 1/2", cross braces shall be fabricated from 25 ga stud or runner pieces. **Face** layers 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 8" o.c. at joints and floor and ceiling runners and 12" o.c. at intermediate studs.

Joints staggered 24" each layer and side.**(NLB)**

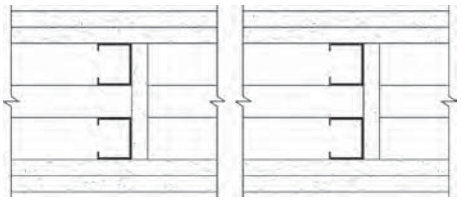

Thickness: 12"
Approx. Weight: 10 psf
Fire Test: UL R4024-13, -14, 11-17-76; UL R3660, 04NK28128, 11-18-04; UL Design U420
Sound Test: RAL TL76-162, 6-11-76

GA FILE NO. WP 5240 | **PROPRIETARY*** | **2 HOUR FIRE**

GYPSUM WALLBOARD, STEEL STUDS, GLASS FIBER INSULATION

Base layer 5/8" proprietary type X paper faced or glass mat faced gypsum panels applied parallel or at right angles to each side of a double row of 2 1/2" steel studs 24" o.c. and not less than 1" apart with 1" Type S or Type S-12 drywall screws 16" o.c. Steel studs staggered 12" each side of wall. **Face** layer 5/8" proprietary type X paper faced or glass mat faced gypsum panels applied parallel or at right angles to each side of wall with 1 5/8" Type S or Type S-12 drywall screws 12" o.c. Face layer vertical joints offset one stud cavity from base layer vertical joints. Face layer horizontal joints offset not less than 6" from base layer horizontal joints. **(NLB)**

PROPRIETARY GYPSUM BOARD

Temple-Inland	-	5/8" Type X



Thickness: 8 1/2"
Approx. Weight: 9.5 psf
Fire Test: UL R6937, 08NK19036, 9-24-08; 10NK15166, 2-14-11; UL Design W407

This Space Left Blank

**Contact the manufacturer for more detailed information on proprietary products.*

CHASE WALLS, WOOD FRAMED

GA FILE NO. WP 5450

PROPRIETARY*

1 HOUR FIRE | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, WOOD STUDS

Base layer 5/8" proprietary type X gypsum wallboard applied parallel to each side of 2 x 4 wood studs 16" o.c. staggered 8" o.c. on 2 x 6 wood plates with 1 1/4" drywall screws 8" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel to each side with 1 7/8" drywall screws 8" o.c.

Joints staggered 24" on opposite sides.

Sound tested with resilient channels on one side and 3 1/2" glass fiber insulation in stud cavity on both sides. (**LOAD-BEARING)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type C

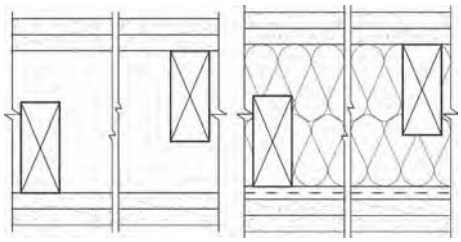

Thickness: 9 1/2"
Approx. Weight: 13 psf
Fire Test: UL R14196, 11NK09957, 7-22-11, UL Design U340
Sound Test: RAL TL11-167, 7-14-11

GA FILE NO. WP 5508

PROPRIETARY*

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side of double row of 2 x 4 wood studs 24" o.c. on separate plates with 1 1/4" drywall screws 8" o.c. No minimum airspace between rows of studs.

Joints staggered 16" on opposite sides.

Sound tested with 1" air space between rows of studs and 3 1/2" glass fiber insulation in stud cavity on both sides. **(LOAD-BEARING)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type X

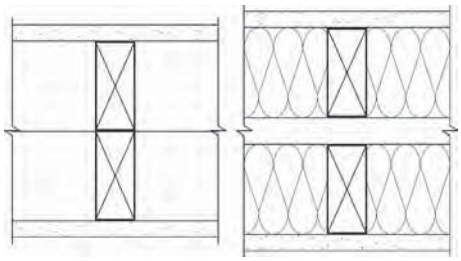

Thickness: 9 1/2"
Approx. Weight: 10 psf
Fire Test: UL R14196, 06NK07241, 3-13-06, UL Design U341
Sound Test: RAL TL11-160, 7-11-11

GA FILE NO. WP 5509

PROPRIETARY*

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to each side of 2 x 4 wood studs 16" o.c. staggered 8" o.c. on 2 x 6 wood plates with 1 1/4" drywall screws 8" o.c.

Joints staggered 24" on opposite sides.

Sound tested with resilient channels on one side and 3 1/2" glass fiber insulation in stud cavity on both sides. (**LOAD-BEARING)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type C

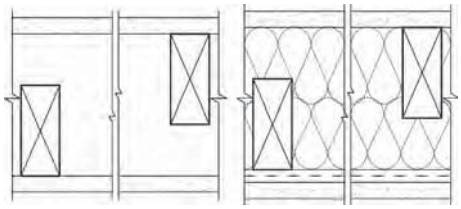

Thickness: 7 3/4"
Approx. Weight: 9 psf
Fire Test: UL R14196, 11NK09957, 7-22-11, UL Design U340
Sound Test: RAL TL11-165, 7-13-11

**Contact the manufacturer for more detailed information on proprietary products.*

CHASE WALLS, WOOD FRAMED

GA FILE NO. WP 5510 | GENERIC | 1 HOUR FIRE | 55 to 59 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

Base layer 1/4" gypsum wallboard applied parallel to each side of double row of 2 x 4 wood studs 16" o.c. on separate plates spaced 1 1/2" apart with 4d coated nails, 1 1/2" long, 0.099" shank, 1/4" heads, 12" o.c. Joints staggered 16" on opposite sides. **Face** layer 1/2" type X plain or predecorated gypsum wallboard or gypsum veneer base applied parallel to each side with 3/8" beads of adhesive 16" o.c. and 5d coated nails, 1¾" long, 0.099" shank, 1/4" heads, 16" o.c. at top and bottom plates. 4d finish nails, 1 1/2" long, 0.072" shank, 0.1055" heads, driven at a 45° angle 16" o.c. horizontally and 24" o.c. vertically. Joints offset 24" from base layer joints.

Sound tested with 1 1/2" mineral fiber insulation in stud space. Horizontal bracing required at mid-height. **(LOAD-BEARING)**

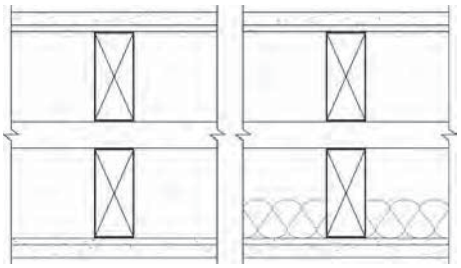

Thickness: 10"
Approx. Weight: 9 psf
Fire Test: See WP 3341 (FM WP-147, 1-2-69); UL R4024, 10-31-68
Sound Test: G&H BW-32ST, 4-22-68

GA FILE NO. WP 5512 | GENERIC | 1 HOUR FIRE | 45 to 49 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of double row of 2 x 4 wood studs 16" o.c. on separate plates 1" apart with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Joints staggered 16" on opposite sides. Horizontal bracing required at mid-height. **(LOAD-BEARING)**

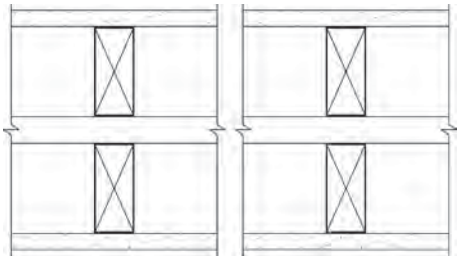

Thickness: 9 1/4"
Approx. Weight: 8 psf
Fire Test: See WP 3605 (UL R1319-4, -6, 6-17-52; UL R2717-39, 1-20-66; UL R3501-52, 3-15-66, UL Design U305; ULC Design W301); UL R4024, 10-31-68
Sound Test: NRCC TL-93-261, IRC-IR-761, 3/98

CHASE WALLS, WOOD FRAMED

GA FILE NO. WP 5515 | GENERIC | 1 HOUR FIRE | 40 to 44 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side of 2 x 4 wood studs 16" o.c. staggered 8" o.c. on 2 x 6 wood plates with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Joints staggered 24" on opposite sides. Horizontal bracing required at mid-height. **(LOAD-BEARING)**

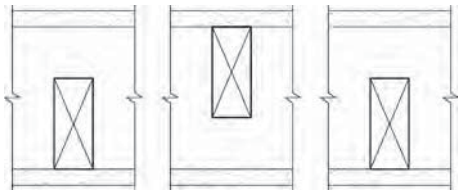

Thickness: 7 3/4"
Approx. Weight: 8 psf
Fire Test: See WP 3605 (UL R1319-4, -6, 6-17-52; UL R2717-39, 1-20-66; UL R3501-52, 3-15-66, UL Design U305; ULC Design W301); UL R4024, 10-31-68
Sound Test: NRCC TL-93-254, IRC-IR-761, 3/98

GA FILE NO. WP 5520 | GENERIC | 2 HOUR FIRE | 55 to 59 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to each side of double row of 2 x 4 wood studs 16" o.c. on separate plates 1" apart with 6d coated nails, 1 7/8" long, 0.085" shank, 1/4" heads, 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 8d coated nails, 2 3/8" long, 0.100" shank, 1/4" heads, 8" o.c.

Joints staggered 16" each layer and side. Sound tested with 3 1/2" glass fiber insulation stapled to studs in stud spaces on one side and with nails for base layer spaced 6" o.c. Horizontal bracing required at mid-height. **(LOAD-BEARING)**

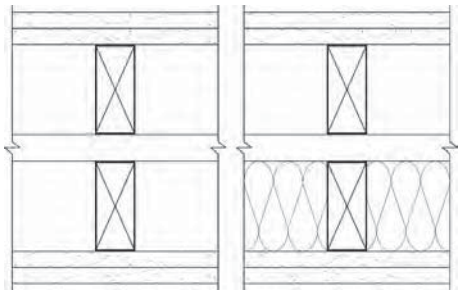

Thickness: 10 3/4"
Approx. Weight: 13 psf
Fire Test: See WP 4135 (FM WP-360, 9-27-74); UL R4024, 10-31-68
Sound Test: NGC 3056, 4-7-70

GA FILE NO. WP 5530 | GENERIC | 2 HOUR FIRE | 50 to 54 STC SOUND

GYPSUM WALLBOARD, WOOD STUDS

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to each side of 2 x 4 wood studs 16" o.c. staggered 8" o.c. on 2 x 6 wood plates with 6d coated nails, 1 7/8" long, 0.085" shank, 1/4" heads, 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to each side with 8d coated nails, 2 3/8" long, 0.113" shank, 9/32" heads, 8" o.c.

Joints staggered 16" each layer and side. Sound tested with nails for base layer spaced 6" o.c. Horizontal bracing required at mid-height. **(LOAD-BEARING)**

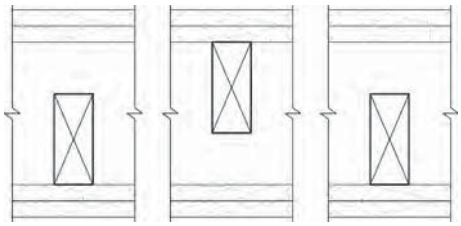

Thickness: 8"
Approx. Weight: 13 psf
Fire Test: See WP 4135 (FM WP-360, 9-27-74); UL R4024, 10-31-68
Sound Test: NGC 2377, 5-19-70

MOVABLE AND OFFICE PARTITIONS

GA FILE NO. WP 5910 — PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 3/8" gypsum wallboard applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. at edges and ends only. **Face** layer 1/2" proprietary type X predecorated gypsum wallboard applied parallel to each side with proprietary clips 17" o.c. at edges and 1 5/8" Type S drywall screws 12" o.c. at floor and ceiling runners. Clips attached to studs with 1" Type S drywall screws.

Joints staggered 24" o.c. each layer and side. Sound tested with 2 3/4" glass fiber insulation in stud space. **(NLB)**

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Canada Inc. - 1/2" CertainTeed® Type C Gypsum Board

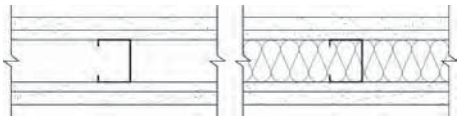

Thickness: 3 3/8"
Approx. Weight: 7 psf
Fire Test: ULC 78T70, 7-25-78, ULC Design W410
Sound Test: BGL 471, 5-16-79

GA FILE NO. WP 6010 — GENERIC

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, MINERAL FIBER INSULATION, STEEL STUDS

One layer 1/2" type X predecorated gypsum wallboard applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 30" o.c. at vertical joints. Aluminum battens snapped over 7/8" wide, 25 ga galvanized steel track at vertical joints attached with 1" Type S drywall screws 12" o.c. 2 1/2" aluminum base applied along bottom edge on steel base clips 24" o.c. applied with 1 1/4" Type S drywall screws. 2" mineral fiber insulation, 3.0 pcf, in stud space.

Joints staggered 24" on opposite sides. **(NLB)**



Thickness: 3 1/2"
Approx. Weight: 5 psf
Fire Test: FM WP 96-1, 6-23-67
Sound Test: NGC 2213, 8-3-67

GA FILE NO. WP 6020 — GENERIC

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, MINERAL FIBER INSULATION, STEEL STUDS

One layer 1/2" type X predecorated gypsum wallboard applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 30" o.c. at vertical joints and adhesive at intermediate studs. Aluminum battens snapped over 7/8" wide, 25 ga galvanized steel track at vertical joints attached with 1" Type S drywall screws 9" o.c. 2 1/2" aluminum base applied along bottom edge on steel base clips 24" o.c. applied with 1 1/4" Type S drywall screws. 2" mineral fiber insulation, 3.7 pcf, in stud space.

Joints staggered 24" on opposite sides. **(NLB)**



Thickness: 3 1/2"
Approx. Weight: 5 psf
Fire Test: FM WP 110-1, 10-5-67
Sound Test: RAL TL65-101, 4-1-65

GA FILE NO. WP 6025 — GENERIC

1 HOUR FIRE | **45 to 49 FSTC SOUND**

GYPSUM WALLBOARD, MINERAL FIBER INSULATION, STEEL STUDS

One layer 1/2" type X gypsum wallboard applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. at vertical joints and 1/2" beads of adhesive at intermediate studs. Aluminum battens applied over joints with 1" Type S drywall screws 12" o.c. 2" mineral fiber insulation, 3.8 pcf, in stud space. 3 1/2" aluminum base applied along bottom edge on steel base clips 24" o.c. applied with 1 1/4" Type S drywall screws.

Joints staggered 24" on opposite sides. **(NLB)**



Thickness: 3 1/2"
Approx. Weight: 5 psf
Fire Test: UC, 7-27-70
Field Sound Test: USG 17084, 8-18-70

**Contact the manufacturer for more detailed information on proprietary products.*

MOVABLE AND OFFICE PARTITIONS

GA FILE NO. WP 6040 — GENERIC

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" type X predecorated gypsum wallboard applied parallel to each side of 2 1/2" steel studs 24" o.c. with 7/8" wide, 25 ga galvanized steel track fastened over each stud with 1 1/8" Type S drywall screws 9" o.c. Aluminum battens snapped over steel track and 2 1/2" aluminum base applied along bottom edge on steel base clips 24" o.c. applied with 1 1/4" Type S drywall screws.

Joints staggered 24" o.c. each side. Sound tested with 3" glass fiber insulation in stud space. STC 40 to 44 without glass fiber insulation. **(NLB)**



Thickness: 3 3/4"
Approx. Weight: 7 psf
Fire Test: UL R3501-23, -24; 6-4-63; UL Design U405
Sound Test: G&H NG-145FT, 4-17-64; NG-146FT, 4-20-64

GA FILE NO. WP 6070 — PROPRIETARY*

1 HOUR FIRE | **45 to 49 FSTC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 24" or 30" wide 3/4" kerfed, beveled-edge proprietary gypsum wallboard applied parallel to each side of 2 5/8" H-studs 24" or 30" o.c. and 1 7/8" floor and ceiling runners with two 1 1/4" Type S drywall screws at floor and ceiling runners and stud flanges inserted in the kerfed panel edges. Aluminum trim strips screw attached 12" o.c. through panel into ceiling runner. An aluminum or steel one-piece combination runner and trim may be used in lieu of the steel ceiling runner and aluminum trim strips. Aluminum base trim may be used each side of wall with clip attachment.

Sound tested with 24" wide panels, one-piece ceiling runner and trim, and 1" mineral fiber insulation in stud space. STC 40 to 44 without mineral fiber insulation. **(NLB)**

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 3/4" ULTRAWALL® Gypsum Panels (USG Interiors)



Thickness: 3 3/8"
Approx. Weight: 7 psf
Fire Test: UC, 8-18-67; UC, 7-23-69; WHI-495-0120, 4-5-78; UL R1319, 86NK29226, 12-10-86, UL Design U427
Field Sound Test: BBN 701216, 12-22-70; BBN 701008, 11-3-70

GA FILE NO. WP 6130 — GENERIC

1 HOUR FIRE | **40 to 44 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 30" wide 5/8" type X plain or predecorated gypsum wallboard applied parallel to each side of 2 1/2" steel studs 30" o.c. with 1 1/4" Type S drywall screws 30" o.c. Aluminum battens snapped over steel batten retainer strips at each stud and ceiling runner attached with 1 1/4" Type S drywall screws 9" o.c. and steel clips 24" o.c. at floor runner.

Sound tested with 2" glass fiber insulation in stud space. **(NLB)**



Thickness: 3 3/4"
Approx. Weight: 5.5 psf
Fire Test: FM WP 109, 10-26-67
Sound Test: NGC 2218, 8-17-67

GA FILE NO. WP 6135 — GENERIC

1 HOUR FIRE | **40 to 44 STC SOUND**

GYPSUM WALLBOARD, MINERAL FIBER INSULATION, STEEL STUDS

One layer 1/2" type X plain or predecorated gypsum wallboard applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 30" o.c. at vertical joints. Aluminum battens attached over each stud with 1" Type S drywall screws 12" o.c. 2" mineral fiber insulation, 2.63 pcf, stapled 24" o.c. in stud space.

Joints staggered 24" on opposite sides. **(NLB)**



Thickness: 3 1/2"
Approx. Weight: 6 psf
Fire Test: OSU T-4264, 2-9-68
Sound Test: KG 517, 11-6-68

**Contact the manufacturer for more detailed information on proprietary products.*

MOVABLE AND OFFICE PARTITIONS

GA FILE NO. WP 6152

GENERIC

1 HOUR FIRE

40 to 44 STC SOUND

METAL CLAD GYPSUM PANELS, MINERAL FIBER INSULATION, STEEL STUDS

One layer 30" wide metal faced 1/2" type X gypsum wallboard panels applied parallel to each side of 2 1/2" fabricated steel studs 15" o.c. Metal cladding adhesively attached to wallboard. Studs fabricated from two members joined at webs with tabs and having stud flanges formed to provide spring receiving slots to receive edge flanges of cladding. Two layers 2 1/4" wide 5/8" type X gypsum wallboard strips attached to each side of stud webs. First strip attached with 1 1/4" long Type S drywall screws 12" o.c. Second strip attached with 1 7/8" long Type S drywall screws 24" o.c. and offset 6" from screws in first strip. 2" mineral fiber insulation, 3.8 pcf friction fit in stud cavities. Clad gypsum panels secured at vertical edges to studs by inserting 1 5/16" wide flanges of cladding into stud receiving slot; flanges of cladding are crimped 12" o.c. forming a 3/8" long by 3/32" deep crimp to secure panels to studs. Panels attached to floor and ceiling runners with 1 1/4" Type S drywall screws located 4" from each corner and one in the middle at the bottom.

Joints staggered 15" on opposite sides. **(NLB)**



Thickness: 3 1/2"
Approx. Weight: 8.5 psf
Fire Test: FM WP 495, 11-15-78
Sound Test: KAL 443990, 10-31-78

GA FILE NO. WP 6240

GENERIC

1 HOUR FIRE

35 to 39 STC SOUND

SEMI-SOLID GYPSUM WALLBOARD

Face layer 24" wide 5/8" type X gypsum wallboard laminated parallel to each side of 6" wide 1" gypsum coreboard studs. **Face** layer joints aligned on opposite sides and offset from stud edges 1 3/4" to form an interlocking joint. Face layer attached to studs with 1 1/2" long Type G screws 30" o.c. spaced 2" from joint on tongue edge and 4" from joint on groove edge. Panels mounted in floor and ceiling channels. **(NLB)**



Thickness: 2 1/4"
Limiting Height: 12'0"
Approx. Weight: 7 psf
Fire Test: FM WP 142-1, 1-6-69
Sound Test: RAL TL64-212, 4-13-64

GA FILE NO. WP 6250

GENERIC

1 HOUR FIRE

35 to 39 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" type X predecorated gypsum wallboard applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 30" o.c. Aluminum battens attached over each stud with 1 1/2" Type S drywall screws 12" o.c. and covered with plastic inserts. 4" snap-on aluminum base applied to bottom edge of assembly.

Joints staggered 24" on opposite sides. **(NLB)**



Thickness: 3 3/4"
Approx. Weight: 5 psf
Fire Test: OSU T-2898, 9-17-64
Sound Test: OR 64-65, 7-17-64

MOVABLE AND OFFICE PARTITIONS

GA FILE NO. WP 6254 | **PROPRIETARY*** | **1 HOUR FIRE** | **35 to 39 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

One layer 1/2" proprietary type X gypsum wallboard installed parallel to 2 1/2" steel studs 24" o.c. with proprietary clips at vertical joints, 1" Type S drywall screws 8" o.c. at floor and ceiling runners, and 6" wide strips of adhesive 18" o.c. at intermediate studs. Clips attached 10" o.c. to studs at vertical joints with 1/2" Type S panhead screws. One piece of 1/2" proprietary type X gypsum board placed between the studs in stud cavity.

Joints staggered 24" on opposite sides. **(NLB)**

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Canada Inc. - 1/2" CertainTeed® Type C Gypsum Board

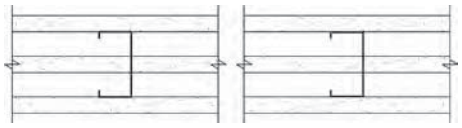

Thickness: 3 1/2"
Approx. Weight: 6 psf
Fire Test: WHI 495-0661, 2-12-85; WHI 495-0662, 2-12-85
Sound Test: BGL 472, 5-18-79

GA FILE NO. WP 6525 | **PROPRIETARY*** | **2 HOUR FIRE** | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, MINERAL FIBER INSULATION, STEEL STUDS

One layer 24" wide 3/4" kerfed, beveled-edge proprietary gypsum wallboard applied parallel to ONE SIDE of 2 5/8" wide H-studs and 1 7/8" floor and ceiling runners with two 1 1/4" Type S drywall screws at floor and ceiling runners and stud flanges inserted in kerfed panel edges. 1 1/2" mineral fiber insulation, 3.0 pcf, in stud space.

OPPOSITE SIDE: **Base** layer 24" wide 3/4" kerfed, beveled-edge proprietary gypsum wallboard applied parallel to studs with two 1 1/4" Type S drywall screws at floor and ceiling runners and stud flanges inserted in kerfed panel edges. **Face** layer 24" wide 3/4" kerfed, beveled-edge proprietary gypsum wallboard applied parallel to studs over 2" wide 3/8" gypsum board spacer strips at floor and ceiling runners and 3/4" Z-splines in the kerfed panel edges. Spacer strips attached with 1 5/8" Type S drywall screws 24" o.c. **Face** layer attached to floor and ceiling runners with two 2 3/8" Type S drywall screws per panel. Z-splines attached to H-studs with screws 24" o.c.

1 1/4" wide metal trim strips screw-attached both faces at ceiling runner. **(NLB)**

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 3/4" ULTRAWALL® Gypsum Panels (USG Interiors)

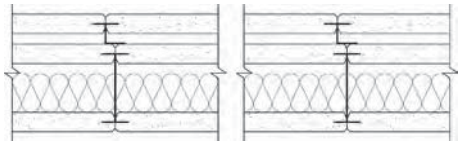

Thickness: 4 1/2"
Approx. Weight: 12 psf
Fire Test: UL R1319-130, 4-27-73, UL Design U416
Sound Test: RAL TL70-198, 4-8-70

This Space Left Blank

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 6800 — PROPRIETARY*

1 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with T section of 2½" steel C-T studs between panels.

OPPOSITE SIDE: One layer ⅝" proprietary type X gypsum wallboard applied parallel to studs with 1" Type S drywall screws 12" o.c.

Sound tested with horizontal resilient channels 24" o.c. and 2½" glass fiber friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

PABCO Gypsum
- ⅝" FLAME CURB® Super 'C'™
- 1" PABCORE® Gypsum Liner Board

Thickness: 3⅛"
Approx. Weight: 7 psf
Fire Test: WHI-495-1303, 7-19-95
Sound Test: RAL TL96-28, 2-13-96

GA FILE NO. WP 6850 — PROPRIETARY*

1 HOUR FIRE | **40 to 44 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T or I studs between panels.

OPPOSITE SIDE: One layer ⅝" proprietary type X gypsum wallboard applied parallel to studs with 1" Type S drywall screws 8" o.c. at edges and 12" o.c. at intermediate studs.

Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.
- ⅝" CertainTeed® Type X Gypsum Board
- 1" CertainTeed® Shaftliner Type X Gypsum Board

Thickness: 3⅛"
Approx. Weight: 7 psf
Fire Test: UL R8701, 98NK33190, 7-12-99, UL Design U417
Sound Test: NGC 2006036, 1-31-07

GA FILE NO. WP 6851 — PROPRIETARY*

1 HOUR FIRE | **40 to 44 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H or C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with H section of 2½" proprietary C-H or C-T steel studs between panels.

OPPOSITE SIDE: One layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c.

Sound tested with 1½" glass fiber insulation friction fit in stud cavity and with the ⅝" proprietary type X gypsum wallboard applied with screws spaced 12" o.c. **(NLB)**



PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC
- ⅝" ToughRock® Fireguard® Gypsum Board
- 1" DensGlass® Shaftliner

Thickness: 3⅛"
Approx. Weight: 7 psf
Fire Test: UL R2717, 10CA13714, 7-8-10, UL Design V473
Sound Test: RAL TL09-357, 12-7-09

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 6855 | **PROPRIETARY*** | **1 HOUR FIRE** | **40 to 44 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" proprietary C-H, C-T, or I steel studs between panels.

OPPOSITE SIDE: One layer ⅝" proprietary type X gypsum wallboard applied parallel to studs with 1" Type S drywall screws 8" o.c. at edges and 12" o.c. at intermediate studs.

Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC
- ⅝" ToughRock® Fireguard® Gypsum Board
- 1" DensGlass® Shaftliner

Thickness: 3⅛"
Approx. Weight: 7 psf
Fire Test: GET, 1-7-74; ITS, 8-30-01, ITS Design GP/WA 60-01
Sound Test: RAL-TL09-357, 12-7-09

GA FILE NO. WP 6904 | **PROPRIETARY*** | **1 HOUR FIRE** | **40 to 44 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary glass mat type X gypsum panels inserted between 2½" floor and ceiling J runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: One layer ⅝" proprietary type X glass mat gypsum substrate applied parallel or at right angles to studs with 1" Type S drywall screws 12" o.c.

Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM PANEL PRODUCTS

National Gypsum Company
- ⅝" Gold Bond® Brand e²XP® Interior Extreme® Gypsum Panels
- 1" Gold Bond® Brand e²XP® Extended Exposure FIRE-SHIELD® Shaftliner

Thickness: 3⅛"
Approx. Weight: 7 psf
Fire Test: UL R3501, 08NK58332, 12-12-08; 07NK17992, 12-12-07; UL Design U499
Sound Test: NGC 2542, 5-11-76

GA FILE NO. WP 6905 | **PROPRIETARY*** | **1 HOUR FIRE** | **40 to 44 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: One layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 12" o.c.

Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

National Gypsum Company
- ⅝" Gold Bond® Brand FIRE-SHIELD® Gypsum Wallboard
- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

Thickness: 3⅛"
Approx. Weight: 7 psf
Fire Test: UL R3501, 93NK22748, 9-15-93; 97NK24041, 7-14-97; UL Design U499; FM WP-755,2-27-85
Sound Test: NGC 2542, 5-11-76

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7008

PROPRIETARY*

1 HOUR FIRE | **35 to 39 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with H section of 2½" proprietary vented C-H steel studs between panels.

OPPOSITE SIDE: One layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1" Type S drywall screws 12" o.c.

STC estimate based on 1" mineral fiber insulation in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	-	⅝" CertainTeed® Type C Gypsum Board
Lafarge North America Inc.	-	⅝" Firecheck® Type X
	-	1" Mold Defense® Shaftliner
PABCO Gypsum	-	⅝" FLAME CURB® Type X
United States Gypsum Company	-	⅝" SHEETROCK® Brand FIRECODE® Core Gypsum Panels
	-	1" SHEETROCK® Brand Gypsum Liner Panels

Thickness: 3⅛"
Approx. Weight: 8 psf
Fire Test: UL R1319, 88NK2747, 2-8-88, UL Design U469
Sound Test: Estimated

GA FILE NO. WP 7023

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, STEEL I, C-H, OR C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with tab-flange section of 2½" steel I, C-H, or C-T stud between panels.

OPPOSITE SIDE: One layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1" Type S drywall screws 12" o.c. **(NLB)**

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	⅝" FireBloc® Type X
	-	1" Shaftliner

Thickness: 3⅛"
Approx. Weight: 7 psf
Fire Test: UL R14196, 05NK29331, 2-18-06, UL Design V455

GA FILE NO. WP 7024

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, STEEL C-T, C-H, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with tab-flange section of 2½" steel C-T, C-H, or I stud between panels.

OPPOSITE SIDE: One layer ⅝" proprietary type X gypsum wallboard applied parallel to studs with 1" Type S drywall screws 12" o.c. **(NLB)**



PROPRIETARY GYPSUM BOARD

Lafarge North America Inc.	-	⅝" Firecheck® Type X
	-	1" Mold Defense® Shaftliner

Thickness: 3⅛"
Approx. Weight: 8 psf
Fire Test: UL R18482, 09CA16342, 8-19-09, UL Design V481, Systems G & H

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7024.2

PROPRIETARY*

1 HOUR FIRE

GYPSUM PANEL PRODUCTS, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X glass mat faced gypsum panels applied parallel or at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ⅝" proprietary type X glass mat faced gypsum panels applied parallel to studs with 1⅝" Type S drywall screws 12" o.c. **(NLB)**



Thickness: 3⅛"
Approx. Weight: 8.5 psf
Fire Test: UL R6937, 09CA38295, 10-27-09, UL Design V493

PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland	-	1" GreenGlass Gypsum Liner Board
	-	⅝" GreenGlass Type X

GA FILE NO. WP 7024.3

PROPRIETARY*

1 HOUR FIRE

GYPSUM PANEL PRODUCTS, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ⅝" proprietary type X gypsum wallboard applied parallel to studs with 1⅝" Type S drywall screws 12" o.c. **(NLB)**



Thickness: 3⅛"
Approx. Weight: 8.5 psf
Fire Test: UL R6937, 09CA38295, 10-27-09, UL Design V493

PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland	-	1" SilentGuard Liner Board
	-	⅝" Type X

GA FILE NO. WP 7051

PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H OR C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H or C-T studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard applied at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ½" proprietary type X gypsum wallboard applied parallel to studs with 1⅝" Type S drywall screws 12" o.c.

Sound tested with 1⅞" glass fiber insulation in stud space. **(NLB)**



Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R7094, 93NK8151, 9-14-93; UL R3660, 07NK22992, 2-18-08; UL Design U428
Sound Test: RAL TL93-181, 7-1-93

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	-	½" CertainTeed® Type C Gypsum Board
	-	1" GlasRoc® Shaftliner Gypsum Panels
Lafarge North America Inc.	-	½" Firecheck® Type C
	-	1" Mold Defense® Shaftliner
National Gypsum Company	-	½" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
		1" Gold Bond® Brand FIRE-SHIELD® Shaftliner
PABCO Gypsum	-	½" FLAME CURB® Super 'C'™
	-	1" PABCORE® Gypsum Liner Board
Temple-Inland	-	½" TG-C
	-	1" Silent Guard™ Gypsum Liner Board

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7052 — PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H OR C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H or C-T studs between panels. **Face** layer ½" proprietary type X gypsum wallboard applied parallel to studs with vertical joints midway between studs and laminated to proprietary gypsum panels with 4" wide strips of taping compound at wallboard perimeter and vertical centerline. 1½" Type G drywall screws 24" o.c. located 1½" back from wallboard edges and at vertical centerline.

OPPOSITE SIDE: One layer ½" proprietary type X gypsum wallboard applied at right angles to studs with 1" Type S drywall screws 24" o.c.

Sound tested with 1⅞" glass fiber insulation in stud space. **(NLB)**



Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: See WP 7051 (UL R7094, 93NK8151, 9-14-93, UL Design U429)
Sound Test: See WP 7051 (RAL TL93-181, 7-1-93)

PROPRIETARY GYPSUM BOARD

Lafarge North America Inc.	-	½" Firecheck® Type C
	-	1" Mold Defense® Shaftliner
PABCO Gypsum	-	½" FLAME CURB® Super 'C'™
	-	1" PABCORE® Gypsum Liner Board
Temple-Inland	-	½" TG-C
	-	1" Silent Guard™ Gypsum Liner Board

GA FILE NO. WP 7053 — PROPRIETARY*

2 HOUR FIRE | **50 to 54 FSTC SOUND**

GYPSUM WALLBOARD, STEEL C-H STUDS, MINERAL FIBER INSULATION

One layer 1" x 24" proprietary type X gypsum liner panels inserted between 4" floor and ceiling J runners with H section of 4" proprietary vented C-H steel studs between panels. 3" proprietary mineral fiber insulation, 2.0 pcf, in stud space. When wall height exceeds liner panel length, liner panels are butted to extend to the full height of the wall. Horizontal joints need not be backed by steel framing.

OPPOSITE SIDE: One layer ¾" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1¼" Type S drywall screws 8" o.c. at vertical edges and 12" o.c. at intermediate studs when installed parallel to studs or 8" o.c. at vertical end joints and intermediate studs when applied at right angles to studs. Horizontal joints need not be backed by steel framing. **(NLB)**

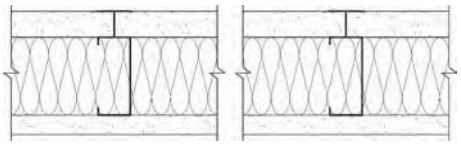

Thickness: 4¾"
Approx. Weight: 8 psf
Fire Test: UL R1319, 97NK33240, 11-20-97, UL Design U415 - System C
Field Sound Test: SA-910913, 9-12-91

PROPRIETARY GYPSUM BOARD

United States Gypsum Company	-	¾" SHEETROCK® Brand ULTRACODE® Core Gypsum Panels
	-	1" SHEETROCK® Brand Gypsum Liner Panels

GA FILE NO. WP 7054 — PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL C-T, OR C-H STUDS

One layer 1" x 24" proprietary type X fiberglass mat gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-T, or C-H studs between panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X fiberglass mat gypsum substrate, fiberglass mat water-resistant gypsum backing board, gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ⅝" proprietary type X fiberglass mat gypsum substrate, fiberglass mat water-resistant gypsum backing board, gypsum wallboard or gypsum veneer base applied parallel to studs with 1⅝" Type S drywall screws 24" o.c. along top and bottom tracks and 12" o.c. at vertical joints and intermediate studs. Face layer joints offset 24" from base layer joints.

Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**

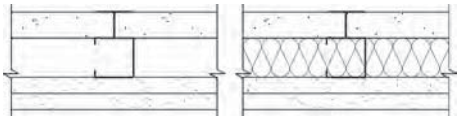

Thickness: 3¾"
Approx. Weight: 9 psf
Fire Test: UL R2717, 08NK012297, 9-11-08, UL Design V473
Sound Test: RAL TL09-358, 12-8-08

PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC	-	⅝" ToughRock® Fireguard® Gypsum Board
	-	1" DensGlass® Shaftliner

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7054.4

PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard applied at right angles to studs with 1" Type S drywall screws 24" o.c. and 6" from floor and ceiling runners. **Face** layer ½" proprietary type X gypsum wallboard applied parallel to studs with 1⅝" Type S drywall screws 12" o.c. and 3" from floor and ceiling runners. Joints offset 24" from base layer joints.

Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**



Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: ITS, 8-30-01, ITS Design GP/WA 120-01
Sound Test: RAL TL09-060, 12-8-09)

PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC
- ½" ToughRock® Fireguard C® Gypsum Board
- 1" DensGlass® Shaftliner

GA FILE NO. WP 7056

PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM BOARD, C-H OR C-T STUDS OR SLOTTED STEEL I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" slotted steel I or C-H or C-T studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ½" proprietary type X gypsum wallboard or veneer base applied parallel to studs with 1⅝" Type S drywall screws 12" o.c.

Sound tested with horizontal resilient channels 24" o.c. and 1" glass fiber insulation friction fit in stud space. **(NLB)**

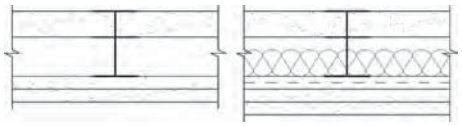

Thickness: 3½" (Fire)
4" (Sound)
Approx. Weight: 9 psf
Fire Test: UL R8701, 98NK33190, 7-12-99, UL Design U417
Sound Test: Estimated, see WP 7057 (WEAL 84-107, 3-16-84)

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.
- ½" CertainTeed® Type C Gypsum Board
- 1" CertainTeed® Shaftliner Type X Gypsum Board

GA FILE NO. WP 7057

PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM BOARD, C-H OR C-T STUDS OR SLOTTED STEEL I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" slotted steel I or C-H or C-T studs between panels. One layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1" Type S drywall screws 12" o.c.

Sound tested with horizontal resilient channels 24" o.c. and 1" glass fiber insulation friction fit in stud space. **(NLB)**

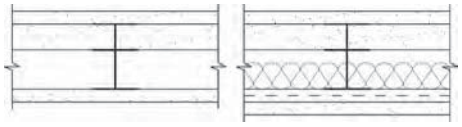

Thickness: 3½" (Fire)
4" (Sound)
Approx. Weight: 9 psf
Fire Test: UL R8701, 98NK33190, 7-12-99, UL Design U417
Sound Test: WEAL 84-107, 3-16-84

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.
- ½" CertainTeed® Type C Gypsum Board
- 1" CertainTeed® Shaftliner Type X Gypsum Board

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7058 — PROPRIETARY* — 2 HOUR FIRE — 50 to 54 STC SOUND

GYPSUM WALLBOARD, STEEL I, C-H, OR C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel I, C-H, or C-T studs between panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to base layer with 1⅝" Type S drywall screws 12" o.c. **(NLB)**

Sound tested with resilient channels 24" o.c. on double layer side and 1½" glass fiber friction fit in stud cavity.

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - ⅝" FireBloc® Type X
- 1" Shaft Liner

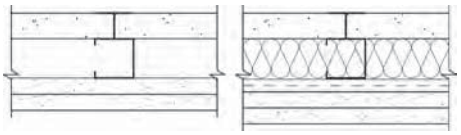

Thickness: 3¾"
Approx. Weight: 9 psf
Fire Test: UL R14196, 05NK29331, 2-18-06, UL Design V455
Sound Test: RAL TL10-359, 11-2-10

GA FILE NO. WP 7059 — PROPRIETARY* — 2 HOUR FIRE — 50 to 54 STC SOUND

GYPSUM PANEL PRODUCTS, STEEL C-T, OR C-H STUDS

One layer 1" x 24" proprietary type X fiberglass mat gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-T, or C-H studs between panels. One layer ⅝" proprietary type X fiberglass mat gypsum substrate, fiberglass mat water-resistant gypsum backing board, gypsum wallboard or gypsum veneer base applied parallel to each side with 1" Type S drywall screws 12" o.c.

Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**

PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC - ⅝" ToughRock® Fireguard® Gypsum Board
- 1" DensGlass® Shaftliner

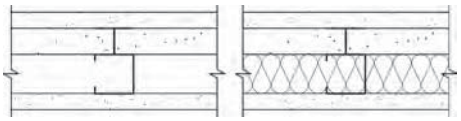

Thickness: 3¾"
Approx. Weight: 9 psf
Fire Test: UL R2717, 08NK012297, 9-11-08 UL Design V473
Sound Test: RAL TL09-358, 12-8-09

GA FILE NO. WP 7060 — PROPRIETARY* — 2 HOUR FIRE — 50 to 54 STC SOUND

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1" Type S drywall screws 24" o.c. **Face** layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1⅝" Type S drywall screws 12" o.c.

Sound tested with horizontal resilient channels 24" o.c. and 1½" glass fiber insulation friction fit in stud space. **(NLB)**

PROPRIETARY GYPSUM BOARD

National Gypsum Company - ⅝" Gold Bond® Brand FIRE-SHIELD® Gypsum Board
- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

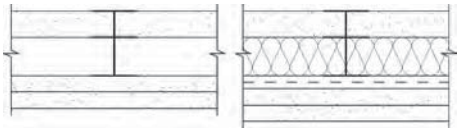

Thickness: 3¾" (Fire)
4¼" (Sound)
Approx. Weight: 9 psf
Fire Test: UC ES-7408, 11-21-75 (Rev 6-76); UL Design U497
Sound Test: KAL 437362, 11-3-76

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7061

PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels. One layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with 1" Type S drywall screws 12" o.c.

Sound tested with horizontal resilient channels 24" o.c. and 1½" glass fiber insulation friction fit in stud space. **(NLB)**

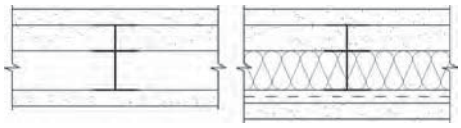

PROPRIETARY GYPSUM BOARD

National Gypsum Company - ⅝" Gold Bond® Brand FIRE-SHIELD® Gypsum Board
- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

Thickness: 3¾" (Fire)
4¼" (Sound)
Approx. Weight: 9 psf
Fire Test: UC ES-7407, 1-22-76; UL Design U498
Sound Test: KAL 437363, 11-4-76

GA FILE NO. WP 7062

PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels. One layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with 1" Type S drywall screws 12" o.c.

Sound tested with horizontal resilient channels 24" o.c. and 1½" glass fiber insulation friction fit in stud space. **(NLB)**

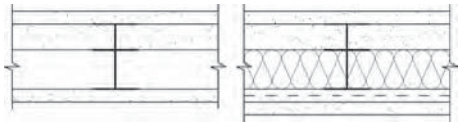

PROPRIETARY GYPSUM BOARD

National Gypsum Company - ½" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

Thickness: 3½" (Fire)
4" (Sound)
Approx. Weight: 9 psf
Fire Test: See WP 7079 (UL R3501, 93NK22748, 9-15-93; 97NK4588, 1-30-97; 97NK5247, 2-4-97; UL Design U498; FM WP-545, 12-22-81)
Sound Test: BBN NGC 2610, 4-15-82

GA FILE NO. WP 7064

PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied either parallel to studs with 1⅝" Type S drywall screws 12" o.c. or at right angles to studs with 1⅝" Type S drywall screws 8" o.c. at wall perimeter and vertical joints and 12" o.c. at intermediate studs.

Sound tested with horizontal resilient channels 24" o.c. and 1½" glass fiber insulation friction fit in stud space. **(NLB)**

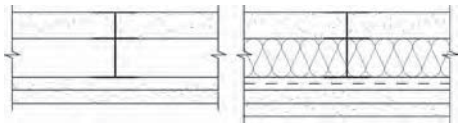

PROPRIETARY GYPSUM BOARD

Lafarge North America Inc. - ½" Firecheck® Type C
National Gypsum Company - ½" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner
Temple-Inland - ½" TG-C

Thickness: 3½" (Fire)
4" (Sound)
Approx. Weight: 9 psf
Fire Test: See WP 7080 (UL R3501, 93NK22748, 9-15-93, UL Design U497; FM WP-636, 10-14-81; WHI-651-0500.05, 3-22-89 & 7-19-89)
Sound Test: BBN NGC 2609, 4-15-82

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7065.2

PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary glass mat type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X glass mat gypsum substrate applied parallel to studs with 1" Type S drywall screws 24" o.c. **Face** layer ⅝" proprietary type X glass mat gypsum substrate applied parallel to studs with 1⅝" Type S drywall screws 12" o.c.

Sound tested with horizontal resilient channels 24" o.c. and 1½" glass fiber insulation friction fit in stud space. **(NLB)**

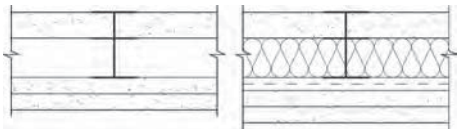

Thickness: 3¾" (Fire)
4¼" (Sound)
Approx. Weight: 9 psf
Fire Test: UL R3501, 08NK58332, 12-12-08; 07NK17992, 12-12-07; UL Design U497
Sound Test: KAL 437362, 11-3-76

PROPRIETARY GYPSUM PANEL PRODUCTS

National Gypsum Company
- ⅝" Gold Bond® Brand e²XP® Interior Extreme® Gypsum Panels
- 1" Gold Bond® Brand e²XP® Extended Exposure FIRE-SHIELD® Shaftliner

GA FILE NO. WP 7065.4

PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X glass mat faced gypsum panels applied parallel or at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ⅝" proprietary type X glass mat faced gypsum panels applied parallel to studs with 1⅝" Type S drywall screws 12" o.c.

Sound tested with 1½" mineral fiber insulation friction fit in stud spaces. **(NLB)**

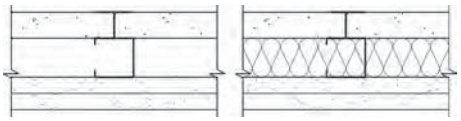

Thickness: 3¾"
Approx. Weight: 8.5 psf
Fire Test: UL R6937, 09CA38295, 10-27-09, UL Design V493
Sound Test: RAL TL08-288B, 10-10-08

PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland
- 1" GreenGlass Gypsum Liner Board
- ⅝" GreenGlass Type X

GA FILE NO. WP 7065.5

PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ⅝" proprietary type X gypsum wallboard applied parallel to studs with 1⅝" Type S drywall screws 12" o.c.

Sound tested with 1½" mineral fiber insulation friction fit in stud spaces. **(NLB)**

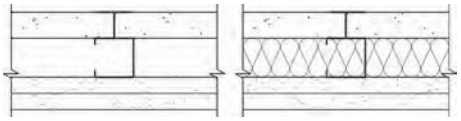

Thickness: 3¾"
Approx. Weight: 8.5 psf
Fire Test: UL R6937, 09CA38295, 10-27-09, UL Design V493
Sound Test: RAL TL08-288B, 10-10-08

PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland
- 1" SilentGuard Liner Board
- ⅝" Type X

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7068

PROPRIETARY*

2 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with H section of 2½" proprietary vented C-H steel studs between panels. One layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1" Type S drywall screws 12" o.c.

Joints staggered 24" on opposite sides. **(NLB)**



PROPRIETARY GYPSUM BOARD

United States Gypsum Company
- ½" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels
- 1" SHEETROCK® Brand Gypsum Liner Panels

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R1319, R11633, 87NK21464, 9-14-87, UL Design U467
Sound Test: See ASW 1205 (BBN 750704, 7-16-75)

GA FILE NO. WP 7071

PROPRIETARY*

2 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard applied at right angles to studs with 1" Type S drywall screws 24" o.c. and 3" from floor and ceiling runners. **Face** layer ½" proprietary type X gypsum wallboard applied parallel to studs with 1⅝" Type S drywall screws 12" o.c. and 6" from floor and ceiling runners.

Sound tested with 1½" mineral fiber insulation friction fit in stud spaces. **(NLB)**



PROPRIETARY GYPSUM BOARD

Lafarge North America Inc.
- ½" Firecheck® Type C
- 1" Mold Defense® Shaftliner

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R18482, 07NK23212, 08/18/08, UL Design V481
Sound Test: RAL TL08-169, 6-18-08

GA FILE NO. WP 7072

PROPRIETARY*

2 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H, C-T, or I studs between panels. One layer ½" proprietary type X gypsum wallboard applied parallel to each side with 1" Type S drywall screws 12" o.c. and 6" from floor and ceiling runners.

Joints staggered 24" on opposite sides. **(NLB)**

Sound tested with 1½" mineral fiber insulation friction fit in stud spaces.



PROPRIETARY GYPSUM BOARD

Lafarge North America Inc.
- ½" Firecheck® Type C
- 1" Mold Defense® Shaftliner

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R18482, 07NK23212, 08/18/08, UL Design V481
Sound Test: RAL TL08-173, 6-23-08

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7073 — PROPRIETARY* — 2 HOUR FIRE — 45 to 49 STC SOUND

GYPSUM PANEL PRODUCTS, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H, C-T, or I studs between panels. One layer ½" proprietary type X gypsum wallboard applied parallel to each side with 1" Type S drywall screws 12" o.c.

Joints staggered 24" on opposite sides. Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC
- ½" ToughRock® Fireguard C® Gypsum Board
- 1" DensGlass® Shaftliner

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: ITS, 8-30-01, ITS Design GP/WA 120-02
Sound Test: RAL TL09-359, 12-8-09

GA FILE NO. WP 7076 — PROPRIETARY* — 2 HOUR FIRE — 45 to 49 STC SOUND

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1⅝" Type S drywall screws 12" o.c.

Sound tested with 2½" glass fiber insulation friction fit in stud space. **(NLB)**

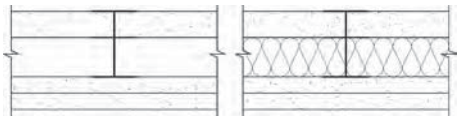

PROPRIETARY GYPSUM BOARD

National Gypsum Company
- ⅝" Gold Bond® Brand FIRE-SHIELD® Gypsum Board
- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

Thickness: 3¾"
Approx. Weight: 8.5 psf
Fire Test: UC ES-7408, 11-21-75 (Rev. 6-76); UL Design U497
Sound Test: NGC 2507, 7-21-75

GA FILE NO. WP 7077 — PROPRIETARY* — 2 HOUR FIRE — 45 to 49 STC SOUND

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels. One layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs on each side with 1" Type S drywall screws 12" o.c.

Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

National Gypsum Company
- ⅝" Gold Bond® Brand FIRE-SHIELD® Gypsum Board
- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

Thickness: 3¾"
Approx. Weight: 8.5 psf
Fire Test: UC ES-7407, 1-22-76; UL Design U498
Sound Test: NGC 2543, 5-18-76

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7078 | **PROPRIETARY*** | **2 HOUR FIRE** | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T or I studs between panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to base layer with 1⅝" Type S drywall screws 12" o.c.

Sound tested with 2½" glass fiber insulation friction fit in stud space. **(NLB)**

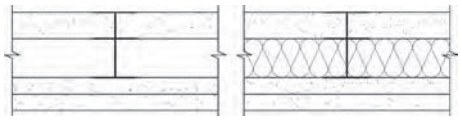

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.
- ⅝" CertainTeed® Type X Gypsum Board
- 1" CertainTeed® Shaftliner Type X Gypsum Board

Thickness: 3¾"
Approx. Weight: 8.5 psf
Fire Test: WHI 495-0091, 12-9-77; WHI 495-0095, 12-16-77; UL R8701, 98NK33190, 7-12-99, UL Design U417
Sound Test: WHI F2, 3-13-78

GA FILE NO. WP 7079 | **PROPRIETARY*** | **2 HOUR FIRE** | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels. One layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with 1" Type S drywall screws 12" o.c.

Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

National Gypsum Company
- ½" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R3501, 93NK22748, 9-15-93;97NK4588, 1-30-97; 97NK5247, 2-4-97; UL Design U498; FM WP-545, 12-22-81
Sound Test: NGC 2617, 7-27-82

GA FILE NO. WP 7080 | **PROPRIETARY*** | **2 HOUR FIRE** | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied either parallel to studs with 1⅝" Type S drywall screws 12" o.c. or at right angles to studs with 1⅝" Type S drywall screws 8" o.c. at wall perimeter and vertical joints and 12" o.c. at intermediate studs.

Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

National Gypsum Company
- ½" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R3501, 93NK22748, 9-15-93, UL Design U497; FM WP-636, 10-14-81; WHI-651-0500.05, 3-22-89 & 7-19-89
Sound Test: NGC 2616, 7-26-82

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7082 — PROPRIETARY* — 2 HOUR FIRE — 45 to 49 STC SOUND

GYPSUM BOARD, SLOTTED STEEL I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" slotted steel I studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1⅝" Type S drywall screws 12" o.c.

Sound tested with 1" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	- ½" CertainTeed™ Type C Gypsum Board
	- 1" CertainTeed® Shaftliner Type X Gypsum Board
PABCO Gypsum	- ½" FLAME CURB® Type XXX
	- 1" PABCORE® Gypsum Liner Board

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: WHI 495-0528, 7-12-83; WHI 495-0566, 11-1-83
Sound Test: See WP 7083 (WEAL 84-108, 3-16-84)

GA FILE NO. WP 7083 — PROPRIETARY* — 2 HOUR FIRE — 45 to 49 STC SOUND

GYPSUM WALLBOARD, SLOTTED STEEL I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" slotted steel I studs between panels. One layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1" Type S drywall screws 12" o.c.

Sound tested with 1" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	- ½" CertainTeed® Type C Gypsum Board
	- 1" CertainTeed® Shaftliner Type X Gypsum Board
PABCO Gypsum	- ½" FLAME CURB® Type XXX
	- 1" PABCORE® Gypsum Liner Board

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: WHI 495-0569, 11-4-83; WHI 495-0570, 11-7-83
Sound Test: WEAL 84-108, 3-16-84

GA FILE NO. WP 7084 — PROPRIETARY* — 2 HOUR FIRE — 45 to 49 STC SOUND

GYPSUM WALLBOARD, STEEL C-H, C-T OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H, C-T, or I studs between panels. One layer ½" proprietary type X gypsum wallboard applied parallel to each side with 1" Type S drywall screws 12" o.c.

Sound tested with 1⅞" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	- ½" CertainTeed® Type C Gypsum Board
	- 1" GlasRoc® Shaftliner Gypsum Panels
Lafarge North America Inc.	- ½" Firecheck® Type C
	- 1" Mold Defense® Shaftliner
National Gypsum Company	- ½" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
	- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner
PABCO Gypsum	- ½" FLAME CURB® Super 'C'™
	- 1" PABCORE® Gypsum Liner Board
Temple-Inland	- ½" TG-C
	- 1" Silent Guard™ Gypsum Liner Board

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R7094, 93NK8151, 9-14-93, UL Design U429; UL R3660, 07NK22992, 2-18-08, UL Design U417
Sound Test: RAL-TL93-182, 7-2-93 WEAL 84-108, 3-16-84

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7095

PROPRIETARY*

2 HOUR FIRE | **45 to 49 FSTC SOUND**

GYPSUM WALLBOARD, STEEL C-H STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with H section of 2½" proprietary vented C-H steel studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1" Type S drywall screws 24" o.c. **Face** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1⅝" Type S drywall screws 12" o.c. Joints offset 24" o.c. from base layer joints.

Sound tested with 1" mineral fiber insulation in cavity. **(NLB)**



Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R1319, 82NK27438, 12-17-82, UL Design U438
Field Sound Test: BBN 750706, 7-16-75

PROPRIETARY GYPSUM BOARD

Lafarge North America Inc. - ½" Firecheck® Type C
United States Gypsum Company - ½" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels
- 1" SHEETROCK® Brand Gypsum Liner Panels

GA FILE NO. WP 7096

PROPRIETARY*

2 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard applied at right angles to studs with 1" Type S drywall screws 24" o.c. and 6" from floor and ceiling runners. **Face** layer ½" proprietary type X gypsum wallboard applied parallel to studs with 1⅝" Type S drywall screws 12" o.c. and 3" from floor and ceiling runners. Joints offset 24" from base layer joints.

Sound tested with 1" glass fiber insulation friction fit in stud space. **(NLB)**



Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R8701, 98NK33190, 7-12-99, UL Design U417
Sound Test: RAL TL89-379, 11-7-89; WEAL 84-108, 3-16-84

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - ½" CertainTeed® Type C Gypsum Board
- 1" CertainTeed® Shaftliner Type X Gypsum Board

GA FILE NO. WP 7097

PROPRIETARY*

2 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H, C-T, or I studs between panels. One layer ½" proprietary type X gypsum wallboard applied parallel to each side with 1" Type S drywall screws 12" o.c.

Joints staggered 24" on opposite sides. Sound tested with 1" glass fiber insulation friction fit in stud space. **(NLB)**



Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R8701, 98NK33190, 7-12-99, UL Design U417
Sound Test: RAL TL89-380, 11-8-89 WEAL 84-108, 3-16-84

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - ½" CertainTeed® Type C Gypsum Board
- 1" CertainTeed® Shaftliner Type X Gypsum Board

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7098 | **PROPRIETARY*** | **2 HOUR FIRE** | **45 to 49 STC SOUND**

GYPSUM BOARD, STEEL C-T OR SLOTTED I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-T or slotted I studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1⅝" Type S drywall screws 12" o.c.

Sound tested with 1" glass fiber friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.
- ½" CertainTeed® Type C Gypsum Board
- 1" CertainTeed® Shaftliner Type X Gypsum Board

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: WHI 495-0528, 7-12-83; WHI 495-0566, 11-1-83; WHI 495-1227, 2-10-93; WHI 495-1244, 6-30-93
Sound Test: See WP 7099 (WEAL 84-108, 3-16-84)

GA FILE NO. WP 7099 | **PROPRIETARY*** | **2 HOUR FIRE** | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL C-T OR SLOTTED I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel C-T or slotted I studs between panels. One layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1" Type S drywall screws 12" o.c.

Sound tested with 1" glass fiber friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.
- ½" CertainTeed® Type C Gypsum Board
- 1" CertainTeed® Shaftliner Type X Gypsum Board

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: WHI 495-0569, 11-4-83; WHI 495-0570, 11-7-83; WHI 495-1225, 2-8-93; WHI 495-1245, 7-1-93
Sound Test: WEAL 84-108, 3-16-84

GA FILE NO. WP 7118 | **PROPRIETARY*** | **2 HOUR FIRE** | **35 to 39 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H, C-T, or I studs between panels. One layer ½" proprietary type X gypsum wallboard applied parallel to each side with 1" Type S drywall screws 12" o.c. and 6" from floor and ceiling runners.

Joints staggered 24" on opposite sides. **(NLB)**



PROPRIETARY GYPSUM BOARD

Lafarge North America Inc.
- ½" Firecheck® Type C
- 1" Mold Defense® Shaftliner

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R18482, 07NK23212, 08/18/08, UL Design V481
Sound Test: RAL TL08-174, 6-24-08

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7119 — PROPRIETARY*

2 HOUR FIRE | **35 to 39 STC SOUND**

GYPSUM WALLBOARD, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard applied at right angles to studs with 1" Type S drywall screws 24" o.c. and 3" from floor and ceiling runners. **Face** layer ½" proprietary type X gypsum wallboard applied parallel to studs with 1⅝" Type S drywall screws 12" o.c. and 6" from floor and ceiling runners. **(NLB)**

PROPRIETARY GYPSUM BOARD

Lafarge North America Inc.	-	½" Firecheck® Type C
	-	1" Mold Defense® Shaftliner



Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R18482, 07NK23212, 08/18/08, UL Design V481
Sound Test: RAL TL08-168, 6-17-08

GA FILE NO. WP 7125 — GENERIC

2 HOUR FIRE | **35 to 39 STC SOUND**

GYPSUM WALLBOARD, STEEL STUDS

Base layer ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles to ONE SIDE ONLY of 1⅝" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. **Second** layer ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles with two 1⅝" Type S drywall screws per board. **Third** layer ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles with two 2⅝" Type S drywall screws per board and one 2⅝" Type S drywall screws placed midway between studs at floor and ceiling runners. Steel strips 0.020" x 1½" wide vertically applied over third layer at vertical joints and intermediate studs with 2⅝" Type S drywall screws 12" o.c. **Fourth** layer ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles to steel strips with 1" Type S drywall screws 8" o.c.

Joints offset 24" between layers. **(NLB)**

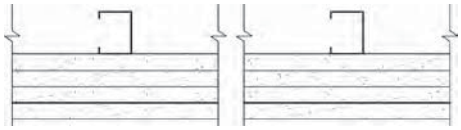

Thickness: 4⅛"
Limiting Height: 12'0"
Approx. Weight: 9.5 psf
Fire Test: GET, 4-13-70
Sound Test: KG 634, 4-1-70

GA FILE NO. WP 7210 — GENERIC

2 HOUR FIRE | **30 to 34 STC SOUND**

SOLID GYPSUM WALLBOARD, STEEL BRACING

Steel angles, 22 ga, ¾" x 1¼", attached to floor. Steel angles, 22 ga, ¾" x 1¼" x 30" long, attached to end walls and spaced not more than 5 feet o.c. Ceiling channel, 25 ga, 1" deep by 1⅝" wide, attached to ceiling. One leg of the ceiling channel is aligned with 1¼" leg of the wall angles and oriented so the first two layers of gypsum board can be inserted into the runner. Hoirizontal bracing angles, 22 ga, ¾" x 1¼", spaced 5 feet o.c. with 1¼" leg attached to 1¼" leg of wall angles. **Base** layer ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles without horizontal joints to horizontal bracing with top edge inserted in ceiling channel and attached to floor, wall, and bracing angles with 1" Type S drywall screws 16" o.c. **Second** layer 1" gypsum board panels applied at right angles without horizontal joints to horizontal bracing with laminating compound combed over the entire contact surface and with top edge inserted into ceiling channel and attached to floor, wall, and bracing angles with 2¼" Type S-12 drywall screws 12" o.c. Additional floor and wall angles attached to floor and end walls with 1¼" leg flat against the gypsum board. Laminating compound combed over the entire contact surface. **Face** layer ⅝" type X gypsum wallboard or gypsum veneer base applied at right angles without horizontal joints horizontal to bracing with laminating compound combed over the entire contact surface and attached to ceiling channel and floor, and wall angles with 1" Type S drywall screws 16" o.c. **(NLB)**

†Limiting height shown is based on interior partition exposure conditions. Shaft wall exposure conditions may require reduction of limiting height.



Thickness: 2¼"
Limiting Height: 11'0"†
Approx. Weight: 9 psf
Fire Test: UL R1319-58, 74, 12-29-64, UL Design U505
Sound Test: Estimated

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7254 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM PANEL PRODUCTS, STEEL I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with tab-flange section of 2½" steel I studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard applied at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ½" proprietary type X gypsum wallboard applied parallel to studs with 1⅝" Type S drywall screws 12" o.c. **(NLB)**



PROPRIETARY GYPSUM PANEL PRODUCTS

American Gypsum Company LLC	-	½" FireBloc® Type C
	-	1" Shaft Liner
CertainTeed Gypsum Inc.	-	½" CertainTeed® Type C Gypsum Board
	-	1" GlasRoc® Shaftliner Gypsum Panels
Temple-Inland	-	½" TG-C
	-	1" Silent Guard™ Gypsum Liner Board

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R14196, 04NK4991, 2-10-04; UL R3660, 07NK22992, 2-18-08; UL Design V433 - System A

GA FILE NO. WP 7255 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM PANEL PRODUCTS, STEEL I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with tab-flange section of 2½" steel I studs between panels. One layer ½" proprietary type X gypsum wallboard applied parallel to each side with 1" Type S drywall screws 12" o.c. **(NLB)**



PROPRIETARY GYPSUM PANEL PRODUCTS

American Gypsum Company LLC	-	½" FireBloc® Type C
	-	1" Shaft Liner
CertainTeed Gypsum Inc.	-	½" CertainTeed® Type C Gypsum Board
	-	1" GlasRoc® Shaftliner Gypsum Panels
Temple-Inland	-	½" TG-C
	-	1" Silent Guard™ Gypsum Liner Board

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R14196, 04NK4991, 2-10-04; UL R3660, 07NK22992, 2-18-08; UL Design V433 - System B

GA FILE NO. WP 7257 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL I, C-H, OR C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel I, C-H, or C-T studs between panels. One layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1" Type S drywall screws 12" o.c. **(NLB)**



PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	⅝" FireBloc® Type X
	-	1" Shaft Liner

Thickness: 3¾"
Approx. Weight: 9 psf
Fire Test: UL R14196, 05NK29331, 2-18-06, UL Design V455

Contact the manufacturer for more detailed information on proprietary products.

SHAFT WALLS

GA FILE NO. WP 7259 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM PANEL PRODUCTS, STEEL C-H OR C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H or C-T studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard applied at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ½" proprietary type X gypsum wallboard applied parallel to studs with 1⅝" Type S drywall screws 12" o.c. **(NLB)**



PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland	-	½" TG-C
	-	1" GreenGlass Gypsum Liner Panel

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R6937, 08NK02787, 9-19-08, UL Design U428

GA FILE NO. WP 7260 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL C-H STUDS

One layer 1" x 24" proprietary type X gypsum liner panels applied parallel to 4" steel C-H studs spaced vertically 24" o.c. Steel C-H studs oriented horizontally and either supported by 2" x 2" 20 ga steel angles attached to vertical J track at each end of the wall or screw attached to the runners with ½" long panhead screws, one at each end on each side of the wall. Wall width is limited by the length of the gypsum liner panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S or S-12 drywall screws 12" o.c. **Face** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S or S-12 drywall screws 12" o.c. **(NLB)**



PROPRIETARY GYPSUM BOARD

United States Gypsum Company	-	⅝" SHEETROCK® Brand FIRECODE® Core Gypsum Panels
		1" SHEETROCK® Brand Gypsum Liner Panels

Thickness: 5¼"
Approx. Weight: 12 psf
Fire Test: UL R1319, 04NK2667, 2-10-04; UL R1319, 04NK2664, 3-2-04; UL Design U437

GA FILE NO. WP 7261 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL C-H OR C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H or C-T studs between panels. One layer ½" proprietary type X gypsum wallboard applied parallel or at right angles to each side with 1" Type S drywall screws 12" o.c. **(NLB)**



PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland	-	½" TG-C
	-	1" GreenGlass Gypsum Liner Board

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R6937, 08NK02787, 9-19-08, UL Design U429

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7262 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM PANEL PRODUCTS, STEEL I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with tab-flange section of 2½" steel I studs between panels.

OPPOSITE SIDE: **Base** layer ½" proprietary type X gypsum wallboard applied at right angles to studs with 1" Type S drywall screws 24" o.c. **Face** layer ½" proprietary type X gypsum wallboard applied parallel to studs with 1⅝" Type S drywall screws 12" o.c. **(NLB)**



PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland - ½" TG-C
- 1" GreenGlass Gypsum Liner Board

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R6937, 08NK02787, 9-19-08, UL Design V433 - System A

GA FILE NO. WP 7263 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM PANEL PRODUCTS, STEEL I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with tab-flange section of 2½" steel I studs between panels. One layer ½" proprietary type X gypsum wallboard applied parallel to each side with 1" Type S drywall screws 12" o.c. **(NLB)**



PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland - ½" TG-C
- 1" GreenGlass Gypsum Liner Board

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R6937, 08NK02787, 9-19-08, UL Design V433 - System B

GA FILE NO. WP 7264 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM WALLBOARD, CEMENTITIOUS BACKER UNITS, STEEL C-H STUDS

One layer 1" x 24" proprietary type X gypsum liner panels inserted between 2½" floor and ceiling J runners with H section of 2½" 20 ga proprietary vented C-H steel studs between panels. 1½" mineral fiber insulation in stud space. When wall height exceeds liner panel length, liner panels are butted to extend to the full height of the wall. Horizontal joint need not be backed by steel framing.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" long Type S drywall screws 24" o.c. when applied parallel to studs or 16" o.c. when applied at right angles to studs **Face** layer ½" or ⅝" proprietary cementitious backer units applied parallel or at right angles to studs with 1⅝" long Type S wafer head screws spaced 8" o.c. Vertical joints offset one stud cavity from gypsum wallboard joints. Horizontal joints offset not less than 12" from gypsum wallboard joints. **(NLB)**



PROPRIETARY GYPSUM BOARD

United States Gypsum Company - ⅝" SHEETROCK® Brand FIRECODE® Core Gypsum Panels
- 1" SHEETROCK® Brand Gypsum Liner Panels

Thickness: 3⅝"
Approx. Weight: 10 psf
Fire Test: UL R1319, 97NK33240, 7-29-86, UL Design U415 - System D

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7265 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM PANEL PRODUCTS, STEEL C-H STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with H section of 2½" steel C-H studs between panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1" Type S drywall screws 24" o.c. **Face** layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1⅝" Type S drywall screws 12" o.c. Face layer joints offset 24" from base layer joints. **(NLB)**



PROPRIETARY GYPSUM BOARD

United States Gypsum Company - ⅝" SHEETROCK® Brand UltraLight Panels FIRECODE® X
- 1" SHEETROCK® Brand Glass-Mat Liner Panels

Thickness: 3¾"
Approx. Weight: 9 psf
Fire Test: UL R61319, 11NK08543, 6-17-11, UL Design U415, System B & UL Design U438

GA FILE NO. WP 7400 — PROPRIETARY* — 3 HOUR FIRE — 50 to 54 STC SOUND

GYPSUM WALLBOARD, FURRING CHANNELS, STEEL C-H STUDS

One layer 1" x 24" proprietary type X gypsum liner panels inserted between 2½" floor and ceiling runners with H section of 2½" proprietary vented C-H steel studs between panels. When wall height exceeds liner panel length, liner panels are butted to extend to the full height of the wall. Horizontal joints need not be backed by steel framing.

OPPOSITE SIDE: **First** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws spaced 24" o.c. when applied parallel to studs or 16" o.c. when applied at right angles to studs. **Second** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1⅝" Type S drywall screws spaced 24" o.c. when applied parallel to studs or 16" o.c. when applied at right angles to studs. **Face** layer ⅝" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 2¼" Type S drywall screws spaced 16" o.c. when applied parallel to studs or 12" o.c. when applied at right angles to studs. Screws offset 6" from screws in layer below. Horizontal joints in adjacent layers offset not less than 12". Horizontal joints need not be backed by steel framing. Vertical joints centered over studs and offset 24" between adjacent layers.

Sound tested using 4" C-H studs and 3" mineral fiber sound attenuation blankets in cavity. **(NLB)**

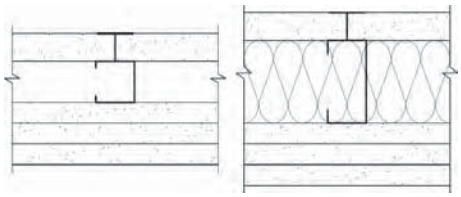

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - ⅝" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels
- 1" SHEETROCK® Brand Gypsum Liner Panels

Thickness: 4⅜" (Fire)
5⅞" (Sound)
Approx. Weight: 13 psf
Fire Test: UL R1319, 97NK33240, 4-29-96, UL Design U415 - System G
Sound Test: RAL OT04-018, 9-4-04

GA FILE NO. WP 7422 — PROPRIETARY* — 3 HOUR FIRE — 50 to 54 STC SOUND

GYPSUM PANEL PRODUCTS, METAL C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-T studs between panels.

OPPOSITE SIDE: **Base** layer ⅝" proprietary type X gypsum wallboard applied at right angles to studs with 1" Type S drywall screws 24" o.c. **Second** layer ⅝" proprietary type X gypsum wallboard applied at right angles to studs with 1⅝" Type S drywall screws 16" o.c. at studs and 1½" Type G drywall screws 16" o.c. placed 2" back on either side of vertical joints. **Face** layer ⅝" proprietary type X gypsum wallboard applied parallel to studs with 2¼" Type S drywall screws 12" o.c. at studs and 1½" Type G drywall screws 12" o.c. placed 2" back on either side of horizontal joints.

Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**

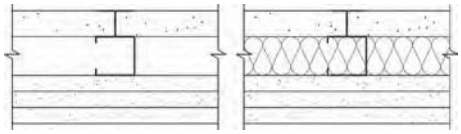

PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC - ⅝" ToughRock® Fireguard C® Gypsum Board
- 1" DensGlass® Shaftliner

Thickness: 4⅜"
Approx. Weight: 12 psf
Fire Test: ITS, 8-30-01, ITS Design GP/WA 180-01
Sound Test: RAL TL09-360, 12-8-09

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7454

PROPRIETARY*

3 HOUR FIRE

45 to 49 FSTC SOUND

GYPSUM WALLBOARD, STEEL STUDS

One layer 1" x 24" proprietary type X gypsum liner panels inserted between 4" floor and ceiling J runners with H section of 4" C-H steel studs between panels. When wall height exceeds liner panel length, liner panels are butted to extend to the full height of the wall. Horizontal joints need not be backed by steel framing. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to framing on gypsum liner panel side with 1" Type S drywall screws 16" o.c. when applied parallel to studs or 12" o.c. when applied at right angles to studs.

OPPOSITE SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 24" o.c. when applied parallel to studs or 16" o.c. when applied at right angles to studs. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1 5/8" Type S drywall screws 16" o.c. when applied parallel to studs or 12" o.c. when applied at right angles to studs.

Sound tested using 4" C-H studs. **(NLB)**

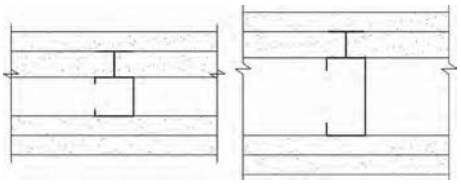

Thickness: 4 3/8" (Fire)
5 7/8" (Sound)
Approx. Weight: 12 psf
Fire Test: UL R1319, 97NK33240, 4-26-96, UL Design U415 - System H
Field Sound Test: USG 040902, 9-1-04

PROPRIETARY GYPSUM BOARD

United States Gypsum Company
- 5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels
- 1" SHEETROCK® Brand Gypsum Liner Panels

GA FILE NO. WP 7492

PROPRIETARY*

3 HOUR FIRE

GYPSUM WALLBOARD, FURRING CHANNELS, STEEL C-T, C-H, or I STUDS

One layer 1" x 24" proprietary type X gypsum liner panels inserted between 2 1/2" floor and ceiling J runners with tab-flange section of 2 1/2" steel C-T, C-H, or I studs between panels.

OPPOSITE SIDE: **First** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1" Type S drywall screws 24" o.c. **Second** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1 5/8" Type S drywall screws spaced 24" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 2 1/4" Type S drywall screws spaced 24" o.c. on perimeter and 16" o.c. in the field. Joints offset not less than 12" between layers. Horizontal joints need not be backed by framing. **(NLB)**



Thickness: 4 3/8"
Approx. Weight: 12 psf
Fire Test: UL R18482, 09CA16342, 8-19-09, UL Design V481 - System H

PROPRIETARY GYPSUM BOARD

Lafarge North America Inc.
- 5/8" Firecheck® Type C
- 1" Mold Defense® Shaftliner

**Contact the manufacturer for more detailed information on proprietary products.*

SHAFT WALLS

GA FILE NO. WP 7690

PROPRIETARY*

4 HOUR FIRE

GYPSUM WALLBOARD, FURRING CHANNELS, STEEL C-H STUDS

One layer 1" x 24" proprietary type X gypsum liner panels inserted between 2½" floor and ceiling runners with H section of 2½" proprietary vented C-H steel studs between panels. When wall height exceeds liner panel length, liner panels are butted to extend to the full height of the wall. Horizontal joints need not be backed by steel framing.

OPPOSITE SIDE: **First** layer ¾" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 1¼" Type S drywall screws 24" o.c. **Second** layer ¾" proprietary type X gypsum wallboard applied parallel or at right angles to studs with 2¼" Type S drywall screws 12" o.c. Horizontal joints need not be backed by steel framing. When second layer is applied parallel to studs, vertical joints shall be centered over studs and offset not less than 24" from base layer joint; otherwise all joints shall be offset not less than 12". Rigid furring channels 24" o.c. applied at right angles to studs with 2" Type S-12 pan head screws. Screws alternate from top flange to bottom flange at each stud intersection. **Third** layer ¾" proprietary type X gypsum wallboard applied at right angles to channels with 1¼" Type S drywall screws 12" o.c. **Face** layer ¾" proprietary type X gypsum wallboard applied parallel or at right angles to channels with 2¼" Type S drywall screws 12" o.c. Joints offset 24" from third layer joints. When face layer is applied parallel to studs, vertical joints shall be centered over studs and offset not less than 24" from base layer joint; otherwise all joints shall be offset not less than 12" **(NLB)**



Thickness: 6⅜"
Approx. Weight: 18 psf
Fire Test: UL R1319, 97NK33240, 4-29-96, UL Design U415 - System I

PROPRIETARY GYPSUM BOARD

United States Gypsum Company
- ¾" SHEETROCK® Brand ULTRACODE® Core Gypsum Panels
- 1" SHEETROCK® Brand Gypsum Liner Panels

GA FILE NO. WP 7691

PROPRIETARY*

4 HOUR FIRE

GYPSUM WALLBOARD, FURRING CHANNELS, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 4" floor and ceiling runners with tab-flange section of 4" steel C-H, C-T, or I studs between panels.

OPPOSITE SIDE: **First** layer ⅝" proprietary type X gypsum wallboard applied parallel to studs with 1⅛" Type S drywall screws 12" o.c. **Second** layer ⅝" proprietary type X gypsum wallboard applied parallel to studs with 1⅝" Type S drywall screws 12" o.c. and to the first layer with 1½" Type G drywall screws 8" o.c. on both sides of horizontal joints. **Third** layer ⅝" proprietary type X gypsum wallboard applied parallel to studs with 2¼" Type S drywall screws 12" o.c. and to the second layer with 1½" Type G drywall screws 12" o.c. vertically and centered between the studs, and spaced 8" o.c. on both sides of horizontal joints. Rigid furring channels spaced 16" o.c. applied at right angles to studs with 2¼" Type S drywall screws alternating top flange to bottom flange at each stud intersection. **Fourth** layer ⅝" proprietary type X gypsum wallboard applied at right angles to channels with 1⅛" Type S drywall screws 12" o.c. in the field of the board and 8" o.c. on either side of horizontal joints centered on the channels. **Face** layer ⅝" proprietary type X gypsum wallboard applied at right angles to channels with 1⅝" Type S drywall screws 12" o.c. in the field of the board and 8" o.c. on either side of horizontal joints centered on the channels, and to the fourth layer with 1½" Type G drywall screws 16" o.c. along the vertical joints and centered between the furring channels. Vertical joints and horizontal butt joints offset 24" between layers. **(NLB)**

Thickness: 8"
Approx. Weight: 16.5 psf
Fire Test: UL R3501, 05NK04286, 6-14-05; UL R3501, 05NK13523, 5-18-05; UL Design V451

PROPRIETARY GYPSUM BOARD

National Gypsum Company
- ⅝" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

**Contact the manufacturer for more detailed information on proprietary products.*

EXTERIOR WALLS

GA FILE NO. WP 7920

PROPRIETARY*

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL STUDS

EXTERIOR SIDE: One layer 5/8" proprietary type X gypsum sheathing or glass mat gypsum substrate (sheathing) applied parallel to each side of 3 5/8" steel studs 24" o.c. with 1" Type S corrosion resistant drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs. Joints caulked with flexible, non-hardening building sealant or covered with weather exposed cladding or finish system.

INTERIOR SIDE: One layer 5/8" proprietary type X paper faced or glass mat faced gypsum panel product (sound board) applied parallel to studs with 1" Type S drywall screws 8" o.c. at vertical joints and 12" o.c. at intermediate studs.

Joints staggered 24" on opposie sides. Sound tested with 3 1/2" glass fiber insulation in stud cavity. **(NLB)**

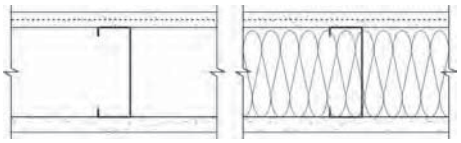

Thickness: 4 7/8"
Approx. Weight: 6 psf
Fire Test: UL R6937, 06NK17962, 2-17-07; 09NK05706, 4-13-09; UL Design U465
Sound Test: OL 08-0911, 9-4-08

PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland	-	5/8" Type X
	-	5/8" Type X ComfortGuard Sound Deadening Gypsum Board

GA FILE NO. WP 8002

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, MINERAL FIBER INSULATION, CEMENTITIOUS BACKER UNITS, STEEL STUDS

EXTERIOR SIDE: One layer 1/2" proprietary cementitious backer units applied parallel to 3 5/8" 20 ga steel studs 16" o.c. with 1" corrosion resistant Type S-12 wafer head screws 8" o.c. A weather resistive barrier must be installed behind the cementitious backer unit. 3" mineral fiber friction fit in stud space.

INTERIOR SIDE: One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1" Type S-12 drywall screws 8" o.c. at vertical joints and floor and ceiling runners and 12" o.c. at intermediate studs. Joints taped. 3/32" of gypsum veneer plaster when gypsum veneer base is used. Lateral support for framing members as required. **(NLB)**



Thickness: 4 5/8"
Approx. Weight: 7 psf
Fire Test: UL R12262, 96NK4276, 5-1-96, UL Design U404

PROPRIETARY GYPSUM BOARD

United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels

GA FILE NO. WP 8004

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS, MINERAL FIBER INSULATION, FIBER-CEMENT BOARD

EXTERIOR SIDE: One layer 7/16" proprietary fiber-cement board applied parallel to 3 5/8" steel studs 16" o.c. with 1" No. 8-18 x 0.323" head diameter ribbed bugle head screws 6" o.c. 3 1/2" mineral fiber insulation batts or blankets, 3.0 pcf, in stud space.

INTERIOR SIDE: One layer 5/8" proprietary type X gypsum wallboard applied parallel to studs with 1" Type S drywall screws 8" o.c. at edges and 12" o.c. at intermediate framing. **(NLB)**



Thickness: 4 3/4"
Approx. Weight: 7.5 psf
Fire Test: OPL 11710-92783, 2-13-92

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type X Gypsum Board

**Contact the manufacturer for more detailed information on proprietary products.*

EXTERIOR WALLS

GA FILE NO. WP 8005

PROPRIETARY*

1 HOUR FIRE

GLASS MAT GYPSUM SUBSTRATE, STEEL STUDS

EXTERIOR SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate (sheathing) applied parallel or at right angles to 3 5/8" steel studs 24" o.c. with 1" Type S corrosion resistant screws 8" o.c. at vertical studs and 12" o.c. at perimeter runners. Joints caulked with flexible, non-hardening building sealant or covered with weather exposed cladding or finish system.

INTERIOR SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate, glass mat water-resistant gypsum backing board, gypsum wallboard, water-resistant gypsum backing board, or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. at studs and 12" o.c. at floor and ceiling runners. **(NLB)**



Thickness: 4 7/8"
Approx. Weight: 6 psf
Fire Test: CTC 2171-3996, 7-12-90

PROPRIETARY GYPSUM PANEL PRODUCT

Georgia Pacific Gypsum LLC	- 5/8" DensGlass® Fireguard® Sheathing
	- 5/8" DensArmor Plus® Fireguard® Interior Panel

GA FILE NO. WP 8006

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, GLASS MAT GYPSUM SUBSTRATE, STEEL STUDS, MINERAL OR GLASS FIBER INSULATION

EXTERIOR SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate (sheathing) applied parallel to 3 1/2" 20 ga steel studs 24" o.c. with 1" Type S-12, self-drilling, corrosion resistant, bugle head, drywall screws 12" o.c. Studs attached to both vertical legs of floor and ceiling runners either by welding or with 1/2" Type S-12 pan head screws. Mineral or glass fiber insulation friction fit into the stud space. Exterior cladding to be attached through glass mat gypsum panel to studs.

INTERIOR SIDE: One layer 5/8" proprietary type X gypsum board applied parallel to studs with 1" Type S-12 drywall screws 12" o.c.

Bracing: Lateral bracing spaced not over 40" o.c. shall be 1" by 18 ga steel straps attached to each side or channel bracing attached to each stud with a clip angle. For studs with holes or punch-outs in the web the "Q" factor shall be determined by means of stub column tests. Tested at 100 percent of design load. **(LOAD-BEARING)**



FIRE SIDE

Thickness: 4 3/4"
Approx. Weight: 6 psf
Fire Test: UL R3660/R15187, 01NK21103, 2-4-02; ULR6937, 07NK08079, 9-19-08; UL Design U425

PROPRIETARY GYPSUM PANEL PRODUCTS

American Gypsum Company, LLC	- 5/8" FireBloc® Type X
	- 5/8" M-Glass® Type X Exterior Sheathing
CertainTeed Gypsum Inc.	- 5/8" CertainTeed® Type X Gypsum Board
	- 5/8" GlasRoc® Sheathing Type X Gypsum Panels
CertainTeed Gypsum Canada Inc.	- 5/8" CertainTeed® Type X Gypsum Board
Lafarge North America Inc.	- 5/8" Firecheck® Type X
	- 5/8" Weather Defense® Platinum Sheathing
Georgia Pacific Gypsum LLC	- 5/8" ToughRock® Fireguard® Gypsum Board
	- 5/8" DensGlass® Fireguard® Sheathing
National Gypsum Company	- 5/8" e²XP® FIRE-SHIELD® Gypsum Sheathing
	- 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board
PABCO Gypsum	- 5/8" FLAME CURB® Type X
	- 5/8" PABCO GLASS™ Sheathing Type X
Temple-Inland	- 5/8" GreenGlass Type X
	- 5/8" Type X

**Contact the manufacturer for more detailed information on proprietary products.*

EXTERIOR WALLS

GA FILE NO. WP 8007 — PROPRIETARY* — 1 HOUR FIRE

GYPSUM WALLBOARD, GLASS MAT GYPSUM SUBSTRATE, STEEL STUDS

EXTERIOR SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate (sheathing) applied parallel or at right angles to 3 5/8" steel studs 24" o.c. with 1" Type S corrosion resistant screws 8" o.c. at vertical studs and 12" o.c. at perimeter runners. Joints caulked with flexible, non-hardening building sealant or covered with weather exposed cladding or finish system.

INTERIOR SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate, glass mat water-resistant gypsum backing board, gypsum wallboard, water-resistant gypsum backing board, or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. at studs and 12" o.c. at floor and ceiling runners. **(NLB)**



Thickness: 4 7/8"
Approx. Weight: 6 psf
Fire Test: UL R6937, 06NK17962, 2-17-07, UL Design U465

PROPRIETARY GYPSUM PANEL PRODUCT

Georgia Pacific Gypsum LLC	-	5/8" DensArmor Plus® Fireguard® Interior Panel
	-	5/8" DensGlass® Fireguard® Sheathing
Temple-Inland	-	5/8" GreenGlass Type X
	-	5/8" Type X

GA FILE NO. WP 8008 — PROPRIETARY* — 1 HOUR FIRE

GLASS MAT GYPSUM SUBSTRATE, STEEL STUDS, MINERAL OR GLASS FIBER INSULATION

EXTERIOR SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate (sheathing) applied parallel to 3 1/2" 20 ga steel studs 24" o.c. with 1" Type S-12, self-drilling, corrosion resistant, bugle head, drywall screws 12" o.c. Studs attached to both vertical legs of floor and ceiling runners either by welding or with 1/2" Type S-12 pan head screws. Mineral or glass fiber insulation friction fit into the stud space. Exterior cladding to be attached through glass mat gypsum panel to studs.

INTERIOR SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate applied parallel to studs with 1" Type S-12 drywall screws 12" o.c.

Bracing: Lateral bracing spaced not over 40" o.c. shall be 1" by 18 ga steel straps attached to each side or channel bracing attached to each stud with a clip angle. For studs with holes or punch-outs in the web the "Q" factor shall be determined by means of stub column tests. Tested at 100 percent of design load. **(LOAD-BEARING)**



FIRE SIDE

Thickness: 4 3/4"
Approx. Weight: 6 psf
Fire Test: UL R3501, 07NK179922, 12-12-07, UL Design U425

PROPRIETARY GYPSUM PANEL PRODUCTS

National Gypsum Company	-	5/8" Gold Bond® Brand e²XP® FIRE-SHIELD® Gypsum Sheathing
	-	5/8" Gold Bond® Brand e²XP® Interior Extreme® Gypsum Panels

GA FILE NO. WP 8105 — GENERIC — 1 HOUR FIRE

GYPSUM WALLBOARD, GYPSUM SHEATHING, WOOD STUDS

EXTERIOR SIDE: One layer 48" wide 5/8" type X gypsum sheathing applied parallel to 2 x 4 wood studs 24" o.c. with 1 3/4" galvanized roofing nails 4" o.c. at vertical joints and 7" o.c. at intermediate studs and top and bottom plates. Joints of gypsum sheathing may be left untreated. Exterior cladding to be attached through sheathing to studs.

INTERIOR SIDE: One layer 5/8" type X gypsum wallboard, water-resistant gypsum backing board, or gypsum veneer base applied parallel or at right angles to studs with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c. **(LOAD-BEARING)**



Thickness: Varies
Approx. Weight: 7 psf
Fire Test: See WP 3510 (UL R3501-47, -48, 9-17-65, UL Design U309; UL R1319-129, 7-22-70, UL Design U314)

**Contact the manufacturer for more detailed information on proprietary products.*

EXTERIOR WALLS

GA FILE NO. WP 8109

PROPRIETARY*

1 HOUR FIRE

GYPSUM PANEL PRODUCTS, FIBER-CEMENT SIDING, WOOD STUDS

EXTERIOR SIDE: **Base** layer 5/8" proprietary type X gypsum sheathing or glass mat gypsum substrate applied parallel to 2 x 4 wood studs 16" o.c. with 1 3/4" galvanized roofing nails 4" o.c. at vertical joints and 7" o.c. at intermediate studs and top and bottom plates. Joints of gypsum sheathing may be left untreated. **Face** layer 1/4" proprietary fiber-cement siding fastened through sheathing to studs. 3 1/2" unfaced glass fiber friction fit in stud space.

INTERIOR SIDE: One layer 5/8" proprietary type X gypsum wallboard, glass mat gypsum substrate, water-resistant gypsum backing board, or gypsum veneer base applied parallel or at right angles to studs with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c. **(LOAD BEARING)**



Thickness: 5 1/8"
Approx. Weight: 9 psf
Fire Test: See WP 3510 (UL R3501-47, -48, 9-17-65, UL Design U309; UL R-1319-129, 7-22-70, UL Design U314)

PROPRIETARY GYPSUM PANEL PRODUCTS

American Gypsum Company LLC	- 5/8" FireBloc® Type X
	- 5/8" Exterior Sheathing Type X
CertainTeed Gypsum Inc.	- 5/8" CertainTeed® Type X Gypsum Board
	- 5/8" GlasRoc® Sheathing Type X Gypsum Panels
Georgia Pacific Gypsum LLC	- 5/8" DensArmor Plus® Fireguard® Interior Panel
	- 5/8" DensGlass® Fireguard® Sheathing
Lafarge North America Inc.	- 5/8" Firecheck® Type X
	- 5/8" Weather Defense® Platinum Sheathing
National Gypsum Company	- 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board
	- 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Sheathing
PABCO Gypsum	- 5/8" FLAME CURB® Type X
	- 5/8" Exterior Gypsum Sheathing Type X
Temple-Inland	- 5/8" Type X
	- 5/8" GreenGlass Type X

GA FILE NO. WP 8111

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, GLASS MAT GYPSUM SUBSTRATE, RESILIENT CHANNELS, MINERAL OR GLASS FIBER INSULATION, WOOD STUDS

EXTERIOR SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate (sheathing) applied parallel or at right angles to 2 x 4 wood studs 16" o.c. with 1 7/8" galvanized nails 7" o.c. 3" mineral or glass fiber insulation in stud space. Exterior cladding to be attached through glass mat gypsum substrate to studs.

INTERIOR SIDE: Resilient channels 24" o.c. attached at right angles to studs with one 1 1/4" Type W drywall screw at each stud. One layer 5/8" proprietary type X gypsum board applied at right angles to channels with Type S or S-12 drywall screws 8" o.c.

Joints staggered on opposite sides. **(LOAD-BEARING)**



Thickness: 5 3/8"
Approx. Weight: 7 psf
Fire Test: UL R3660/R15187, 01NK21103, 2-4-02; UL R3501, 07NK17992, 12-12-07; UL R6937, 06NK17692, 9-19-08; UL Design U305

PROPRIETARY GYPSUM PANEL PRODUCTS

CertainTeed Gypsum Inc.	- 5/8" CertainTeed® Type X Gypsum Board
	- 5/8" GlasRoc® Sheathing Type X Gypsum Panels
CertainTeed Gypsum Canada Inc.	- 5/8" CertainTeed® Type X Gypsum Board
Georgia Pacific Gypsum LLC	- 5/8" DensArmor Plus® Fireguard® Interior Panel
	- 5/8" DensGlass® Fireguard® Sheathing
Lafarge North America Inc.	- 5/8" Firecheck® Type X
	- 5/8" Weather Defense® Platinum Sheathing
National Gypsum Company	- 5/8" e²XP® FIRE-SHIELD® Gypsum Sheathing
	- 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board
Temple-Inland	- 5/8" GreenGlass Type X
	- 5/8" Type X

**Contact the manufacturer for more detailed information on proprietary products.*

EXTERIOR WALLS

GA FILE NO. WP 8122

GENERIC

1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS,
POLYMER MODIFIED EXTERIOR INSULATION & FINISH SYSTEM

EXTERIOR SIDE: One layer 5/8" type X gypsum sheathing applied parallel to 3 5/8" 18 ga steel studs 16" o.c. with #6x1 1/4" self-drilling, corrosion resistant, bugle head, drywall screws 8" o.c. at edges and ends and 12" o.c. at intermediate studs. Polymer modified exterior insulation & finish system applied over sheathing. 2" maximum foam plastic thickness.

INTERIOR SIDE: One layer 5/8" type X gypsum wallboard applied parallel to studs with #6x1 1/4" self-drilling, bugle head, drywall screws 8" o.c. at edges and ends and 12" o.c. at intermediate studs. **(NLB)**



Thickness: 6" - 7" Varies
Approx. Weight: 7 psf
Fire Test: SWRI 01-4409-003, 6-5-92

GA FILE NO. WP 8123

GENERIC

1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS,
POLYMER BASED EXTERIOR INSULATION & FINISH SYSTEM

EXTERIOR SIDE: One layer 5/8" type X gypsum sheathing applied parallel to 3 5/8" 18 ga steel studs 24" o.c. with #6x1 1/4" self-drilling, corrosion resistant, bugle head, drywall screws 8" o.c. at edges and ends and 12" o.c. at intermediate studs. Polymer based exterior insulation & finish system applied over sheathing. 4" maximum foam plastic thickness.

INTERIOR SIDE: One layer 5/8" type X gypsum wallboard applied parallel to studs with #6x1 1/4" self-drilling, bugle head, drywall screws 8" o.c. at edges and ends and 12" o.c. at intermediate studs. **(NLB)**



Thickness: 5 3/4" - 9" Varies
Approx. Weight: 7 psf
Fire Test: SWRI 01-4409-001(c), 1-24-92

EXTERIOR WALLS

GA FILE NO. WP 8126

PROPRIETARY*

1 HOUR FIRE

GYPSUM PANEL PRODUCTS, FOAM PLASTIC BOARDS, WOOD STUDS, EXTERIOR CLADDING

EXTERIOR SIDE: **Base** layer 5/8" proprietary type X gypsum sheathing or glass mat gypsum substrate applied parallel or at right angles to 2 x 4 wood studs 16" o.c. with 6d cement-coated or common nails or 1 7/8" Type W drywall screws 7" o.c. **Second** layer maximum 1 1/2" proprietary faced polyisocyanurate foam plastic sheathing applied parallel to studs with 3" galvanized roofing nails 8" o.c. at perimeter and 12" o.c. at intermediate studs. **Face** layer exterior siding, fiber-cement siding, masonry veneer, stucco, or exterior insulation and finish system (EIFS).

INTERIOR SIDE: 5/8" proprietary type X gypsum wallboard applied at right angles to studs with 6d cement-coated or common nails or 1 7/8" Type W drywall screws 7" o.c. Unfaced 3 1/2" glass fiber, 0.72 pcf, friction fit in stud space. **(LOAD-BEARING)**



Thickness: Varies
Approx. Weight: 6 psf
Fire Test: UL R2637, 94NK19449, 6-28-96, UL Design U354

PROPRIETARY GYPSUM PANEL PRODUCTS

American Gypsum Company LLC	- 5/8" FireBloc® Type X
	- 5/8" Exterior Sheathing Type X
CertainTeed Gypsum Inc.	- 5/8" GlasRoc® Sheathing Type X Gypsum Panels
	- 5/8" CertainTeed® Type X Gypsum Board
Georgia Pacific Gypsum LLC	- 5/8" DensArmor Plus® Fireguard® Interior Panel
	- 5/8" DensGlass® Fireguard® Sheathing
Lafarge North America Inc.	- 5/8" Weather Defense® Platinum Sheathing
	- 5/8" Firecheck® Type X
National Gypsum Company	- 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Sheathing
	- 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board
PABCO Gypsum	- 5/8" FLAME CURB® Type X
	- 5/8" PABCO GLASS™ Sheathing Type X
Temple-Inland	- 5/8" Type X
	- 5/8" GreenGlass Type X

GA FILE NO. WP 8130

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, GLASS MAT GYPSUM SUBSTRATE, WOOD STUDS

EXTERIOR SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate (sheathing) applied parallel or at right angles to 2 x 4 wood studs 16" o.c. with galvanized roofing nails, 1 3/4" long, 0.128" shank, 7/16" head, 7" o.c. Exterior surface covered with weather exposed cladding or finish system.

INTERIOR SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate, glass mat water-resistant gypsum backing board, gypsum wallboard, water-resistant gypsum backing board, or gypsum veneer base applied parallel or at right angles to studs with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Joints staggered on opposite sides. **(LOAD-BEARING)**



Thickness: 4 3/4"
Approx. Weight: 7.5 psf
Fire Test: WHI-495-0702, 8-7-85; WHI-495-0703, 8-8-85; UL R2717, 89NK3419, 8-29-89; UL R3501, 07NK17992, 12-12-07; UL R6937, 06NK17692, 9-19-08; UL R15187, 02NK31412, 7-17-02; UL Designs U337 & U305

PROPRIETARY GYPSUM PANEL PRODUCTS

American Gypsum Company LLC	- 5/8" FireBloc® Type X
CertainTeed Gypsum Inc.	- 5/8" CertainTeed® Type X Gypsum Board
	- 5/8" GlasRoc® Sheathing Type X Gypsum Panels
Georgia Pacific Gypsum LLC	- 5/8" DensGlass® Fireguard® Sheathing
	- 5/8" DensArmor Plus® Fireguard® Interior Panel
Lafarge North America Inc.	- 5/8" Weather Defense® Platinum Sheathing
	- 5/8" Firecheck® Type X
National Gypsum Company	- 5/8" e2XP® FIRE-SHIELD® Gypsum Sheathing
	- 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board
PABCO Gypsum	- 5/8" FLAME CURB® Type X
	- 5/8" PABCO GLASS™ Sheathing Type X
Temple-Inland	- 5/8" GreenGlass Type X
	- 5/8" Type X

**Contact the manufacturer for more detailed information on proprietary products.*

EXTERIOR WALLS

GA FILE NO. WP 8131

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, WOOD STUDS, MINERAL FIBER INSULATION, WOOD STRUCTURAL PANELS, CEMENTITIOUS BACKER UNITS

EXTERIOR SIDE: **Base** layer 15/32" wood structural panels applied parallel to 2 x 4 wood studs 16" o.c. with 10d galvanized nails 6" o.c. at edges and at top and bottom plates and 12" o.c. at intermediate studs. Weather resistive barrier applied over panels. **Face** layer 1/2" proprietary cementitious backer units applied parallel or at right angles to studs with 1 5/8" long corrosion resistant screws 8" o.c.

INTERIOR SIDE: One layer 5/8" proprietary type X gypsum wallboard applied parallel or at right angles to studs with either 6d cement coated nails, 1 7/8" long 7" o.c. or 1 7/8" long Type S or Type W drywall screws 8" o.c. 3" mineral fiber insulation, 3.0 pcf, friction fit in stud space. **(LOAD-BEARING)**



Thickness: 6 1/2"
Approx. Weight: 14 psf
Fire Test: UL R1319, 97NK14997, 4-25-97, UL Design U303

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Panels

GA FILE NO. WP 8133

PROPRIETARY*

1 HOUR FIRE

GLASS MAT GYPSUM SUBSTRATE, WOOD STUDS

EXTERIOR SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate (sheathing) applied parallel or at right angles to 2 x 4 wood studs 16" o.c. with galvanized roofing nails, 1 3/4" long, 0.128" shank, 7/16" head, 7" o.c. Exterior surface covered with weather exposed cladding or finish system.

INTERIOR SIDE: One layer 5/8" proprietary type X glass mat gypsum substrate or glass mat water-resistant gypsum backing board applied parallel or at right angles to studs with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 7" o.c.

Joints staggered on opposite sides. **(LOAD-BEARING)**



Thickness: 4 3/4"
Approx. Weight: 7.5 psf
Fire Test: UL R3501, 07NK17992, 12-12-07; UL Designs U337 & U305

PROPRIETARY GYPSUM PANEL PRODUCTS

National Gypsum Company - 5/8" Gold Bond® Brand e²XP® FIRE-SHIELD® Gypsum Sheathing
- 5/8" Gold Bond® Brand e²XP® Interior Extreme® Gypsum Panels

GA FILE NO. WP 8134

PROPRIETARY*

1 HOUR FIRE

GYPSUM WALLBOARD, GLASS MAT GYPSUM SUBSTRATE, STEEL STUDS

EXTERIOR SIDE: One layer 5/8" proprietary type X gypsum sheathing or glass mat gypsum substrate (sheathing) applied parallel or at right angles to 3 1/2" steel studs 24" o.c. with 1" Type S drywall screws 8" o.c. at edges and 12" o.c. at intermediate studs when applied parallel to framing or 8" o.c. at ends and intermediate studs when applied at right angles to framing.

INTERIOR SIDE: One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 8" o.c. at edges and 12" o.c. at intermediate studs when applied parallel to framing or 8" o.c. at ends and intermediate studs when applied at right angles to framing.

Vertical joints centered over studs and staggered one stud cavity on opposite sides. Horizontal joints on opposite sides need not be staggered or backed. **(NLB)**



Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: UL R1319, 08NK19249, 9-19-09, UL Design U419

PROPRIETARY GYPSUM PANEL PRODUCT

United States Gypsum Company - 5/8" SECUROCK® Glass-Mat Sheathing Panels
- 5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® X

**Contact the manufacturer for more detailed information on proprietary products.*

EXTERIOR WALLS

GA FILE NO. WP 8135 — PROPRIETARY* — 1 HOUR FIRE

GYPSUM WALLBOARD, GLASS MAT GYPSUM SUBSTRATE, STEEL STUDS

EXTERIOR SIDE: One layer 5/8" proprietary type X gypsum sheathing or glass mat gypsum substrate (sheathing) applied parallel or at right angles to 3 1/2", 20 ga steel studs 24" o.c. with 1" Type S-12 drywall screws 8" o.c. at edges and 12" o.c. at intermediate studs when applied parallel to framing or 8" o.c. at ends and intermediate studs when applied at right angles to framing.

INTERIOR SIDE: One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S-12 drywall screws 8" o.c. at edges and 12" o.c. at intermediate studs when applied parallel to framing or 8" o.c. at ends and intermediate studs when applied at right angles to framing.

Vertical joints centered over studs and staggered one stud cavity on opposite sides. Horizontal joints on opposite sides need not be staggered or backed. **(LOAD-BEARING)**

PROPRIETARY GYPSUM PANEL PRODUCT

United States Gypsum Company
- 5/8" SECUROCK® Glass-Mat Sheathing Panels
- 5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® X



Thickness: 4 7/8"
Approx. Weight: 7 psf
Fire Test: UL R1319, 08NK19299, 9-1-09, UL Design U423

GA FILE NO. WP 8136 — PROPRIETARY* — 1 HOUR FIRE

GYPSUM WALLBOARD, GLASS MAT GYPSUM SUBSTRATE, WOOD STUDS

EXTERIOR SIDE: One layer 5/8" proprietary type X gypsum sheathing or glass mat gypsum substrate (sheathing) applied parallel or at right angles to 2 x 4 wood studs 16" o.c. with 1 5/8" Type S drywall screws 12" o.c. to studs when applied parallel to framing or 8" o.c. when applied at right angles to framing.

INTERIOR SIDE: One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to 2 x 4 wood studs 16" o.c. with 1 5/8" Type S drywall screws 12" o.c. to studs when applied parallel to framing or 8" o.c. when applied at right angles to framing.

Vertical joints centered over studs and staggered one stud cavity on opposite sides. Horizontal joints on opposite sides need not be staggered. **(LOAD-BEARING)**

PROPRIETARY GYPSUM PANEL PRODUCT

United States Gypsum Company
- 5/8" SECUROCK® Glass-Mat Sheathing Panels
- 5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® X



Thickness: 4 3/4"
Approx. Weight: 7 psf
Fire Test: UL R1319, 08CA05754, 5-14-09, UL Design U305 & U327

GA FILE NO. WP 8161 — GENERIC — 1 HOUR FIRE

GYPSUM SHEATHING, GYPSUM WALLBOARD, STRUCTURAL INSULATED PANELS (SIPS)

EXTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied vertically with 1 5/8" Type W drywall screws 12" o.c. at edges and ends and 24" o.c. in the field to Structural Insulated Panels (SIPS) with 3 1/2" expanded polystyrene foam core and 7/16" oriented strand board facing. Base layer joints offset 16" from SIPS panel joints. **Face** layer 5/8" type X gypsum sheathing applied vertically with 2" Type W drywall screws 12" o.c. at edges and 24" o.c. in the field. Exterior cladding attached through sheathing to SIPS panels.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum wallboard applied vertically to SIPS panels with 1 5/8" Type W drywall screws 12" o.c. at edges and ends and 24" o.c. in the field. Base layer joints offset 16" from SIPS panel joints. **Face** layer 5/8" type X gypsum wallboard applied vertically with 2" Type W drywall screws 12" o.c. at edges and 24" o.c. in the field.

Joints staggered 16" between layers. **(LOAD-BEARING)**



Thickness: 6 7/8" without exterior cladding
Approx. Weight: 12 psf
Fire Test: ITS 3036073, 12-18-02; SWRI 01-8305-052c, 2-86

**Contact the manufacturer for more detailed information on proprietary products.*

EXTERIOR WALLS

GA FILE NO. WP 8162

GENERIC

1 HOUR FIRE

GYPSUM SHEATHING, GYPSUM WALLBOARD, STRUCTURAL INSULATED PANELS (SIPS)

EXTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied vertically with 1 5/8" cupped-head drywall nails 24" o.c. vertically and 16" o.c. horizontally, with the bottom row of nails 8" from the bottom of the wall, to Structural Insulated Panels (SIPS) with 3 1/2" expanded polystyrene foam core and 7/16" oriented strand board facing. Base layer joints offset 24" from SIPS panel joints. **Face** layer 5/8" type X gypsum sheathing applied vertically with 1 7/8" cupped-head drywall nails 12" o.c. vertically and 16" o.c. horizontally and offset 8" from base layer nails. Exterior cladding attached through sheathing to SIPS panels.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied vertically with 1 5/8" cupped-head drywall nails 24" o.c. vertically and 16" o.c. horizontally, with the bottom row of nails 8" from the bottom of the wall Base layer joints offset 24" from SIPS panel joints. **Face** layer 5/8" type X gypsum sheathing applied vertically with 1 7/8" cupped-head drywall nails 12" o.c. vertically and 16" o.c. horizontally and offset 8" from base layer nails.

Joints staggered 24" between layers. **(LOAD-BEARING)**



Thickness: 6 7/8" without exterior cladding
Approx. Weight: 12 psf
Fire Test: OPL 15816-110457, 2-26-02

GA FILE NO. WP 8163

GENERIC

1 HOUR FIRE

GYPSUM SHEATHING, GYPSUM WALLBOARD, STRUCTURAL INSULATED PANELS (SIPS)

EXTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied vertically with 1 5/8" Type W drywall screws 12" o.c. at edges and ends and 24" o.c. in the field to Structural Insulated Panels (SIPS) with 5 1/2" expanded polystyrene foam core and 7/16" oriented strand board facing. Base layer joints offset 16" from SIPS panel joints. **Face** layer 5/8" type X gypsum sheathing applied vertically with 2" Type W drywall screws 12" o.c. at edges and 24" o.c. in the field. Exterior cladding attached through sheathing to SIPS panels.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum wallboard applied vertically to SIPS panels with 1 5/8" Type W drywall screws 12" o.c. at edges and ends and 24" o.c. in the field. Base layer joints offset 16" from SIPS panel joints. **Face** layer 5/8" type X gypsum wallboard applied vertically with 2" Type W drywall screws 12" o.c. at edges and 24" o.c. in the field.

Joints staggered 16" between layers. **(LOAD-BEARING)**



Thickness: 8 7/8" without exterior cladding
Approx. Weight: 12 psf
Fire Test: ITS 3036073, 12-18-02; SWRI 01-8305-052c, 2-86

GA FILE NO. WP 8164

GENERIC

1 HOUR FIRE

GYPSUM SHEATHING, GYPSUM WALLBOARD, STRUCTURAL INSULATED PANELS (SIPS)

EXTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied vertically with 1 5/8" cupped-head drywall nails 24" o.c. vertically and 16" o.c. horizontally, with the bottom row of nails 8" from the bottom of the wall, to Structural Insulated Panels (SIPS) with 5 1/2" expanded polystyrene foam core and 7/16" oriented strand board facing. Base layer joints offset 24" from SIPS panel joints. **Face** layer 5/8" type X gypsum sheathing applied vertically with 1 7/8" cupped-head drywall nails 12" o.c. vertically and 16" o.c. horizontally and offset 8" from base layer nails. Exterior cladding attached through sheathing to SIPS panels.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied vertically with 1 5/8" cupped-head drywall nails 24" o.c. vertically and 16" o.c. horizontally, with the bottom row of nails 8" from the bottom of the wall Base layer joints offset 24" from SIPS panel joints. **Face** layer 5/8" type X gypsum sheathing applied vertically with 1 7/8" cupped-head drywall nails 12" o.c. vertically and 16" o.c. horizontally and offset 8" from base layer nails.

Joints staggered 24" between layers. **(LOAD-BEARING)**



Thickness: 8 7/8" without exterior cladding
Approx. Weight: 12 psf
Fire Test: OPL 15816-110457, 2-26-02

EXTERIOR WALLS

GA FILE NO. WP 8202 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS, POLYMER BASED EXTERIOR INSULATION & FINISH SYSTEM

EXTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied parallel to 3 5/8" 18 ga steel studs 16" o.c. with #6x1 1/4" self-drilling, corrosion resistant, bugle head, drywall screws 24" o.c. **Face** layer 5/8" type X gypsum sheathing applied parallel to studs with #6x1 7/8" self-drilling, corrosion resistant, bugle head, drywall screws 8" o.c. at edges and ends and 12" o.c. at intermediate studs. Polymer based exterior insulation & finish system applied over sheathing. 4" maximum foam plastic thickness.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum wallboard applied parallel to studs with #6x1 1/4" self-drilling, bugle head, drywall screws 24" o.c. **Face** layer 5/8" type X gypsum wallboard applied parallel to studs with #6x1 7/8" self-drilling, bugle head, drywall screws 8" o.c. at edges and ends and 12" o.c. at intermediate studs.

Joints staggered each layer and side. **(NLB)**



Thickness: 7" - 10 1/4" Varies
Approx. Weight: 12 psf
Fire Test: SWRI 01-4409-001(e), 4-27-92

GA FILE NO. WP 8203 | PROPRIETARY* | 2 HOUR FIRE

GYPSUM WALLBOARD, GLASS MAT GYPSUM SUBSTRATE, STEEL STUDS, MINERAL OR GLASS FIBER INSULATION

EXTERIOR SIDE: **Base** layer 5/8" proprietary type X glass mat gypsum substrate (sheathing) applied parallel to 3 1/2" 20 ga steel studs 24" o.c. with 1" Type S-12, self-drilling, corrosion resistant, bugle head, drywall screws 12" o.c. Studs attached to each side of floor and ceiling runners by welding or with 1/2" Type S-12 pan head screws. **Face** layer 5/8" proprietary type X glass mat gypsum substrate (sheathing) applied parallel to studs with 1 5/8" Type S-12, self-drilling, corrosion resistant, bugle head, drywall screws 12" o.c. Mineral or glass fiber insulation friction fit into the stud space. Exterior cladding to be attached through glass mat gypsum panel to studs.

INTERIOR SIDE: **Base** layer 5/8" proprietary type X gypsum board applied parallel to studs with 1" Type S-12 drywall screws 12" o.c. **Face** layer 5/8" proprietary type X gypsum board applied parallel to studs with 1 5/8" Type S-12 drywall screws 12" o.c.

Joints staggered 24" each layer and side.

Bracing: Lateral bracing spaced not over 40" o.c. shall be 1" by 18 ga steel straps attached to each side or channel bracing attached to each stud with a clip angle. For studs with holes or punch-outs in the web the "Q" factor shall be determined by means of stub column tests. Tested at 80 percent of design load. **(LOAD-BEARING)**



FIRE SIDE

Thickness: 6"
Approx. Weight: 10 psf
Fire Test: UL R3660/R15187, 01NK21103, 2-4-02, UL Design U425

PROPRIETARY GYPSUM PANEL PRODUCTS

CertainTeed Gypsum Inc.	- 5/8" CertainTeed® Type X Gypsum Board
	- 5/8" GlasRoc® Sheathing Type X Gypsum Panels
CertainTeed Gypsum Canada Inc.	- 5/8" CertainTeed® Type X Gypsum Board
Georgia Pacific Gypsum LLC	- 5/8" ToughRock® Fireguard® Gypsum Board
	- 5/8" DensGlass® Fireguard® Sheathing
Lafarge North America Inc.	- 5/8" Weather Defense® Platinum Sheathing
	- 5/8" Firecheck® Type X
National Gypsum Company	- 5/8" e2XP FIRE-SHIELD® Gypsum Sheathing
	- 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board

**Contact the manufacturer for more detailed information on proprietary products.*

EXTERIOR WALLS

GA FILE NO. WP 8204 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM WALLBOARD, GLASS MAT GYPSUM SUBSTRATE, STEEL STUDS

EXTERIOR SIDE: **Base** layer 5/8" proprietary type X gypsum sheathing or glass mat gypsum substrate (sheathing) applied parallel or at right angles to 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum sheathing or glass mat gypsum substrate (sheathing) applied parallel or at right angles to studs with 1 5/8" Type S drywall screws 16" o.c.

INTERIOR SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1 5/8" Type S drywall screws 16" o.c.

Face layer horizontal joints need not be staggered or backed from base layer or on opposite sides. **(NLB)**



Thickness: 6 1/8"
Approx. Weight: 7 psf
Fire Test: UL R1319, 08NK19249, 9-1-09, UL Design U419

PROPRIETARY GYPSUM PANEL PRODUCT

United States Gypsum Company	-	5/8" SECUROCK® Glass-Mat Sheathing Panels
	-	5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® X

GA FILE NO. WP 8205 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM WALLBOARD, MINERAL FIBER INSULATION, CEMENTITIOUS BACKER UNIT, METAL STUD

EXTERIOR SIDE: **Base** layer 5/8" proprietary type X gypsum sheathing applied parallel to 3 5/8" 20 ga steel studs 16" o.c. with 1" Type S-12 drywall screws 24" o.c. **Face** layer 5/8" proprietary type X gypsum sheathing applied parallel to framing with 1 5/8" Type S-12 drywall screws 12" o.c. or 1/2" proprietary cementitious backer unit applied parallel or at right angles to framing with 1 5/8" Type S-12 wafer head screws 8" o.c.

INTERIOR SIDE: **Base** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to framing with 1" Type S-12 drywall screws 24" o.c. **Face** layer 1/2" proprietary cementitious backer unit applied parallel or at right angles to framing with 1 5/8" Type S-12 wafer head screws 8" o.c. Joints finished. 3" mineral fiber friction fit in stud space.

Joints staggered each layer and side. Weather resistive barrier must be installed behind the cementitious backer unit on the exterior side. **(NLB)**



Thickness: 5 3/4" - 5 7/8"
Approx. Weight: 11 psf
Fire Test: Based on UL R1319, 10-17-90, UL Design U474

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	-	1/2" CertainTeed® Type C Gypsum Board
Lafarge North America Inc.	-	1/2" Firecheck® Type C
Temple-Inland	-	5/8" Sheathing Type TG-X
	-	1/2" Type TG-C
United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® Core Gypsum Sheathing
	-	1/2" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

Contact the manufacturer for more detailed information on proprietary products.

EXTERIOR WALLS

GA FILE NO. WP 8206 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM WALLBOARD, GLASS MAT GYPSUM SUBSTRATE, STEEL STUDS

EXTERIOR SIDE: **Base** layer 5/8" proprietary type X gypsum sheathing or glass mat gypsum substrate (sheathing) applied parallel or at right angles to 3 1/2", 20 ga steel studs 24" o.c. with 1" Type S-12 drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum sheathing or glass mat gypsum substrate (sheathing) applied parallel or at right angles to studs with 1 5/8" Type S-12 drywall screws 16" o.c.

INTERIOR SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1" Type S-12 drywall screws 16" o.c. **Face** layer 5/8" proprietary type X gypsum Wallboard or gypsum veneer base applied parallel or at right angles to studs with 1 5/8" Type S-12 drywall screws 16" o.c.

Face layer horizontal joints need not be staggered or backed from base layer or on opposite sides. **(LOAD-BEARING)**

PROPRIETARY GYPSUM PANEL PRODUCT

United States Gypsum Company
- 5/8" SECUROCK® Glass-Mat Sheathing Panels
- 5/8" SHEETROCK® Brand UltraLight Panels FIRECODE® X



Thickness: 6 1/8"
Approx. Weight: 7 psf
Fire Test: UL R1319, 08CA62192, 5-15-09, UL Design U423

GA FILE NO. WP 8250 — PROPRIETARY* — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS, GYPSUM SHEATHING, METAL LATH, CEMENT-LIME STUCCO, MINERAL FIBER INSULATION

EXTERIOR SIDE: One layer 1/2" gypsum sheathing applied at right angles to 3 5/8" 20 ga steel studs 16" o.c. Self-furring metal lath, 3.4 lb, attached through sheathing to studs with 1 1/4" Type S-12 drywall screws 8" o.c. 1" portland cement-lime stucco applied over lath.

INTERIOR SIDE: One layer 5/8" foil backed proprietary type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1" Type S-12 drywall screws 8" o.c. 3" mineral fiber insulation, 2.0 pcf, in stud space. **(NLB)**

PROPRIETARY GYPSUM BOARD

United States Gypsum Company
- 5/8" SHEETROCK® Brand FIRECODE® C Core Foil-Back Gypsum Panels



Thickness: 5 3/4"
Approx. Weight: 20 psf
Fire Test: OSU T-4851, 6-70

GA FILE NO. WP 8325 — GENERIC — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS, METAL LATH, PERLITE-CEMENT LIME PLASTER

EXTERIOR SIDE: 1 1/2" x 17 ga galvanized woven wire self-furring paper backed lath attached to 3 5/8" 20 ga steel studs 16" o.c. with 1/2" Type S-12 pan head screws 6" o.c. 1" 6:1:1 perlite- portland cement-lime plaster applied over lath.

INTERIOR SIDE: One layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to studs with 1" Type S-12 drywall screws 12" o.c. 3 1/4" 6:1:1 perlite-portland cement-lime back plaster spray applied in stud space.

Achieved 4 hours when tested from cement side. **(NLB)**



Thickness: 5 1/4"
Approx. Weight: 14 psf
Fire Test: OSU 5645, 5-7-75

**Contact the manufacturer for more detailed information on proprietary products.*

EXTERIOR WALLS

GA FILE NO. WP 8410

GENERIC

2 HOUR FIRE

GYPSUM WALLBOARD, WOOD STUDS, GYPSUM SHEATHING, CLAY BRICK

EXTERIOR SIDE: **Base** layer 1/2" gypsum sheathing applied parallel or at right angles to 2 x 4 wood studs 16" o.c. with 1 3/4" galvanized roofing nails, 0.125" shank, 7/16" heads, 6" o.c. **Face** layer 2" x 4" x 8" clay brick with 1" air space between brick and exterior sheathing. 20 ga galvanized wire ties attached to each stud with 8d coated nails, 2 3/8" long, 0.113" shank, 9/32" head, at every 6th course of bricks.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 8" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to or at right angles to studs with 8d coated nails, 2 3/8" long, 0.113" shank, 9/32" heads, 8" o.c. **(LOAD-BEARING)**



Thickness: 10 1/8"
Approx. Weight: 30 psf
Fire Test: UL R1505-1, 2, 4-22-65, UL Design U302; ULC Design U302

GA FILE NO. WP 8415

GENERIC

2 HOUR FIRE

GYPSUM SHEATHING, GYPSUM WALLBOARD, WOOD STUDS

EXTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied parallel or at right angles to 2 x 4 wood studs 24" o.c. with 6d coated nails, 1 7/8" long, 0.085" shank, 1/4" heads, 24" o.c. **Face** layer 5/8" type X gypsum sheathing applied parallel or at right angles to studs with 8d coated nails, 2 3/8" long, 0.100" shank, 1/4" heads, 8" o.c. Exterior cladding attached through sheathing to studs.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum wallboard or gypsum veneer base applied paralle or at right angles to studs with 6d coated nails, 1 7/8" long, 0.085" shank, 1/4" heads, 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 8d coated nails, 2 3/8" long, 0.100" shank, 1/4" heads, 8" o.c.

Joints staggered 24" each layer and side. **(LOAD-BEARING)**



Thickness: 6 1/8" without exterior cladding
Approx. Weight: 12 psf
Fire Test: See WP 4135 (FM WP 360, 9-27-74)

EXTERIOR WALLS

GA FILE NO. WP 8416

PROPRIETARY*

2 HOUR FIRE

GYPSUM WALLBOARD, GLASS MAT GYPSUM SUBSTRATE, WOOD STUDS

EXTERIOR SIDE: **Base** layer 5/8" proprietary type X glass mat gypsum substrate (sheathing) applied parallel or at right angles to 2 x 4 wood studs 16" o.c. with 1 7/8", 0.0915" shank, 1/4" head, galvanized roofing nails 6" o.c. **Face** layer 5/8" proprietary type X glass mat gypsum substrate (sheathing) applied parallel or at right angles to studs to with 2 3/8", 0.113" shank, 9/32" head, galvanized roofing nails 8" o.c. Exterior cladding to be attached through glass mat gypsum panel to studs.

INTERIOR SIDE: **Base** layer 5/8" proprietary type X gypsum board applied parallel or at right angles to studs with 1 7/8", 0.0915" shank, 1/4" head nails 6" o.c. **Face** layer 5/8" proprietary type X gypsum board applied parallel or at right angles to studs with 2 3/8", 0.113" shank, 9/32" head nails 8" o.c.

Joints staggered 16" each layer and side. **(LOAD-BEARING)**



Thickness: 6 1/8" without exterior cladding
Approx. Weight: 12 psf
Fire Test: Based on UL R3660/R15187, 2-4-02; UL R6937, 08NK02787, 9-19-08; UL Design U301

PROPRIETARY GYPSUM PANEL PRODUCTS

CertainTeed Gypsum Inc.	- 5/8" CertainTeed® Type X Gypsum Board
	- 5/8" GlasRoc® Sheathing Type X Gypsum Panels
CertainTeed Gypsum Canada Inc.	- 5/8" CertainTeed® Type X Gypsum Board
Georgia Pacific Gypsum LLC	- 5/8" DensArmor Plus® Fireguard® Interior Panel
	- 5/8" DensGlass® Fireguard® Sheathing
Lafarge North America Inc.	- 5/8" Weather Defense® Platinum Sheathing
	- 5/8" Firecheck® Type X
National Gypsum Company	- 5/8" e²XP® FIRE-SHIELD® Gypsum Sheathing
	- 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board
Temple-Inland	- 5/8" GreenGlass Type X
	- 5/8" Type X

GA FILE NO. WP 8417

PROPRIETARY*

2 HOUR FIRE

GYPSUM WALLBOARD, WOOD STUDS, GYPSUM SHEATHING, STUCCO NETTING, CEMENT STUCCO

EXTERIOR SIDE: **Base** layer 5/8" proprietary type X gypsum sheathing applied parallel or at right angles to 2 x 4 wood studs 16" o.c. with 1 3/4", 0.125" shank, 7/16" head galvanized roofing nails 8" o.c. or 2" Type S drywall screws 8" o.c. Pre-furred wire stucco netting applied over gypsum sheathing with 1 1/4" x 1" steel staples 7" o.c. Portland cement stucco, 3/4", applied over stucco netting.

INTERIOR SIDE: **Base** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 1 1/4" Type S drywall screws 12" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to studs with 2" Type S drywall screws 12" o.c.

Joints staggered 16" each layer and side. **(LOAD-BEARING)**



Thickness: 6 1/4"
Approx. Weight: 17 psf
Fire Test: UL R3501, 03NK2475, 5-21-03, UL Design U371

PROPRIETARY GYPSUM BOARD

National Gypsum Company	- 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Board
	- 5/8" Gold Bond® Brand FIRE-SHIELD® Gypsum Sheathing

**Contact the manufacturer for more detailed information on proprietary products.*

EXTERIOR WALLS

GA FILE NO. WP 8418 | **GENERIC** | **2 HOUR FIRE**

GYPSUM SHEATHING, GYPSUM WALLBOARD, WOOD STUDS

EXTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied parallel or at right angles to 2 x 4 wood studs 16" o.c. with 1 1/4" Type W drywall screws 12" o.c. **Face** layer 5/8" type X gypsum sheathing applied parallel or at right angles to studs with 1 7/8" Type W drywall screws 12" o.c. and offset 6" from screws in base layer. Exterior cladding attached through sheathing to studs.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum wallboard or veneer base applied parallel or at right angles to studs with 1 1/4" Type W drywall screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard or veneer base applied parallel or at right angles to studs with 1 7/8" Type W drywall screws 12" o.c. and offset 6" from screws in base layer.

Joints staggered 16" each layer and side. **(LOAD-BEARING)**



Thickness: 6 1/8" without exterior cladding
Approx. Weight: 12 psf
Fire Test: See WP 4136
(SWRI 01-5920-614, 12-5-94)

GA FILE NO. WP 8420 | **GENERIC** | **2 HOUR FIRE**

WOOD STUDS, CEMENT STUCCO, WIRE MESH, GYPSUM WALLBOARD

EXTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied parallel to 2 x 6 fire retardant treated wood studs 16" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 12" o.c. and covered with a single layer fire resistant protective weather retarder paper stapled along each edge at 16" o.c. Galvanized self-furring wire mesh applied over sheathing with 8d galvanized roofing nails, 2 3/8" long, 0.113" shank, 9/32" heads, 6" o.c. Cement-stucco applied over wire mesh in two 1/2" thick coats with bonding agent applied between coats.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum wallboard or gypsum veneer base applied parallel to studs with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 12" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to studs with 8d coated nails, 2 3/8" long, 0.113" shank, 9/32" heads, 8" o.c. at edges and 12" o.c. at intermediate studs. **(LOAD-BEARING)**

FIRE SIDE



Thickness: 8 5/8"
Approx. Weight: 19 psf
Fire Test: UC, 12-21-67

This Space Left Blank

METAL CLAD EXTERIOR WALLS

GA FILE NO. WP 9010 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL LINER, STEEL FACIA, GLASS FIBER INSULATION

Coated steel interlocking interior liner panels attached to top and bottom supporting angles with 3/4"-14 steel screws. 1 1/2" glass fiber insulation batts, 0.6 pcf, applied horizontally. 16 ga coated steel hat-shaped subgirts 1/2" deep x 2 1/2" wide with 1 1/16" legs screw attached to legs of liner panels and to top and bottom supporting angles. Subgirts spaced horizontally 3" from top and bottom of liner panels with intermediate subgirts spaced 36" minimum, 48" maximum. **Base** layer 5/8" type X gypsum wallboard applied at right angles to subgirts with 1 5/8" Type S-12 drywall screws spaced 12" from vertical edges. **Second** layer 5/8" type X gypsum wallboard applied at right angles to subgirts with 1 5/8" Type S-12 drywall screws spaced 6" from vertical joints into each subgirt. Joints offset 26" from base layer joints. 16 ga hat-shaped metal coated steel subgirts 7/16" deep x 2 3/4" wide with 1/2" legs attached horizontally to first subgirts and gypsum wallboard with 2 3/8"-14 steel screws 24" o.c. Exterior steel or protected steel facing units of various shapes attached vertically to subgirts with U-shaped, coated, 18 ga spring steel clips hooked over lips of facing units and screw attached to subgirts with 3/4"-14 steel screws. Facing units secured along vertical joints with 3/4"-14 steel screws 18" o.c. 24" wide steel liner panels and 12" wide steel facing units are 1 1/2" deep and 20 ga. **(NLB)**



Thickness: 5"
Approx. Weight: 8 psf
Fire Test: UL R4013-14, 12-23-69, UL Design U617

GA FILE NO. WP 9020 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, GYPSUM SHEATHING, RIGID FURRING CHANNELS, STEEL GIRTS, STEEL WALL PANELS

EXTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied at right angles to horizontal, 6" to 12" deep, “Z” or “C” shaped, 0.056" to 0.120" thick steel girts 48" o.c. with 1 1/4" Type S-12 drywall screws 8" o.c. **Face** layer minimum 26 ga steel exterior wall panels applied at right angles to girts with 1 1/2" long, No. 12-14 self-drilling screws 12" o.c. Joints offset 6" from gypsum sheathing joints.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum wallboard applied parallel or at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 24" o.c. Furring channels attached at right angles to girts with two 3/8" long, Type S-12 panhead screws at each girt. **Face** layer 5/8" type X gypsum wallboard applied parallel or at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. Joints offset 24" from base layer joints. **(LOAD-BEARING)**



Thickness: Varies
Approx. Weight: 8 psf
Fire Test: UL R7406, R4024; 96NK36592; 8-23-99; UL Design V421

GA FILE NO. WP 9021 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, RIGID FURRING CHANNELS, STEEL GIRTS, STEEL WALL PANELS

EXTERIOR SIDE: Minimum 26 ga steel exterior wall panels applied at right angles to horizontal, 6" to 12" deep, “Z” or “C” shaped, 0.056" to 0.120" thick steel girts 48" o.c. with 1 1/2" long, No. 12-14 self-drilling screws 12" o.c.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum wallboard applied parallel or at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 24" o.c. Furring channels attached at right angles to girts with two 3/8" long, Type S-12 panhead screws at each girt. **Second** layer 5/8" type X gypsum wallboard applied parallel or at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. Joints offset 24" from base layer joints. **Face** layer 5/8" type X gypsum wallboard applied parallel or at right angles to channels with 2 1/4" Type S drywall screws 12" o.c. Joints offset 24" from second layer joints. **(LOAD-BEARING)**



FIRE SIDE

Thickness: Varies
Approx. Weight: 8 psf
Fire Test: UL R7406, R4024; 96NK36592; 8-23-99; UL Design V421

METAL CLAD EXTERIOR WALLS

GA FILE NO. WP 9060 — GENERIC — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL FURRING CHANNELS, STEEL PANELS, GLASS FIBER INSULATION

Steel furring channels 24" o.c. attached at right angles to legs of exterior panels with 1" Type S drywall screws 16" o.c.

EXTERIOR SIDE: Exterior panels consist of fluted steel wall panels, 24 ga steel, 16" wide, having J shaped 3" deep legs which interlock along vertical edges. 3" glass fiber insulation 1.0 pcf friction fit in panel cavity.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum wallboard or gypsum veneer base attached with 1" Type S drywall screws 12" o.c. at right angles to steel furring channels. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base laminated at right angles to furring channels and attached with 1 7/8" Type S drywall screws 12" o.c. at top and bottom edges. Alternately, **base** layer applied with 1" Type S drywall screws 24" o.c. at vertical joints and **face** layer applied with 1 7/8" Type S drywall screws 12" o.c. Face layer joints offset 16" from base layer joints. **(NLB)**



Thickness: 4 5/8"
Approx. Weight: 7 psf
Fire Test: FM WP 155-1, 1-31-69; FM WP 167-1, 9-18-69

GA FILE NO. WP 9200 — GENERIC — 2 HOUR FIRE

GYPSUM WALLBOARD, GYPSUM SHEATHING, RIGID FURRING CHANNELS, STEEL GIRTS, STEEL WALL PANELS

EXTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied at right angles to horizontal, 6" to 12" deep, "Z" or "C" shaped, 0.056" to 0.120" thick steel girts 48" o.c. with 1 1/4" Type S-12 drywall screws 8" o.c. **Face** layer minimum 26 ga steel exterior wall panels applied at right angles to girts with 1 1/2" long, No. 12-14 self-drilling screws 12" o.c. Joints offset 6" from gypsum sheathing joints.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum wallboard applied parallel or at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 24" o.c. Furring channels attached at right angles to girts with two 3/8" long, Type S-12 panhead screws at each girt. **Second** layer 5/8" type X gypsum wallboard applied parallel or at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. Joints offset 24" from base layer joints. **Face** layer 5/8" type X gypsum wallboard applied parallel or at right angles to channels with 2 1/4" Type S drywall screws 12" o.c. Joints offset 24" from second layer joints. **(LOAD-BEARING)**



Thickness: Varies
Approx. Weight: 9.5 psf
Fire Test: UL R7406, R4024; 96NK36592; 8-23-99; UL Design V421

GA FILE NO. WP 9205 — GENERIC — 2 HOUR FIRE

GYPSUM WALLBOARD, GYPSUM SHEATHING, RIGID FURRING CHANNELS, STEEL GIRTS, STEEL WALL PANELS

EXTERIOR SIDE: **Base** layer 5/8" type X gypsum sheathing applied at right angles to horizontal, 6" to 12" deep, "Z" or "C" shaped, 0.056" to 0.120" thick steel girts 48" o.c. with 1 1/4" Type S-12 drywall screws 8" o.c. **Second** layer 5/8" type X gypsum sheathing applied at right angles to girts with 1 5/8" Type S-12 drywall screws 8" o.c. Vertical joints offset 24" from base layer joints. **Face** layer minimum 26 ga steel exterior wall panels applied at right angles to girts with 2" long, No. 12-14 self-drilling screws 12" o.c. Joints offset 6" from gypsum sheathing joints.

INTERIOR SIDE: **Base** layer 5/8" type X gypsum wallboard applied parallel or at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 24" o.c. Furring channels attached at right angles to girts with two 3/8" long, Type S-12 panhead screws at each girt. **Face** layer 5/8" type X gypsum wallboard applied parallel or at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. Joints offset 24" from base layer joints. **(LOAD-BEARING)**



Thickness: Varies
Approx. Weight: 9.5 psf
Fire Test: UL R7406, R4024; 96NK36592; 8-23-99; UL Design V421

METAL CLAD EXTERIOR WALLS

GA FILE NO. WP 9206 — GENERIC — 2 HOUR FIRE

GYPSUM WALLBOARD, RIGID FURRING CHANNELS, STEEL GIRTS, STEEL WALL PANELS

EXTERIOR SIDE: Minimum 26 ga steel exterior wall panels applied at right angles to horizontal, 6" to 12" deep, “Z” or “C” shaped, 0.056" to 0.120" thick steel girts 48" o.c. with 1½" long, No. 12-14 self-drilling screws 12" o.c.

INTERIOR SIDE: **Base** layer ⅝" type X gypsum wallboard applied parallel or at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 24" o.c. Furring channels attached at right angles to girts with two ⅜" long, Type S-12 panhead screws at each girt. **Second** layer ⅝" type X gypsum wallboard applied parallel or at right angles to channels with 1⅝" Type S drywall screws 12" o.c. Joints offset 24" from base layer joints. **Third** layer ⅝" type X gypsum wallboard applied parallel or at right angles to channels with 1⅞" Type S drywall screws 12" o.c. Joints offset 24" from second layer joints. Steel straps, 0.020" x 1½" wide, vertically applied over third layer at vertical joints and intermediate channels with 2⅝" Type S drywall screws 12" o.c. **Face** layer ⅝" type X gypsum wallboard applied parallel or at right angles to steel straps with 1" Type S drywall screws 8" o.c. Joints offset 24" from third layer joints. **(LOAD-BEARING)**



FIRE SIDE

Thickness: Varies
Approx. Weight: 9.5 psf
Fire Test: UL R7406, R4024; 96NK36592; 8-23-99; UL Design V421

GA FILE NO. WP 9225 — GENERIC — 2 HOUR FIRE

SOLID GYPSUM WALLBOARD, METAL FACINGS, GLASS FIBER INSULATION

Coated steel interlocking interior liner panels attached to top and bottom supporting angles with ¾"-14 steel screws. 1½" glass fiber insulation batts, 0.6 pcf, applied horizontally. 16 ga coated steel hat-shaped subgirts ⅜" deep x 2½" wide with ⅝" legs screw attached to lips of liner panels and to top and bottom supporting angles. Subgirts spaced horizontally 3" from top and bottom of liner panels with intermediate subgirt spaced 36" minimum, 48" maximum. **Base** layer ⅝" type X gypsum wallboard applied at right angles subgirts with 1⅝" Type S-12 drywall screws spaced 12" from vertical joints. **Second** layer ⅝" type X gypsum wallboard applied at right angles to subgirts with 1⅝" Type S-12 drywall screws spaced 6" from vertical joints into each subgirt. Joints offset 24" from base layer joints. **Third** layer ⅝" type X gypsum wallboard applied with 1½" Type G drywall screws spaced 12" from vertical joints and over subgirts. Joints offset 8" from second layer joints. 18 ga hat-shaped metal coated steel subgirts ⅜" deep x 3" wide with 9/16" legs attached horizontally to first subgirt over gypsum wallboard with 2⅝" Type S-12 drywall screws 24" o.c. Exterior steel or protected steel facing units of various shapes attached vertically to subgirts with U-shaped, coated, 14 ga spring steel clips hooked over lips of facing units and screw attached to subgirts with ¾"-14 steel screws. Facing units secured along vertical joints with ¾"-12 steel screws 18" o.c. 24" wide steel liner panels and 12" wide steel facing units are 1½" deep x 20 ga. **(NLB)**



Thickness: 5 9/16"
Approx. Weight: 10 psf
Fire Test: UL R4013-15, 1-8-71, UL Design U602

GA FILE NO. WP 9325 — GENERIC — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL FURRING CHANNELS, METAL PANELS, GLASS FIBER INSULATION

Steel furring channels 24" o.c. attached at right angles to legs of exterior panels with 1" Type S drywall screws 16" o.c.

EXTERIOR SIDE: Exterior panels consist of fluted steel wall panels, 24 ga steel, 16" wide, having J shaped 3" deep legs which interlock along vertical edges. 3" glass fiber insulation, 1.0 pcf, friction fit in panel cavity.

INTERIOR SIDE: **Base** layer ½" type X gypsum wallboard or gypsum veneer base applied at right angles to furring channels with 1" Type S drywall screws 24" o.c. **Second** layer ½" type X gypsum wallboard or gypsum veneer base applied at right angles to furring channels with 1⅞" Type S drywall screws 24" o.c. Vertical joints offset 16" from base layer joints. Steel furring channels placed over the layer directly over the first rows of furring channels and attached thereto with 1⅞" Type S drywall screws 16" o.c. **Third** layer ½" type X gypsum wallboard or gypsum veneer base applied at right angles to furring channels with 1" Type S drywall screws 24" o.c. **Face** layer ½" type X gypsum wallboard or gypsum veneer base applied at right angles to furring channels with 1⅞" Type S drywall screws 12" o.c. **(LOAD-BEARING)**



FIRE SIDE

Thickness: 5¾"
Approx. Weight: 11 psf
Fire Test: FM WP 150-2, 11-15-68

AREA SEPARATION FIRE WALLS

GA FILE NO. ASW 0800

PROPRIETARY*

2 HOUR FIRE | **65 to 69 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL H STUDS

Two layers 1" x 24" proprietary type X gypsum panels inserted between 2" floor and ceiling runners with 2" steel H studs between adjacent pairs of gypsum panels. **(NLB)**

A 3/4" minimum air space must be maintained between steel components and adjacent framing (indicated by dashed lines in sketch). As an alternate, the steel components may be covered with 6" wide battens or full sheets of 1/2" type X gypsum wallboard.

Sound tested with 2 x 4 stud wall faced with 5/8" proprietary gypsum panel product each side of system and 3 1/2" glass fiber insulation in stud space.

PROPRIETARY GYPSUM PANEL PRODUCTS

National Gypsum Company - 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner
- 5/8" Gold Bond® Brand SoundBreak® Gypsum Board

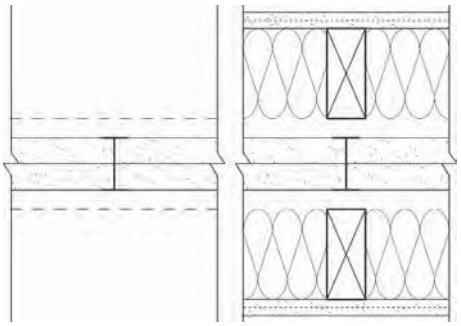

Thickness: 3 1/2" (Fire)
12" (Sound)
Approx. Weight: 9 psf
Fire Test: UL R3501, 05NK28782, 4-13-06, UL Design U347
Sound Test: NRCC B-3451.1, 10-5-06

GA FILE NO. ASW 0810

PROPRIETARY*

2 HOUR FIRE | **65 to 69 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL H STUDS

Two layers 1" x 24" proprietary type X gypsum panels inserted between floor and ceiling runners with steel H stud between adjacent pairs of gypsum panels. **(NLB)**

A 3/4" minimum air space must be maintained between steel components and adjacent framing (as indicated by dashed lines in sketch). As an alternate to an air space, the steel components are covered with 6" wide battens of 1/2" type X gypsum wallboard or full sheets of 1/2" type X gypsum wallboard screw attached to the steel components.

Sound tested with 2 x 4 stud wall faced with 1/2" regular gypsum wallboard each side of assembly and 3 1/2" glass fiber in stud space on both sides.

PROPRIETARY GYPSUM PANEL PRODUCT

Georgia Pacific Gypsum LLC - 1" DensGlass® Shaftliner

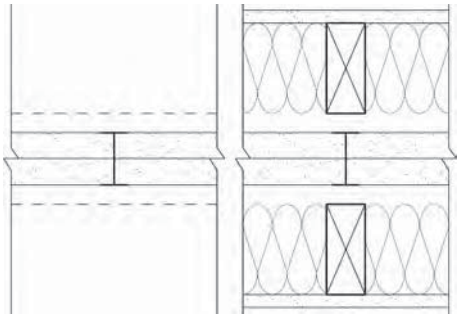

Thickness: 3 1/2" (Fire)
11 3/4" (Sound)
Approx. Weight: 9.5 psf
Fire Test: WHI 495-1290, 11-15-94; ITS Design GP/WA 120-04; WHI 495-1295, 3-15-95; WHI 495-0743 & 0744, 1-28 & 30-86; UL R2717, 04NK03115, 8-18-04, UL Design U373
Sound Test: RAL TL10-291, 8-31-10

Contact the manufacturer for more detailed information on proprietary products.

AREA SEPARATION FIRE WALLS

GA FILE NO. ASW 0980

PROPRIETARY*

2 HOUR FIRE | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, STEEL H STUDS

Two layers 1" x 24" proprietary type X gypsum panels inserted between 2" floor and ceiling runners with H studs between adjacent pairs of gypsum panels. **(NLB)**

A 3/4" minimum air space must be maintained between steel components and adjacent framing (as indicated by dashed lines in sketch). As an alternate to an air space, the steel components are covered with 6" wide battens or full sheets of 1/2" type X gypsum board screw attached to the steel components.

Sound tested with 2 x 4 stud wall faced with 1/2" regular gypsum wallboard each side of assembly and 3 1/2" glass fiber in stud space on both sides.

Height limitation up to 66 feet.

PROPRIETARY GYPSUM BOARD

Lafarge North America Inc. - 1" Mold Defense® Shaftliner

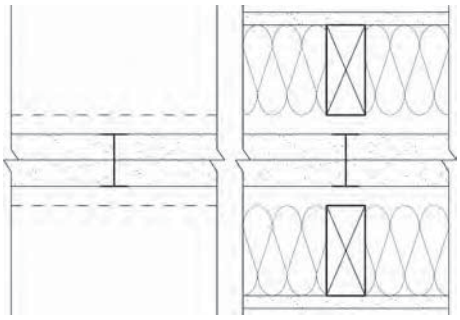

Thickness: 3 1/2" (Fire)
11 3/4" (Sound)
Approx. Weight: 9 psf
Fire Test: UL R18482, 07NK23212, 08/18/08, UL Design U388
Sound Test: RAL TL08-176, 6-25-08

GA FILE NO. ASW 0985

PROPRIETARY*

2 HOUR FIRE | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, STEEL H STUDS

Two layers 1" x 24" proprietary type X gypsum panels inserted between 2" floor and ceiling runners with 2" steel H studs between adjacent pairs of gypsum panels. **(NLB)**

A 3/4" minimum air space must be maintained between steel components and adjacent framing (indicated by dashed lines in sketch). As an alternate, the steel components may be covered with 6" wide battens or full sheets of 1/2" type X gypsum wallboard.

Sound tested with 2 x 4 stud wall faced with 1/2" gypsum wallboard each side of system and 3 1/2" glass fiber insulation in stud space.

PROPRIETARY GYPSUM BOARD

PABCO Gypsum - 1" PABCORE® Gypsum Shaftliner Board Type X

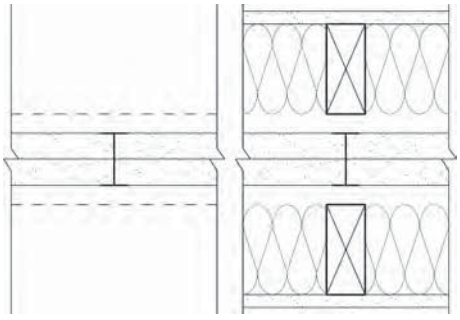

Thickness: 3 1/2" (Fire)
11 3/4" (Sound)
Approx. Weight: 9 psf
Fire Test: WFCi #07073, 2-18-08
Sound Test: RAL TL07-373, 12-4-07

**Contact the manufacturer for more detailed information on proprietary products.*

AREA SEPARATION FIRE WALLS

GA FILE NO. ASW 0997 | **PROPRIETARY*** | **2 HOUR FIRE** | **60 to 64 STC SOUND**

GYPSUM PANEL PRODUCT, STEEL H STUDS

Two layers 1" x 24" proprietary type X gypsum panels inserted between 2" floor and ceiling runners with 2" steel H studs between adjacent pairs of gypsum panels. **(NLB)**

A 3/4" minimum air space must be maintained between steel components and adjacent framing (as indicated by dashed lines in sketch). As an alternate to an air space, the steel components are covered with 6" wide battens of 1/2" gypsum board or 1" mineral fiber insulation. As an alternate to battens, one or both faces of the separation wall are covered with 1" mineral fiber insulation stapled to the gypsum liner panels or 1/2" regular gypsum board screw attached to the steel components.

Sound tested with 2 x 4 stud wall faced with 1/2" regular gypsum wallboard each side of assembly and 3" mineral fiber in stud space on both sides.

PROPRIETARY GYPSUM PANEL PRODUCT

United States Gypsum Company - 1" SHEETROCK® Brand Glass-Mat Liner Panels

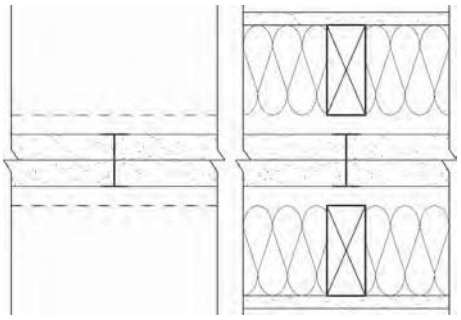

Thickness: 3 1/2" (Fire)
11 3/4" (Sound)
Approx. Weight: 9 psf
Fire Test: UL R1319, 09NK11605, 9-3-09, UL Design U336; UL R1319, 94NK40690, 1-27-95, UL Design V411; WHI 495-PSV-1245, 4-28-83
Sound Test: RAL TL88-350, 9-12-88

GA FILE NO. ASW 0998 | **PROPRIETARY*** | **2 HOUR FIRE** | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, STEEL H STUDS

Two layers 1" x 24" proprietary type X gypsum panels inserted between 2" floor and ceiling runners with 2" steel H studs between adjacent pairs of gypsum panels. **(NLB)**

A 3/4" minimum air space must be maintained between steel components and adjacent framing (indicated by dashed lines in sketch). As an alternate, the steel components may be covered with 6" wide battens or full sheets of 1/2" type X gypsum wallboard.

Sound tested with 2 x 4 stud wall faced with 1/2" gypsum wallboard each side of system and 3 1/2" glass fiber insulation in stud space.

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

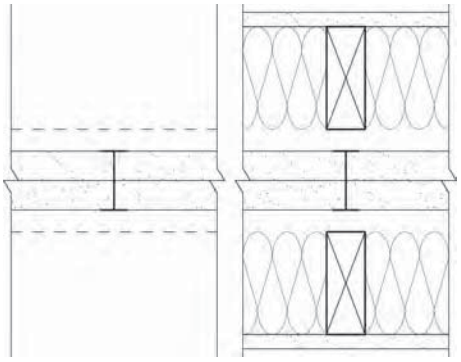

Thickness: 3 1/2" (Fire)
11 3/4" (Sound)
Approx. Weight: 9 psf
Fire Test: UL R3501, 92NK28896, 6-7-93, UL Design U347; WHI 694-0200.6, 10-21 & 24-85
Sound Test: RAL TL05-199, 11-17-05

**Contact the manufacturer for more detailed information on proprietary products.*

AREA SEPARATION FIRE WALLS

GA FILE NO. ASW 0999

PROPRIETARY*

2 HOUR FIRE | **60 to 64 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL H STUDS

Two layers 1" x 24" proprietary type X gypsum panels inserted between 2" floor and ceiling runners with 2" steel H studs between adjacent pairs of gypsum panels. **(NLB)**

A 3/4" minimum air space must be maintained between steel components and adjacent framing (indicated by dashed lines in sketch).

Sound tested with 2 x 4 stud wall faced with 1/2" regular gypsum wallboard each side of system and 3 1/2" glass fiber insulation in stud space.

Height limitation up to 66 feet.

PROPRIETARY GYPSUM PANEL PRODUCT

CertainTeed Gypsum Inc. - 1" GlasRoc® Shaftliner Gypsum Panels

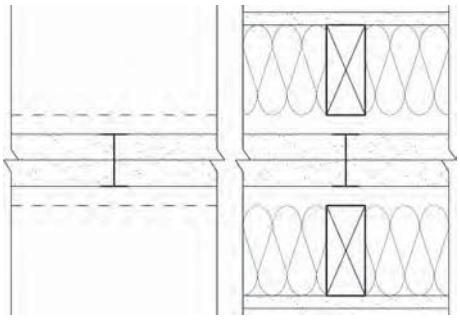

Thickness: 3 1/2" (Fire)
11 3/4" (Sound)
Approx. Weight: 9 psf
Fire Test: UL R3660, 07NK22992, 2-18-08, UL Design U366; ITS 100260628SAT-001, 12-27-10
Sound Test: RAL TL00-176, 12-6-00

GA FILE NO. ASW 1000

PROPRIETARY*

2 HOUR FIRE | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, STEEL H STUDS

Two layers 1" x 24" proprietary type X gypsum panels inserted between 2" floor and ceiling runners with 2" steel H studs between adjacent pairs of gypsum panels. **(NLB)**

A 3/4" minimum air space must be maintained between steel components and adjacent framing (as indicated by dashed lines in sketch). As an alternate to an air space, the steel components are covered with 6" wide battens of 1/2" gypsum board or 1" mineral fiber insulation. As an alternate to battens, one or both faces of the separation wall are covered with 1" mineral fiber insulation stapled to the gypsum liner panels or 1/2" regular gypsum board screw attached to the steel components.

Sound tested with 2 x 4 stud wall faced with 1/2" regular gypsum wallboard each side of assembly and 3" mineral fiber in stud space on both sides.

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 1" SHEETROCK® Brand Gypsum Liner Panels

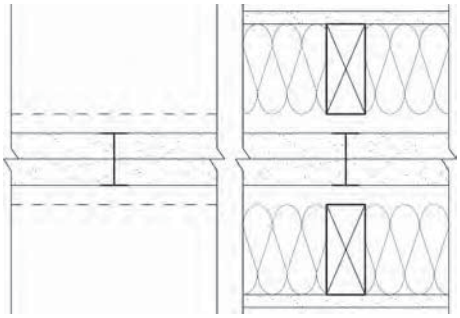

Thickness: 3 1/2" (Fire)
11 3/4" (Sound)
Approx. Weight: 9 psf
Fire Test: UL R1319, 89NK28786, 5-14-90, UL Design U336; UL R1319, 94NK40690, 1-27-95, UL Design V411; WHI 495-PSV-1245, 4-28-83
Sound Test: RAL TL88-350, 9-12-88

**Contact the manufacturer for more detailed information on proprietary products.*

AREA SEPARATION FIRE WALLS

GA FILE NO. ASW 1003 | **PROPRIETARY*** | **2 HOUR FIRE** | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, STEEL H STUDS

Two layers 1" x 24" proprietary type X gypsum panels inserted between floor and ceiling runners with steel H stud between adjacent pairs of gypsum panels. **(NLB)**

A 3/4" minimum air space must be maintained between steel components and adjacent framing (as indicated by dashed lines in sketch).

Sound tested with 2 x 4 stud wall faced with 1/2" regular gypsum wallboard each side of assembly and 3 1/2" glass fiber in stud space on both sides.

Height limitation up to 66 feet.

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 1" CertainTeed® Shaftliner Type X Gypsum Board

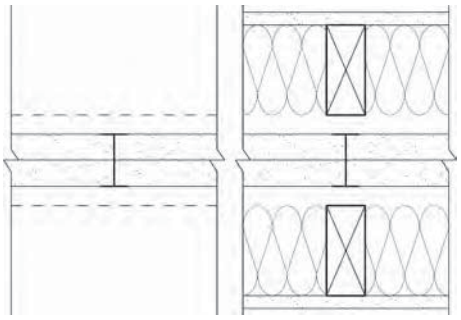

Thickness: 3 1/2" (Fire)
11 3/4" (Sound)
Approx. Weight: 9.5 psf
Fire Test: UL R8701, 99NK43912, 6-1-00, UL Design U366; ITS 100260628SAT-006A,, 006B Rev. 1, 1-7-11
Sound Test: RAL TL00-176, 12-6-00

GA FILE NO. ASW 1004 | **PROPRIETARY*** | **2 HOUR FIRE** | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, STEEL H STUDS

Two layers 1" x 24" proprietary type X gypsum panels inserted between 2" floor and ceiling runners with 2" steel H studs between adjacent pairs of gypsum panels. **(NLB)**

A 3/4" minimum air space must be maintained between steel components and adjacent framing (indicated by dashed lines in sketch).

Sound tested with 2 x 4 stud wall faced with 1/2" regular gypsum wallboard each side of system and 3 1/2" glass fiber insulation in stud space on both sides.

Height limitation up to 66 feet.

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 1" Shaft Liner
Temple-Inland - 1" Silent Guard Gypsum Liner Board

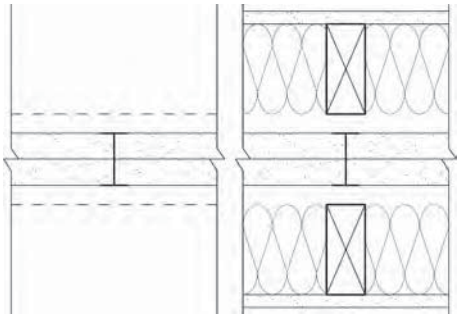

Thickness: 3 1/2" (Fire)
11 3/4" (Sound)
Approx. Weight: 9.5 psf
Fire Test: UL R6937 (R14196), 04NK19014, 10-28-04, UL Design U375
Sound Test: RAL TL05-149, 7-13-05

Contact the manufacturer for more detailed information on proprietary products.

AREA SEPARATION FIRE WALLS

GA FILE NO. ASW 1006 | PROPRIETARY* | 2 HOUR FIRE | 60 to 64 STC SOUND

GYPSUM PANEL PRODUCTS, STEEL H STUDS

Two layers 1" x 24" proprietary type X gypsum panels inserted between 2" floor and ceiling runners with 2" steel H studs between adjacent pairs of gypsum panels. **(NLB)**

A 3/4" minimum air space must be maintained between steel components and adjacent framing (indicated by dashed lines in sketch).

Sound tested with 2 x 4 stud wall faced with 1/2" regular gypsum wallboard each side of system and 3 1/2" glass fiber insulation in stud space on both sides.

PROPRIETARY GYPSUM PANEL PRODUCT

Temple-Inland - 1" GreenGlass Gypsum Liner Board

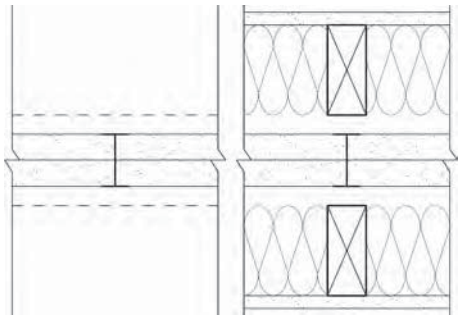

Thickness: 3 1/2" (Fire)
11 3/4" (Sound)
Approx. Weight: 9.5 psf
Fire Test: UL R6937, 08NK02787, 9-19-08, UL Design U375
Sound Test: RAL TL05-149, 7-13-05

GA FILE NO. ASW 1100 | GENERIC | 2 HOUR FIRE | 50 to 54 FSTC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 1 5/8" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 1 1/2" mineral fiber insulation in stud space. **(NLB)**



Thickness: 3 5/8"
Approx. Weight: 9 psf
Fire Test: UC, 12-7-64
Field Sound Test: ACI 1131a, 7-14-64

GA FILE NO. ASW 1105 | GENERIC | 2 HOUR FIRE | 50 to 54 STC SOUND

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side of 2 1/2" steel studs 24" o.c. with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1 5/8" Type S drywall screws 12" o.c.

Joints staggered 24" each layer and side. Sound tested with 1 1/2" mineral fiber insulation in stud space. **(NLB)**

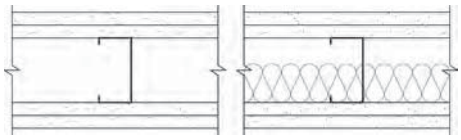

Thickness: 4 1/2"
Approx. Weight: 9 psf
Fire Test: UC, 9-7-64
Sound Test: CK 654-40, 9-7-65

**Contact the manufacturer for more detailed information on proprietary products.*

AREA SEPARATION FIRE WALLS

GA FILE NO. ASW 1111

PROPRIETARY*

2 HOUR FIRE | **50 to 54 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL C-H, C-T, OR I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" proprietary C-H, C-T, or I steel studs between panels. One layer ½" proprietary type X gypsum wallboard applied at right angles to each side with 1" Type S drywall screws 8" o.c.

Joints staggered 24" on opposite sides. STC estimated with 1½" thick glass fiber insulation stapled in stud space. **(NLB)**



PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC	-	½" ToughRock® Fireguard C® Gypsum Board
	-	1" DensGlass® Shaftliner

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: See WP 7097 (WHI 495-1182, 5-15-92; WHI 495-1220, 12-17-92, ITS Design GP/WA 120-02)
Sound Test: RAL TL90-360, 12-8-09

GA FILE NO. ASW 1205

PROPRIETARY*

2 HOUR FIRE | **45 to 49 FSTC SOUND**

GYPSUM WALLBOARD, STEEL C-H STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with H section of 2½" proprietary vented C-H steel studs between panels. One layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied to each side with 1" Type S drywall screws 12" o.c.

Sound tested with 1" mineral fiber insulation, 3.0 pcf, in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

Lafarge North America Inc.	-	½" Firecheck® Type C
Temple-Inland	-	½" TG-C
United States Gypsum Company	-	½" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels
	-	1" SHEETROCK® Brand Gypsum Liner Panels

Thickness: 4"
Approx. Weight: 9 psf
Fire Test: GET 6-23-75; UL R1319, R11633, 87NK21464, 9-14-87, UL Design U467
Field Sound Test: BBN 750704, 7-16-75

GA FILE NO. ASW 1206

PROPRIETARY*

2 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL C-H OR C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H or C-T studs between panels. One layer ½" proprietary type X gypsum wallboard applied parallel to each side with 1" Type S drywall screws 12" o.c.

Sound tested with 1⅞" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM PANEL PRODUCTS

CertainTeed Gypsum Inc.	-	½" CertainTeed® Type C Gypsum Board
	-	1" GlasRoc® Shaftliner Gypsum Panels
Lafarge North America Inc.	-	½" Firecheck® Type C
	-	1" Mold Defense® Shaftliner
PABCO Gypsum	-	½" FLAME CURB® Super 'C'™
	-	1" PABCORE® Gypsum Liner Board
Temple-Inland	-	½" TG-C
	-	1" Silent Guard™ Gypsum Liner Board

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R7094, 93NK8151, 9-14-93; UL R3660, 07NK22992, 2-18-08 UL Design U429
Sound Test: RAL-TL93-182, 7-2-93; WEAL 84-108, 3-16-84

**Contact the manufacturer for more detailed information on proprietary products.*

AREA SEPARATION FIRE WALLS

GA FILE NO. ASW 1207

PROPRIETARY*

2 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM PANEL PRODUCTS, STEEL C-H OR C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling J runners with T section of 2½" steel C-H or C-T studs between panels. One layer ½" proprietary type X gypsum wallboard applied parallel to each side with 1" Type S drywall screws 12" o.c.

Sound tested with 1⅞" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM PANEL PRODUCTS

Temple-Inland - ½" TG-C
- 1" GreenGlass Gypsum Liner Panel

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R6937, 08NK02787, 9-19-08, UL Design U429
Sound Test: RAL-TL93-182, 7-2-93; WEAL 84-108, 3-16-84

GA FILE NO. ASW 1215

PROPRIETARY*

2 HOUR FIRE | **45 to 49 STC SOUND**

GYPSUM WALLBOARD, STEEL I STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel I studs between panels. One layer ½" proprietary type X gypsum wallboard or gypsum veneer base applied parallel or at right angles to each side with 1" Type S drywall screws 12" o.c.

Sound tested with 1½" glass fiber insulation friction fit in stud space. **(NLB)**



PROPRIETARY GYPSUM BOARD

National Gypsum Company - ½" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
- 1" Gold Bond® Brand FIRE-SHIELD® Shaftliner

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R3501, 92NK22748, 9-15-93; 97NK4588, 1-30-97; 97NK5247, 2-4-97; UL Design U498; FM WP-545, 12-22-81
Sound Test: NGC 2617, 7-27-82

GA FILE NO. ASW 1501

PROPRIETARY*

2 HOUR FIRE

GYPSUM WALLBOARD, STEEL I, C-H OR C-T STUDS

One layer 1" x 24" proprietary type X gypsum panels inserted between 2½" floor and ceiling runners with tab-flange section of 2½" steel I, C-H or C-T studs between panels. One layer ⅝" proprietary type X gypsum wallboard or gypsum veneer base applied parallel to each side with 1" Type S drywall screws 12" o.c. **(NLB)**



PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - ⅝" FireBloc® Type X
- 1" Shaft Liner

Thickness: 3½"
Approx. Weight: 9 psf
Fire Test: UL R14196, 05NK29331, 2-18-06; UL R14196, 06NK09317, 4-11-06 UL Design V455

**Contact the manufacturer for more detailed information on proprietary products.*

AREA SEPARATION FIRE WALLS

GA FILE NO. ASW 2600 | **PROPRIETARY*** | **3 HOUR FIRE**

GYPSUM WALLBOARD, STEEL H STUDS

Two layers 1" x 24" proprietary type X gypsum panels inserted between 2" floor and ceiling runners with 2" steel H studs between adjacent pairs of gypsum panels. 2" mineral fiber insulation, 3.0 pcf, applied over each side and stapled to gypsum panels. **(NLB)**

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 1" SHEETROCK® Brand Gypsum Liner Panels



Thickness: 6"
Approx. Weight: 9.6 psf
Fire Test: WHI-495-0393, 1-14-82

This Space Left Blank

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, NONCOMBUSTIBLE

GA FILE NO. FC 1105

GENERIC | **1 HOUR FIRE** | **50 to 54 STC SOUND**

GYPSUM WALLBOARD, STEEL JOISTS, CONCRETE SLAB

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to 3 5/8" steel studs 24" o.c. with 1" Type S drywall screws 12" o.c. Studs wire tied with double strand 18 ga wire 8' o.c. to steel joists 24" o.c. supporting 3/8" rib metal lath and 2 1/2" concrete slab. (One hour restrained and unrestrained.)

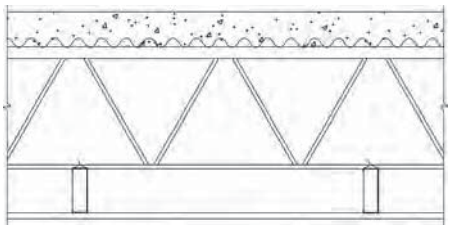

Approx. Ceiling Weight: 2 psf
Fire Test: FM FC-134, 12-16-69
Sound Test: See FC 2030 (NGC 4075, 3-25-69)

GA FILE NO. FC 1110

GENERIC | **1 HOUR FIRE**

GYPSUM WALLBOARD, STEEL JOISTS, CONCRETE SLAB

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. in field. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 52" long with screws 8" o.c. Furring channels wire tied to open web steel joists 24" o.c. supporting 3/8" rib metal lath or 9/16" deep 28 ga corrugated steel and 2" concrete slab measured from top of flute. (Passed 90 minute fire test restrained and unrestrained.)

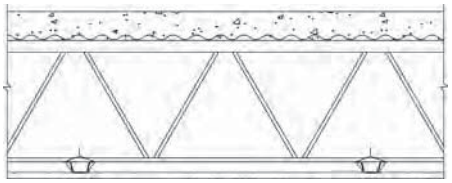

Approx. Ceiling Weight: 2 psf
Fire Test: UL R2717-30, 6-12-64, UL Design G502

GA FILE NO. FC 1130

GENERIC | **1 HOUR FIRE**

GYPSUM WALLBOARD, STEEL JOISTS, CONCRETE SLAB

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to 3 5/8" or 6" steel studs 16" o.c. with 1" Type S drywall screws 12" o.c. Studs placed horizontally to form ceiling envelope without direct attachment to joists except at stud ends. At end joint locations a 54" long backing stud is attached to the continuous stud with six 3/8" long self tapping screws 10" o.c. Studs with a stud sleeve on one end inserted in runners around side walls suspended by 1/8" x 1" steel straps from open web steel bar joists 24" o.c. supporting 3/8" rib metal lath and 2" concrete slab.

Maximum span for 3 5/8" studs is 11'10" at 16" o.c. and for 6" studs is 12'10" at 16" o.c.

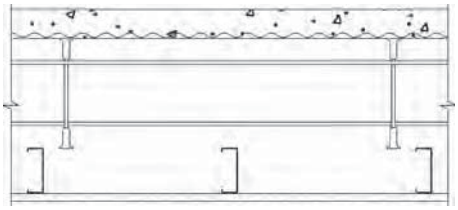

Approx. Ceiling Weight: 2.5 psf
Fire Test: OSU T-3694, 11-5-66

GA FILE NO. FC 1141

GENERIC | **1 HOUR FIRE**

GYPSUM WALLBOARD, RESILIENT CHANNELS, STEEL CHANNEL JOISTS, CONCRETE SLAB

Base layer 1/2" type X gypsum wallboard applied at right angles to resilient furring channels 24" o.c. with 1 1/4" Type S drywall screws 12" o.c. Resilient furring channels applied at right angles to channel shaped, minimum 8" deep, 18 ga galvanized steel joists 24" o.c. with 3/4" Type S-12 drywall screws at each joist. Base layer butt joints staggered 48" in adjacent courses. **Face** layer 1/2" type X gypsum wallboard applied at right angles to channels with end joints located midway between channels. Face layer attached to channels with 1 1/2" Type S drywall screws 12" o.c. End joints attached to base layer with 1 1/2" Type G screws 12" o.c. placed 1 1/2" back from either side of end joints. Face layer edge joints offset 24" from base layer edge joints. Face layer end joints offset 36" from base layer end joints. Joists supporting 5/8" deep 30 ga corrugated steel deck and 1 3/8" (measured from top of flute) concrete slab.

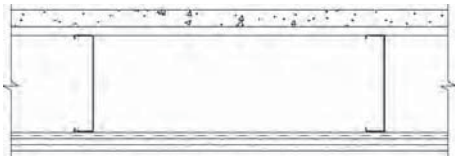

Approx. Ceiling Weight: 4 psf
Fire Test: NRCC B-4216.1, 3-3-05, Assembly FF-40

FLOOR-CEILING SYSTEMS, NONCOMBUSTIBLE

GA FILE NO. FC 1142

GENERIC

1 HOUR FIRE

GYPSUM WALLBOARD, RESILIENT CHANNELS, STEEL CHANNEL JOISTS, GLASS FIBER INSULATION, CONCRETE SLAB

Base layer 1/2" type X gypsum wallboard applied at right angles to resilient furring channels 24" o.c. with 1 1/4" Type S drywall screws 12" o.c. Resilient furring channels applied at right angles to channel shaped, minimum 8" deep, 18 ga galvanized steel joists 16" o.c. with 3/4" Type S-12 drywall screws at each joist. Base layer butt joints staggered 48" in adjacent courses. **Face** layer 1/2" type X gypsum wallboard applied at right angles to channels with end joints located midway between channels. Face layer attached to channels with 1 1/2" Type S drywall screws 12" o.c. End joints attached to base layer with 1 1/2" Type G screws 12" o.c. placed 1 1/2" back from either side of end joints. Face layer edge joints offset 24" from base layer edge joints. Face layer end joints offset 36" from base layer end joints. Joists supporting 5/8" deep 30 ga corrugated steel deck and 1 3/8" (measured from top of flute) concrete slab. 3 1/2" glass fiber batt insulation, 0.64 pcf, in joist space.

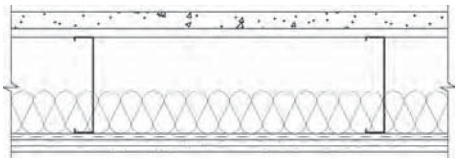

Approx. Ceiling Weight: 4 psf
Fire Test: NRCC B-4216.1, 3-3-05, Assembly FF-43

GA FILE NO. FC 1143

GENERIC

1 HOUR FIRE

GYPSUM WALLBOARD, RESILIENT CHANNELS, STEEL CHANNEL JOISTS, MINERAL FIBER INSULATION, CONCRETE SLAB

Base layer 1/2" type X gypsum wallboard applied at right angles to resilient furring channels 24" o.c. with 1 1/4" Type S drywall screws 12" o.c. Resilient furring channels applied at right angles to channel shaped, minimum 8" deep, 18 ga galvanized steel joists 16" o.c. with 3/4" Type S-12 drywall screws at each joist. Base layer butt joints staggered 48" in adjacent courses. **Face** layer 1/2" type X gypsum wallboard applied at right angles to channels with end joints located midway between channels. Face layer attached to channels with 1 1/2" Type S drywall screws 12" o.c. End joints attached to base layer with 1 1/2" Type G screws 12" o.c. placed 1 1/2" back from either side of end joints. Face layer edge joints offset 24" from base layer edge joints. Face layer end joints offset 36" from base layer end joints. Joists supporting 5/8" deep 30 ga corrugated steel deck and 1 3/8" (measured from top of flute) concrete slab. 3 1/2" glass fiber insulation, 0.64 pcf, or 3 1/2" mineral fiber batt insulation, 2.2 pcf, in joist space.

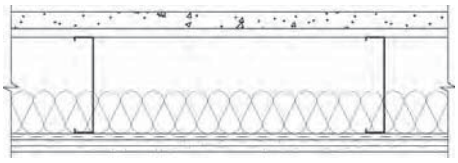

Approx. Ceiling Weight: 4 psf
Fire Test: NRCC B-4216.1, 3-3-05, Assemblies FF-44 & FF-53

GA FILE NO. FC 1144

GENERIC

1 HOUR FIRE

GYPSUM WALLBOARD, STEEL CHANNEL JOISTS, CONCRETE SLAB

Base layer 1/2" type X gypsum wallboard applied at right angles to channel shaped, minimum 8" deep, 18 ga galvanized steel joists 24" o.c. with 1 1/4" Type S-12 drywall screws 12" o.c. Base layer butt joints staggered 48" in adjacent courses. **Face** layer 1/2" type X gypsum wallboard applied at right angles to joists with end joints located midway between joists. Face layer attached to joists with 1 1/2" Type S-12 drywall screws 12" o.c. End joints attached to base layer with 1 1/2" Type G screws 12" o.c. placed 1 1/2" back from either side of end joints. Face layer edge joints offset 24" from base layer edge joints. Face layer end joints offset 36" from base layer end joints. Joists supporting 5/8" deep 30 ga corrugated steel deck and 1 3/8" (measured from top of flute) concrete slab.

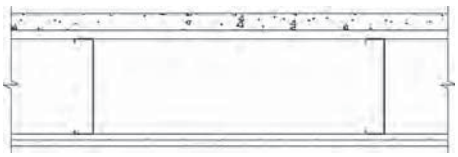

Approx. Ceiling Weight: 4 psf
Fire Test: NRCC B-4216.1, 3-3-05, Assembly FF-54

GA FILE NO. FC 1145

GENERIC

1 HOUR FIRE

GYPSUM WALLBOARD, RESILIENT CHANNELS, STEEL JOISTS, CONCRETE SLAB

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. set back 2" from edges. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 60" long with screws 12" o.c. Furring channels applied at right angles to 6" x 1 5/8" flanged 18 ga steel channel joists 24" o.c. with two 3/8" Type S-12 drywall screws at each joist. Joists supporting 25 ga corrugated metal deck and 2" (measured from top of flute) light weight, 105 pcf, concrete slab. (One hour unrestrained.)

Approx. Ceiling Weight: 2 psf
Fire Test: FM FC 245-1, 1-27-77

FLOOR-CEILING SYSTEMS, NONCOMBUSTIBLE

GA FILE NO. FC 1146 — PROPRIETARY* — 1 HOUR FIRE

GYPSUM WALLBOARD, RESILIENT CHANNELS, STEEL CHANNEL JOISTS, GLASS FIBER INSULATION, CONCRETE SLAB

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. fastened 1 1/2" from edges. Resilient furring channels applied at right angles to channel shaped, minimum 9 1/4" deep, 16 ga galvanized steel joists 24" o.c. with 1/2" Type S-12 drywall screws at each joist. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel with screws 8" o.c. Joists supporting 9/16" deep 22 ga corrugated steel deck and 1" (measured from top of flute) proprietary gypsum floor topping. 3 1/2" mineral wool or glass fiber insulation batts draped over channels.

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type C Gypsum Board

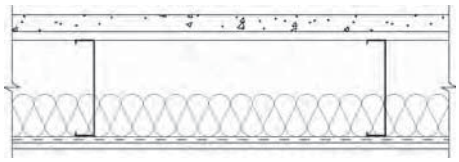

Approx. Ceiling Weight: 3 psf
Fire Test: R3660, 07NK25172, 7-9-08, UL Design G568

GA FILE NO. FC 1180 — GENERIC — 1 HOUR FIRE

STEEL JOISTS, CONCRETE SLAB, METAL LATH, GYPSUM PLASTER

5/8" 1:2-1:3 gypsum-sand plaster applied over 3/8" rib metal lath wire tied with 18 ga wire 5" o.c. to open web steel joists 24" o.c. supporting 3/8" rib metal lath and 2" concrete slab.

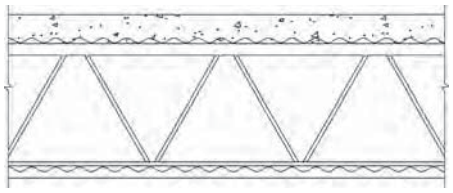

Approx. Ceiling Weight: 4 psf
Fire Test: BMS 92/43, 10-7-42

GA FILE NO. FC 1181 — PROPRIETARY* — 1 HOUR FIRE

STEEL JOISTS, CONCRETE SLAB, GLASS MAT GYPSUM SUBSTRATE

One layer 5/8" proprietary type X glass mat gypsum substrate applied at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum panel end joints located midway between continuous channels and attached to additional pieces of channel 60" long with screws 12" o.c. Furring channels attached with 18 ga wire ties to open web steel joists 24" o.c. supporting 3/8" rib metal lath and 2" concrete slab.

PROPRIETARY GYPSUM PANEL PRODUCT

CertainTeed Gypsum Inc. - 5/8" GlasRoc® Sheathing Type X Gypsum Panels
Georgia Pacific Gypsum LLC - 5/8" DensGlass® Fireguard® Sheathing

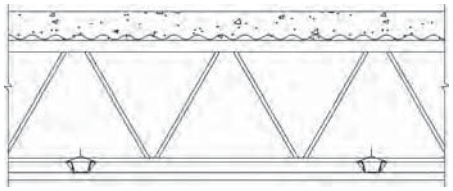

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R3660/R15187, 2-4-02, UL Design G501

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, NONCOMBUSTIBLE

GA FILE NO. FC 1190

PROPRIETARY*

1 HOUR FIRE

STEEL TRUSSES, RESILIENT CHANNELS, MINERAL OR GLASS FIBER INSULATION, GYPSUM WALLBOARD, CONCRETE SLAB

One layer 5/8" proprietary type X gypsum wallboard applied at right angles to resilient furring channels with 1" Type S drywall screws 12" o.c. Resilient channels spaced 12" o.c. when insulation is used or 16"o.c. when no insulation is used. Gypsum board end joints attached with screws 12" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of light-gage steel trusses 48" o.c. with 1/2" Type S-12 screws **(refer to furring channel manufacturer for maximum spans)**. Optional glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting 3/8" rib metal lath and 2" normal weight or lightweight concrete slab.

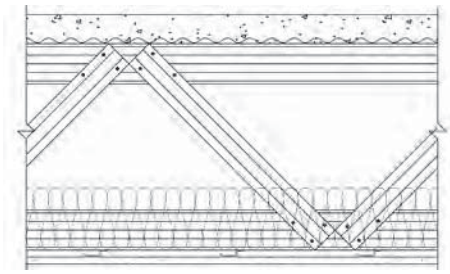

PROPRIETARY GYPSUM BOARD

American GypsumCompany LLC	-	5/8" FireBloc® Type C
Temple-Inland	-	5/8" TG-C

Approx. Ceiling Weight: 3 psf
Fire Test: UL R14196, 08CA28783, 2-15-08, UL Design G567

GA FILE NO. FC 1290

PROPRIETARY*

1 1/2 HOUR FIRE

STEEL JOISTS, CONCRETE SLAB, METAL LATH, GYPSUM TILES

Nominal 24" x 48" x 1/2" proprietary type X gypsum wallboard lay-in panels supported by steel suspension system suspended from steel open web joists supporting 3/8" rib metal lath and 2 1/2" concrete slab. (1 1/2 hour restrained and unrestrained.)

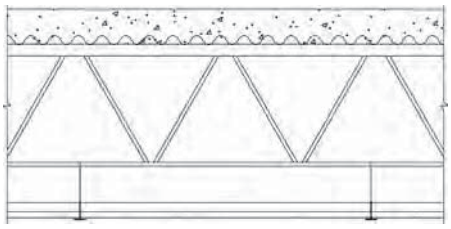

PROPRIETARY GYPSUM BOARD

National Gypsum Company	-	1/2" Gridstone® Brand Ceiling Panels

Approx. Ceiling Weight: 2.5 psf
Fire Test: FM J.I. 0F6Q7.AC, 7-17-80, FM FC-300

GA FILE NO. FC 1291

PROPRIETARY*

1 1/2 HOUR FIRE

STEEL JOISTS, CONCRETE SLAB, METAL LATH, GYPSUM TILES

Nominal 24" x 48" x 1/2" proprietary type X gypsum wallboard lay-in panels supported by steel suspension system suspended from steel open web joists supporting 3/8" rib metal lath and 2 1/2" concrete slab. (1 1/2 hour restrained and unrestrained.)

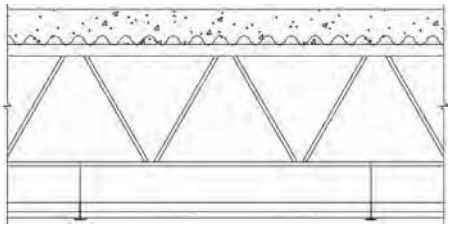

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	1/2" FireBloc CP Gypsum Lay-In Ceiling Panels

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R14196, 09NK14830, 6-3-10, UL Design G259

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, NONCOMBUSTIBLE

GA FILE NO. FC 1800 | **PROPRIETARY*** | **2 HOUR FIRE** | **60 to 64 STC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, STEEL CHANNEL JOISTS, STRUCTURAL CEMENT PANELS, GYPSUM FLOOR UNDERLAYMENT

One layer 5/8" proprietary type X gypsum wallboard applied parallel to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. in the field and 8" o.c. at the perimeter edges along the resilient channel spaced 3" from the wallboard edge on either side. Resilient channels are attached to 16 ga 10" deep steel channel joists spaced 16" o.c. Joists supporting 3/4" proprietary structural cement-fiber units applied at right angles to joists with No. 8 x 1 5/8" self drilling screws spaced 8" o.c. at butt joints and 12" o.c. in the field. 1/2" proprietary gypsum floor topping applied over fiber-cement panels. 3 5/8" mineral or glass fiber insulation in floor cavity.

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

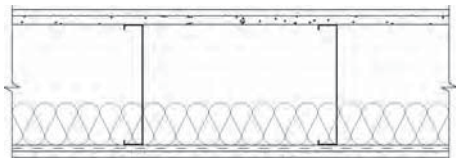

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R25352, 05CA34168, 8-15-06; 11NK12862, 10-12-11; UL Design G556
Sound Test: USG 060802, 8-11-06; USG 060803, 8-28-06
IIC & Test: (43 ceramic tile) USG 060802, 8-11-06; (46 ceramic tile over membrane) USG 060803, 8-28-06

GA FILE NO. FC 1900 | **PROPRIETARY*** | **2 HOUR FIRE** | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, PROPRIETARY STEEL FLOOR JOISTS, GLASS OR MINERAL FIBER INSULATION, GYPSUM FLOOR UNDERLAYMENT

One layer 5/8" proprietary type X gypsum wallboard applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel with screws at 8" o.c. Resilient channels applied at right angles to bottom chord of 9 1/4" deep, 16 ga galvanized proprietary light-gage steel floor joists spaced a maximum of 24" o.c. with 3/4" Type S-12 screws. Optional glass fiber applied directly over gypsum board. Floor joists supporting 9/16" 22 ga corrugated fluted steel deck. 1" proprietary gypsum floor topping applied over steel deck.

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

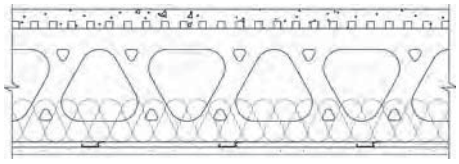

Approx. Ceiling Weight: 3 psf
Fire Test: UL R3501, 06NK28969, 5-16-07, UL Design G563
Sound Test: NGC 5008018, 5-20-08

Contact the manufacturer for more detailed information on proprietary products.

FLOOR-CEILING SYSTEMS, NONCOMBUSTIBLE

GA FILE NO. FC 1901 | **PROPRIETARY*** | **2 HOUR FIRE** | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, STEEL CHANNEL JOISTS, STRUCTURAL CEMENT PANELS, GYPSUM FLOOR UNDERLAYMENT

One layer 5/8" proprietary type X gypsum wallboard applied parallel to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. in the field and 8" o.c. at the perimeter edges along the resilient channel spaced 3" from the wallboard edge on either side. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel with screws at 8" o.c. Resilient channels are attached to 16 ga, 9 1/4" deep steel channel joists spaced 24" o.c. Joists supporting 3/4" proprietary structural cement-fiber units applied at right angles to joists with No. 8 x 1 5/8" self drilling screws spaced 8" o.c. at butt jouints and 12" o.c. in the field. 3/4" proprietary gypsum floor topping applied over fiber-cement panels. 3 5/8" mineral or glass fiber insulation in floor cavity.

PROPRIETARY GYPSUM COMPONENTS

United States Gypsum Company
- 5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels
- LEVELROCK® Brand Floor Underlayment

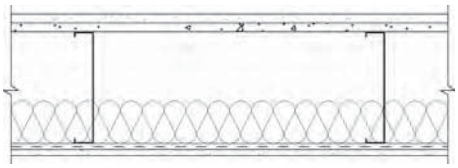

Approx. Ceiling Weight: 2.5 psf

Fire Test: UL R25352, 05CA34168, 8-15-06; 11NK12862, 10-12-11; UL Design G535

Sound Test: RAL TL06-159, 5-4-06; RAL TL06-165, 5-9-06; RAL TL06-166, 5-10-06; RAL TL06-167, 5-11-06; RAL TL06-186, 5-26-06

IIC & Test: (65 C&P) RAL IN06-006, 5-4-06; (62 C&P with Drywall Suspension System Instead of Resilient Channel) RAL IN06-007, 5-9-06; (48 Engineered Wood with Drywall Suspension System Instead of Resilient Channel) RAL IN06-008, 5-10-06; (36 Bare Floor with Drywall Suspension System Instead of Resilient Channel) RAL IN06-009, 5-11-06; (52 Ceramic Tile over Mat with Drywall Suspension System Instead of Resilient Channel) RAL IN06-010, 5-26-06

GA FILE NO. FC 1902 | **PROPRIETARY*** | **2 HOUR FIRE** | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, GLASS FIBER INSULATION, STEEL CHANNEL JOISTS, METAL DECK, GYPSUM FLOOR UNDERLAYMENT

One layer 5/8" proprietary type X gypsum wallboard applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. in the field and 8" o.c. at the perimeter edges along the resilient channel spaced 3" from the wallboard edge on either side. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel with screws at 8" o.c. Resilient channels are attached to 16 ga, 8" deep steel channel joists spaced 24" o.c. Joists supporting 22 ga, 9/16" corrugated metal deck. 1" proprietary gypsum floor topping applied over metal deck. 3 1/2" glass fiber insulation in floor cavity.

PROPRIETARY GYPSUM COMPONENTS

United States Gypsum Company
- 5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels
- LEVELROCK® Brand Floor Underlayment

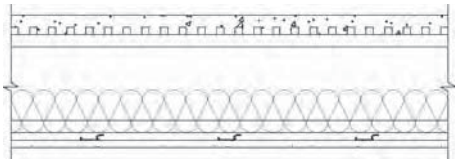

Approx. Ceiling Weight: 2.5 psf

Fire Test: UL R25211, 06CA24681, 10-13-06, UL Design G559

Sound Test: RAL TL07-132, 5-22-07; RAL TL07-133, 5-23-07; RAL TL07-134, 5-23-07; RAL TL07-138, 5-29-07

IIC & Test: (85 C&P) RAL IN07-005, 5-22-07; (54 Vinyl) RAL IN07-007, 5-23-07; (59 Laminate Floor) RAL IN07-008, 5-29-07; (36 Bare Floor) RAL IN07-005, 5-22-07

Contact the manufacturer for more detailed information on proprietary products.

FLOOR-CEILING SYSTEMS, NONCOMBUSTIBLE

GA FILE NO. FC 2030

GENERIC

2 HOUR FIRE

50 to 54 STC SOUND

STEEL JOISTS, CONCRETE SLAB, GYPSUM WALLBOARD

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 54" long with screws 12" o.c. Furring channels attached with 18 ga wire ties 48" o.c. to open web steel joists 24" o.c. supporting 3/8" rib metal lath or 9/16" deep 28 ga corrugated steel and 2 1/2" concrete slab measured from top of flute. Furring channels may be attached to 1 1/2" cold rolled carrying channels 48" o.c. suspended from joists by 8 ga wire hangers not over 48" o.c. **(Two hour restrained and unrestrained.)**

(See GA File No. BM 3310)

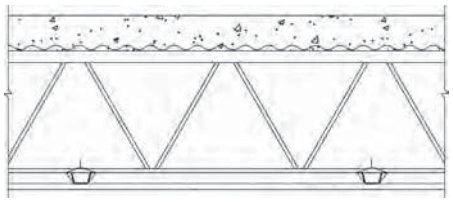

Approx. Ceiling Weight: 2 psf
Fire Test: UL R3501-28, 2-7-64, UL Design G514; ULC Design I511
Sound Test: NGC 4075, 3-25-69

GA FILE NO. FC 2116

GENERIC

2 HOUR FIRE

GYPSUM WALLBOARD, STEEL CHANNEL JOIST, CONCRETE SLAB

Base layer 5/8" type X gypsum wallboard or veneer base applied at right angles to channel shaped, minimum 7 1/4" deep, 18 ga galvanized steel joists 24" o.c. with 1" Type S-12 drywall screws 12" o.c. End joints located midway between joists and staggered between rows. **Face** layer 5/8" type X gypsum wallboard or veneer base applied at right angles to joists with 1 7/8" Type S-12 drywall screws 12" o.c. placed 2" from edges and 1 1/2" Type G drywall screws 12" o.c. placed 2" back on either side of end joints. End joints located midway between joists and all joints offset 24" from base layer joints.

Joists supporting 28 ga corrugated metal deck and 2 1/2" concrete slab measured from the bottom of flutes. Joists braced at midspan with continuous 2" wide, 18 ga, galvanized steel straps attached to the bottom flange of each joist with one 3/8" Type S-12 panhead screw.

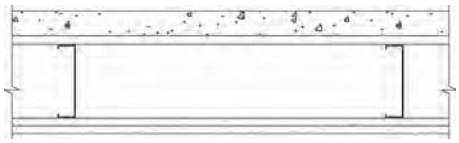

Approx. Ceiling Weight: 5 psf
Fire Test: FM FC 224-2, 9-19-75

GA FILE NO. FC 2120

GENERIC

2 HOUR FIRE

CONCRETE SLAB, PAN JOISTS, GYPSUM WALLBOARD

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 8 o.c. Gypsum board end joints located over continuous channels and attached to additional pieces of channel 54" long located midway between continuous channels at end joints. Furring channels 24" o.c. suspended from 2 1/2" precast reinforced concrete joists 35" o.c. with 21 ga galvanized steel hanger straps fastened to sides of joists. Joist leg depth, 10".

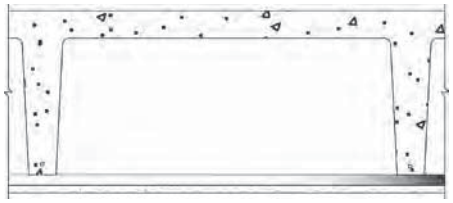

Approx. Ceiling Weight: 3 psf
Fire Test: PCA 1281-1, 10-67

FLOOR-CEILING SYSTEMS, NONCOMBUSTIBLE

GA FILE NO. FC 2130

PROPRIETARY*

2 HOUR FIRE

STEEL JOISTS, CONCRETE SLAB, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 62" long with screws 12" o.c. Furring channels attached with 18 ga wire ties to open web steel joists 24" o.c. supporting 3/8" rib metal lath and 2" concrete slab. (Two hours restrained and unrestrained.)

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® TYPE X
CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	5/8" Firecheck® Type C
National Gypsum Company	-	5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	5/8" FLAME CURB® Type X
Temple-Inland	-	5/8" Type X

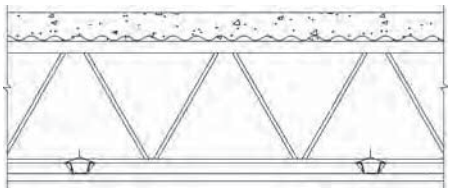

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R2717-43, 7-29-66, UL Design G505; ULC Design I512

GA FILE NO. FC 2131

PROPRIETARY*

2 HOUR FIRE

STEEL JOISTS, CONCRETE SLAB, GLASS MAT GYPSUM SUBSTRATE

One layer 5/8" proprietary type X glass mat gypsum substrate applied at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum panel end joints located midway between continuous channels and attached to additional pieces of channel 62" long with screws 12" o.c. Furring channels attached with 18 ga wire ties to open web steel joists 24" o.c. supporting 3/8" rib metal lath and 2" concrete slab. (Two hours restrained and unrestrained.)

PROPRIETARY GYPSUM PANEL PRODUCTS

Georgia Pacific Gypsum LLC	-	5/8" DensArmor Plus® Fireguard® Interior Panel
Temple-Inland	-	5/8" GreenGlass Type X

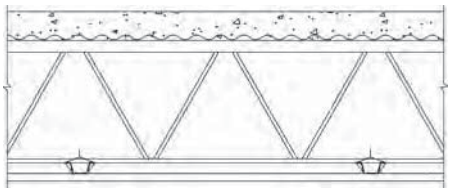

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R6937, 08NK02787, 9-19-08, UL Design G505

GA FILE NO. FC 2160

GENERIC

2 HOUR FIRE

STEEL JOISTS, CONCRETE SLAB, METAL LATH, GYPSUM PLASTER

5/8" gypsum-vermiculite plaster or 7/8 " gypsum-wood fiber plaster applied over 3/8" rib metal lath wire tied with 18 ga wire 5" o.c. to open web steel joists 24" o.c. supporting 3/8" rib metal lath and 2" concrete slab.

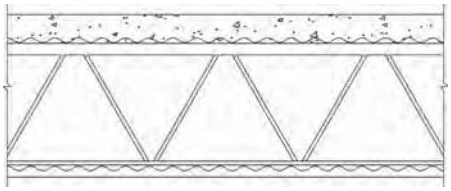

Approx. Ceiling Weight: 3 psf
Fire Test: BMS 92-43, 10-7-42

Contact the manufacturer for more detailed information on proprietary products.

FLOOR-CEILING SYSTEMS, NONCOMBUSTIBLE

GA FILE NO. FC 2170 — GENERIC — 2 HOUR FIRE

STEEL JOISTS, CONCRETE SLAB, METAL LATH, GYPSUM PLASTER

3/4" 1:1 gypsum-sand wood-fibered plaster applied over 3.4 lb. metal lath wire tied 6" o.c. with 18 ga wire 6" o.c. to 3/4" cold rolled channels 13 1/2" o.c. Channels wire tied with 18 ga wire to open web steel joists 24" o.c. supporting 3/8" rib metal lath and 2 1/2" concrete slab.

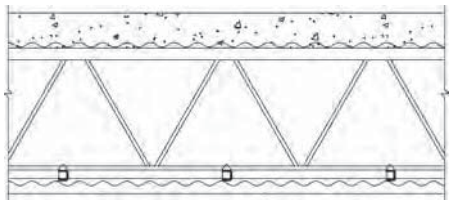

Approx. Ceiling Weight: 4 psf
Fire Test: UL R5429-1, 9-23-66

GA FILE NO. FC 2190 — PROPRIETARY* — 2 HOUR FIRE

STEEL JOISTS, CONCRETE SLAB, METAL LATH, GYPSUM TILES

Nominal 24" x 24" x 1/2" proprietary type X gypsum wallboard lay-in panels supported by steel suspension system suspended from steel open web joists supporting 3/8" rib metal lath and 2 1/2" concrete slab. (Two hour restrained and unrestrained.)

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	1/2" FireBloc® Type C
CertainTeed Gypsum Inc.	-	1/2" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	1/2" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	1/2" Firecheck® Type C
National Gypsum Company	-	1/2" Gridstone® Brand Ceiling Panels
Temple-Inland	-	1/2" TG-C
United States Gypsum Company	-	1/2" SHEETROCK® Brand ClimaPlus™ Gypsum Lay-In Panels

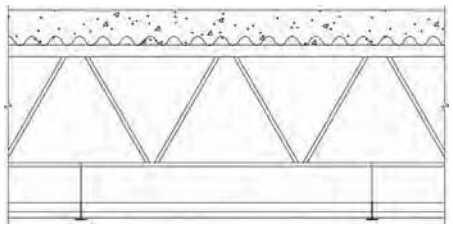

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R1319-126, 6-16-70; UL R3501, 92NK28896, 9-15-93; UL Design G222

GA FILE NO. FC 2191 — PROPRIETARY* — 2 HOUR FIRE

STEEL TRUSSES, CONCRETE SLAB, RESILIENT CHANNELS, GYPSUM WALLBOARD

Base layer 5/8" proprietary type X gypsum wallboard applied at right angles to resilient or rigid furring channels spaced 16" o.c. with 1 1/8" Type S drywall screws 12" o.c. Gypsum board end joints attached with screws 12" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. **Face** layer 5/8" proprietary type X gypsum wallboard applied at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. Face layer joints offset not less than 16" from base layer joints. Channels applied at right angles to bottom chord of light-gage steel trusses 48" o.c. with 1/2" Type S-12 screws **(refer to furring channel manufacturer for maximum spans)**. Trusses supporting 3/8" rib metal lath and 2" normal or lightweight concrete slab.

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® Type C
Temple-Inland	-	5/8" TG-C

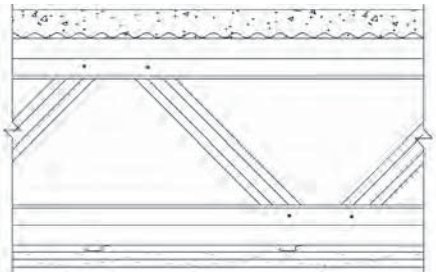

Approx. Ceiling Weight: 5 psf
Fire Test: UL R14196, 08CA28783, 2-15-08; UL R6937, 08NK02787, 9-19-08; UL Design G567

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, NONCOMBUSTIBLE

GA FILE NO. FC 2192

PROPRIETARY*

2 HOUR FIRE

STEEL JOISTS, CONCRETE SLAB, METAL LATH, GYPSUM TILES

Nominal 24" x 24" x 1/2" proprietary type X gypsum wallboard lay-in panels supported by steel suspension system suspended from steel open web joists supporting 3/8" rib metal lath and 2 1/2" concrete slab. (Two hour restrained and unrestrained.)

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 1/2" FireBloc CP Gypsum Lay-In Ceiling Panels

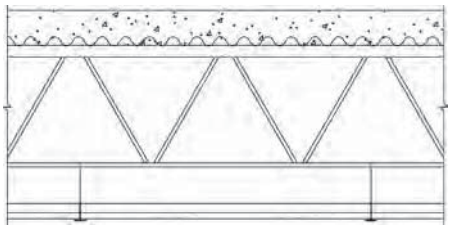

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R14196, 09NK14830 6-3-10; UL Design G222

GA FILE NO. FC 3012

PROPRIETARY*

3 HOUR FIRE | **50 to 54 STC SOUND**

STEEL JOISTS, CONCRETE SLAB, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to furring channels 24" o.c. (double channels at end joints) with 1" Type S drywall screws 12" o.c. 5/8" x 2 3/4" type X gypsum wallboard strips over butt joints. Furring channels wire tied to open web steel joist 24" o.c. supporting 3/8" rib metal lath and 2 1/2" concrete slab. (Three hour restrained and unrestrained.)

(See GA File No. BM 3212)

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® Type C
CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type C Gypsum Board
CertainTeed Gypsum Canada Inc.	-	5/8" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	5/8" Firecheck® Type C
National Gypsum Company	-	5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	5/8" FLAME CURB® Super 'C'™
Temple-Inland	-	5/8" TG-C
United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

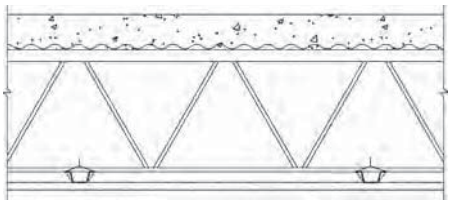

Approx. Ceiling Weight: 3 psf
Fire Test: UL R1319-79, 4-14-65 (Rev. 4-4-77); UL R3501, 88NK21023, 11-27-89; Based on UL R3660-7, -8, 11-12-87; UL R2717-61, 8-18-87; UL Design G512
Sound Test: Est. see FC 2030 (NGC 4075, 3-25-69)

GA FILE NO. FC 3140

GENERIC

3 HOUR FIRE

STEEL JOISTS, METAL LATH, GYPSUM PLASTER

5/8" 1:2-1:3 gypsum-vermiculite plaster or 7/8" neat-wood fiber gypsum plaster applied over 3.4 lb. metal lath wire tied with 18 ga wire 5" o.c. to open web steel joists 24" o.c. supporting 3/8" rib metal lath and 2 1/2" concrete slab.

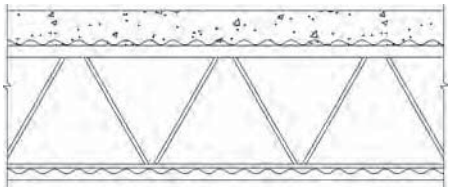

Approx. Ceiling Weight: 4 psf
Fire Test: BMS 92/43, 10-7-42

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, NONCOMBUSTIBLE

GA FILE NO. FC 3150 | **GENERIC** | **3 HOUR FIRE**

CONCRETE SLAB, CELLULAR STEEL DECK, METAL LATH, GYPSUM PLASTER

5/8" thick mill-mixed gypsum-perlite plaster applied over 3.4 lb. metal lath wire tied to 3/4" cold rolled channels 12" o.c. wire tied to 1 1/2" cold rolled channels 48" o.c. suspended 16" with 8 ga steel wire 36" o.c. from 2" concrete slab over 3" cellular steel deck supported by steel beam. **(Three hour restrained and unrestrained.)**

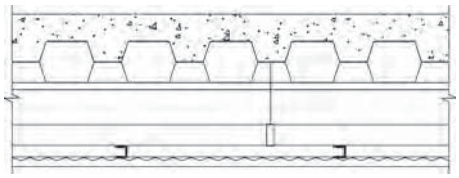

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R3574-6, 7-25-57

GA FILE NO. FC 4120 | **GENERIC** | **4 HOUR FIRE**

STEEL JOISTS, CONCRETE SLAB, METAL LATH, GYPSUM PLASTER

7/8" 1:2-1:3 gypsum-vermiculite plaster applied over 3/8" rib metal lath wire tied 5" o.c. to open web steel joists 24" o.c. supporting 3/8" rib metal lath and 2 1/2" concrete slab.

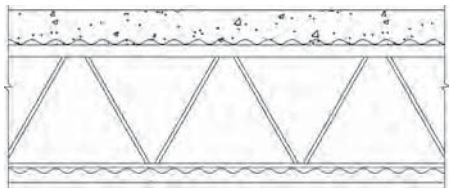

Approx. Ceiling Weight: 5 psf
Fire Test: BMS 92/43, 10-7-42

This Space Left Blank

FLOOR-CEILING SYSTEMS, STEEL FRAMED, WOOD FLOOR

GA FILE NO. FC 4340

GENERIC

1 HOUR FIRE

50 to 54 STC SOUND

GYPSUM WALLBOARD, STEEL CHANNEL JOISTS, PLYWOOD FLOOR

Base layer 1/2" type X gypsum wallboard applied at right angles to resilient furring channels 16" o.c. with 1 1/4" Type S drywall screws 12" o.c. Resilient furring channels applied at right angles to channel shaped, minimum 8" deep, 18 ga galvanized steel joists 16" o.c. with 3/4" Type S-12 drywall screws. **Face** layer 1/2" type X gypsum wallboard applied at right angles to channels with end joints located midway between channels. Face layer attached to channels with 1 5/8" Type S drywall screws 12" o.c. End joints attached to base layer with 1 1/2" Type G screws 12" o.c. placed 1 1/2" back from either side of end joints. Joints offset 24" from base layer joints. 3 1/2" glass fiber batt insulation in joist space. Floor of 5/8" T & G edge plywood applied at right angles to joists with 1 1/4" No. 10 bugle head screws pilot tip 6" o.c. and end joints and 12" o.c at intermediate joists.

STC tested with 1/4" carpet applied over a 3/8" foam pad.

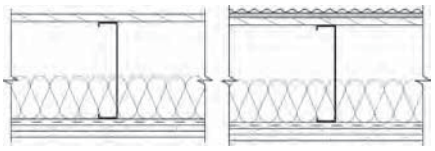

Approx. Ceiling Weight: 4 psf
Fire Test: NRCC A-4219.A, 4-29-98, Assembly FF-23
Sound Test: NRCC B-3163.2, 3-15-01
IIC & Test: 69; NRCC B-3163.2, 3-15-01

GA FILE NO. FC 4370

GENERIC

1 HOUR FIRE

45 to 49 STC SOUND

GYPSUM WALLBOARD, STEEL CHANNEL JOISTS, PLYWOOD FLOOR

Base layer 1/2" type X gypsum wallboard applied at right angles to resilient furring channels 16" o.c. with 1 1/4" Type S drywall screws 12" o.c. Resilient furring channels applied at right angles to channel shaped, minimum 8" deep, 18 ga galvanized steel joists 16" o.c. with 3/4" Type S-12 drywall screws. **Face** layer 1/2" type X gypsum wallboard applied at right angles to channels with end joints located midway between channels. Face layer attached to channels with 1 5/8" Type S drywall screws 12" o.c. End joints attached to base layer with 1 1/2" Type G screws 12" o.c. placed 1 1/2" back from either side of end joints. Joints offset 24" from base layer joints. 3 1/2" glass fiber batt insulation in joist space. Floor of 5/8" T & G edge plywood applied at right angles to joists with 1 1/4" No. 10 bugle head screws with 3/4" pilot tip 6" o.c. and end joints and 12" o.c at intermediate joists.

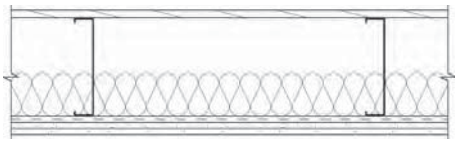

Approx. Ceiling Weight: 4 psf
Fire Test: NRCC A-4219.A, 4-29-98, Assembly FF-23
Sound Test: NRCC B-3163.1, 3-15-01
IIC & Test: 39; NRCC B-3163.1, 3-15-01

GA FILE NO. FC 4490

GENERIC

1 HOUR FIRE

35 to 39 STC SOUND

STEEL CHANNEL JOISTS, GYPSUM WALLBOARD

Base layer 5/8" type X gypsum wallboard applied at right angles to channel shaped steel joists 24" o.c. with 1 1/4" Type S drywall screws 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to joists with 1 7/8" Type S drywall screws 12" o.c. at joints and intermediate joists and 1 1/2" Type G drywall screws 12" o.c. placed 2" back on either side of end joints. Joints offset 24" from base layer joints. Steel joists supporting 1/2" wood structural panels applied at right angles to joists with screws. **Ceiling provides one hour fire resistance protection for framing.**

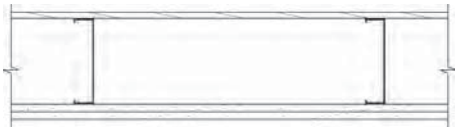

Approx. Ceiling Weight: 5 psf
Fire Test: FM FC 172, 2-25-72; ITS, 8-6-98
Sound Test: Estimated

FLOOR-CEILING SYSTEMS, STEEL FRAMED, WOOD FLOOR

GA FILE NO. FC 4502 — PROPRIETARY* — 1 HOUR FIRE

STEEL CHANNEL JOISTS, PLYWOOD FLOOR, GYPSUM WALLBOARD CEILING

Base layer 1/2" proprietary type X gypsum wallboard applied at right angles to channel shaped, minimum 7" deep, 18 ga galvanized steel joists 24" o.c. with 1" Type S-12 drywall screws 8" o.c. at butt joints and 12" o.c. at intermediate joists. **Face** layer 1/2" proprietary type X gypsum wallboard applied at right angles to joists with 1 1/2" Type G drywall screws at butt joints between joists and 1 5/8" Type S-12 drywall screws 12" o.c. at intermediate joists. Joints offset from base layer joints. Steel joists supporting 5/8" T & G edge plywood floor applied at right angles to joists with 1 15/16" No. 6-20 S-12 point screws 6" o.c. at floor perimeter and end joints and 10" o.c. at intermediate joists. For alternate floor systems, consult manufacturer.

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	1/2" FireBloc® Type C
CertainTeed Gypsum Inc.	-	1/2" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	1/2" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	1/2" Firecheck® Type C
National Gypsum Company	-	1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	1/2" FLAME CURB® Super 'C'™
Temple-Inland	-	1/2" TG-C
United States Gypsum Company	-	1/2" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

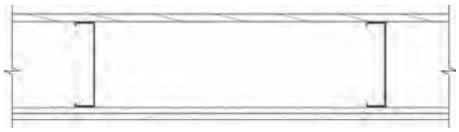

Approx. Ceiling Weight: 4 psf
Fire Test: Based on UL R3660-7, -8, 11-12-87; UL R1319-133, 7-16-75; UL R7094, 90NK10635, 10-24-90; UL Design L524

GA FILE NO. FC 4503 — GENERIC — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL CHANNEL JOISTS, PLYWOOD FLOOR

Base layer 1/2" type X gypsum wallboard applied at right angles to channel shaped, minimum 6" deep, 16 ga galvanized steel joists 24" o.c. with 1" Type S-12 drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard applied at right angles to joists with 1 5/8" Type S-12 drywall screws 12" o.c. at end joints and intermediate joists and 1 1/2" Type G screws 12" o.c. placed 3" back from either side of end joints and staggered 6" from Type S-12 screws at joint. Joints offset 24" from base layer joints.

Floor of 3/4" T & G edge plywood applied at right angles to joists with 1 7/8" No. 6 Phillips head screws with 3/4" pilot tip 6" o.c. and end joints and 12" o.c at intermediate joists.



Approx. Ceiling Weight: 4 psf
Fire Test: FM FC 205-1, 11-16-73

GA FILE NO. FC 4504 — GENERIC — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL CHANNEL JOISTS, WOOD STRUCTURAL PANEL FLOOR

Base layer 1/2" type X gypsum wallboard applied at right angles to channel shaped, minimum 8" deep, 18 ga galvanized steel joists 16" o.c. with 1 1/4" Type S-12 drywall screws 12" o.c. Base layer butt joints staggered 48" in adjacent courses. **Face** layer 1/2" type X gypsum wallboard applied at right angles to joists with end joints located midway between joists. Face layer attached to joists with 1 1/2" Type S-12 drywall screws 12" o.c. End joints attached to base layer with 1 1/2" Type G screws 12" o.c. placed 1 1/2" back from either side of end joints. Face layer edge joints offset 24" from base layer edge joints. Face layer end joints offset 36" from base layer end joints. Joists supporting 5/8" nominal wood structural panel floor with long edges T & G attached at right angles to joists with 1 1/4" No. 10 bugle head screws with 3/4" pilot tip 6" o.c. at end joints and 12" o.c. at intermediate joists.

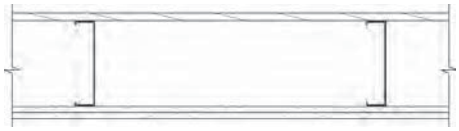

Approx. Ceiling Weight: 4 psf
Fire Test: NRCC B-4216.1, 3-3-05, Assembly FF-51

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, STEEL FRAMED, WOOD FLOOR

GA FILE NO. FC 4515

PROPRIETARY*

1 HOUR FIRE

STEEL TRUSSES, RESILIENT CHANNELS, MINERAL OR GLASS FIBER INSULATION, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels with 1 1/8" Type S drywall screws 12" o.c. Resilient channels spaced 12" o.c. when insulation is used or 16" o.c. when no insulation is used. Gypsum board end joints attached with screws 12" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of light-gage steel trusses 48" o.c. with 1/2" Type S-12 screws. Optional glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting 23/32" wood structural panel subfloor applied at right angles to trusses with construction adhesive and mechanical fasteners 12" o.c. and 15/32" wood structural panel underlayment applied at right angles to trusses with mechanical fasteners 12" o.c. Joints staggered between underlayment and subfloor.

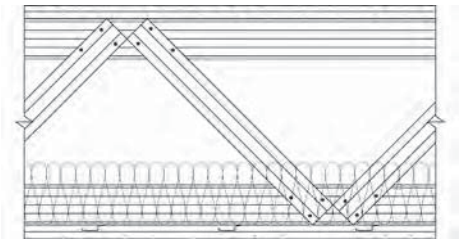

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

Approx. Ceiling Weight: 3 psf
Fire Test: UL R3501, 01NK49664, 9-5-02, UL Design L565

GA FILE NO. FC 4516

PROPRIETARY*

1 HOUR FIRE

STEEL TRUSSES, RESILIENT CHANNELS, MINERAL OR GLASS FIBER INSULATION, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard applied at right angles to resilient furring channels with 1" Type S drywall screws 12" o.c. Resilient channels spaced 12" o.c. when insulation is used or 16" o.c. when no insulation is used. Gypsum board end joints attached with screws 12" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of light-gage steel trusses 48" o.c. with 1/2" Type S-12 screws. Optional glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting 23/32" wood structural panel subfloor applied at right angles to trusses with construction adhesive and mechanical fasteners 12" o.c. and 15/32" wood structural panel underlayment applied at right angles to trusses with mechanical fasteners 12" o.c. Joints staggered between underlayment and subfloor.

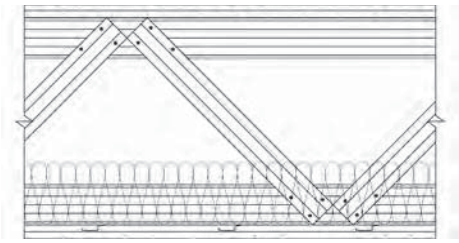

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type C
Temple-Inland - 5/8" TG-C

Approx. Ceiling Weight: 3 psf
Fire Test: UL R14196, 08CA28783, 2-15-08; UL R6937, 08NK02787, 9-19-08; UL Design L597

GA FILE NO. FC 4750

GENERIC

2 HOUR FIRE

WOOD FLOOR, STEEL CHANNEL JOISTS, GYPSUM WALLBOARD, RIGID FURRING CHANNELS

Base layer 5/8" type X gypsum wallboard applied at right angles to channel shaped, minimum 8" deep, 18 ga galvanized steel joists 24" o.c. with 1 1/8" Type S-12 drywall screws 12" o.c. **Second** layer 5/8" type X gypsum wallboard applied at right angles to joists with 1 5/8" Type S-12 drywall screws 12" o.c. Second layer joints offset 24" from base layer joints. **Third** layer 5/8" type X gypsum wallboard applied at right angles to joists with 2 3/8" Type S-12 drywall screws 12" o.c. Third layer joints offset 12" from second layer joints. Hat-shaped rigid furring channels 24" o.c. applied at right angles to joists over third layer with two 2 3/8" long Type S-12 drywall screws at each joist. **Face** layer 5/8" type X gypsum wallboard applied at right angles to furring channels with 1 1/8" Type S drywall screws 12" o.c. Joists supporting 3/4" T & G edge plywood floor applied at right angles to joists with #10x1 5/8" screws 12". **Ceiling provides two hour fire resistance protection for framing.**

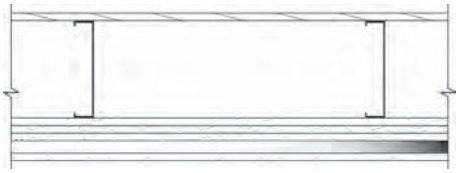

Approx. Ceiling Weight: 12 psf
Fire Test: UL R4024, 02NK04478, 2-20-03, UL Design L556; ULC Design M514

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 4990 | **PROPRIETARY*** | **3/4 HOUR FIRE**

WOOD JOISTS, GLASS PANEL PRODUCT

One layer 5/8" proprietary type X gypsum panels applied at right angles to 2 x 10 wood joists 16" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 6" o.c. Wood joists supporting 1" nominal wood subfloor and 1" nominal wood finish floor, or 19/32" plywood finished floor with long edges T&G and 15/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered.

PROPRIETARY GYPSUM PANEL PRODUCT

Temple-Inland - 5/8" Type X ComfortGuard Sound Deadening Gypsum Board

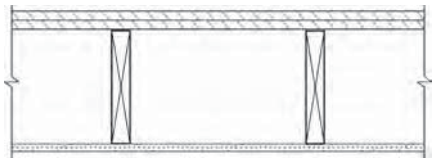

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R6937, 08NK14525, 11-10-08; 09NK10599, 7-24-09; UL Design M504

GA FILE NO. FC 5011 | **PROPRIETARY*** | **1 HOUR FIRE** | **60 to 64 STC SOUND**

WOOD I-JOISTS, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS FIBER BATT OR LOOSE FILL INSULATION, GYPSUM WALLBOARD

Base layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. (16" o.c. when insulation is used) with 1" Type S drywall screws 16" o.c. Gypsum board end joints located midway between continuous channels and attached with screws 8" to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to minimum 10" deep wood I joists spaced a maximum of 19" o.c. with 1 1/4" Type S drywall screws. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 1 5/8" Type S drywall screws 8" o.c. and 1 1/2" Type G screws 8" o.c. at the butt joints located mid-span between the resilient channels. Glass fiber insulation secured to subfloor or loose fill insulation applied directly over gypsum board. Wood I joists supporting 19/32" wood structural panel subfloor applied at right angles to joists with construction adhesive and 6d ring shank nails 12" o.c. Minimum 1/2" proprietary gypsum floor topping applied over subfloor.

STC rated with I joists spaced 24" o.c., 3 1/2" glass fiber insulation in joist spaces, 3/4" proprietary gypsum floor topping poured over 1/4" proprietary sound reduction mat, and with finish flooring of sheet vinyl, engineered wood laminate, and ceramic tile. (STC 64 when sheet vinyl or engineered wood laminate is applied to floor; STC 66 when tested with ceramic tile applied to floor.)

PROPRIETARY GYPSUM COMPONENTS

United States Gypsum Company - 1/2" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels
- LEVELROCK® Brand Floor Underlayment

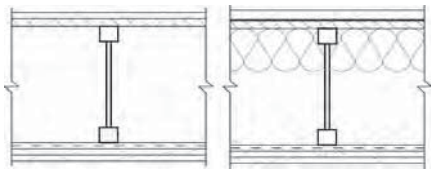

Approx. Ceiling Weight: 3 psf
Fire Test: UL R1319, 05NK04589, 2-4-05; UL R1319, 05NK09496, 3-31-05; UL Design L570
Sound Test: RAL OT03-05, 4-22-03; RAL OT03-07, 4-29-03; RAL OT03-09, 6-18-03
IIC & Test: (58 sheet vinyl), RAL OT03-06, 4-22-03; (62 engineered wood laminate) RAL OT03-08, 4-29-03; (54 ceramic tile) RAL OT03-10, 6-18-03

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5012 | **PROPRIETARY*** | **1 HOUR FIRE** | **60 to 64 STC SOUND**

WOOD TRUSSES, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS OR MINERAL FIBER BATT OR BLANKET INSULATION OR LOOSE FILL CELLULOSE INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 16" o.c. (12" o.c. when insulation batts or blankets are draped over resilient channels or when loose fill insulation is applied to the back of the ceiling membrane) with 1" Type S drywall screws 8" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 60" long with screws 8" o.c. Resilient furring channels applied at right angles to minimum 12" deep parallel chord wood trusses 24" o.c. with 1 1/4" Type S drywall screws. Glass fiber or mineral fiber batt batt or blanket insulation draped over the resilient channels, or loose-fill cellulose insulation spray applied to the back of the ceiling membrane. Wood trusses supporting 23/32" nominal wood structural panel subfloor applied at right angles to trusses with construction adhesive and 6d ring shank nails 12" o.c. 3/4" proprietary gypsum floor topping applied over subfloor. Optional ceiling damper (refer to manufacturer for information on the type of damper).

STC rated with wood trusses spaced 24" o.c., 3 1/2" glass fiber insulation against the floor side in joist spaces, 1" proprietary gypsum floor topping poured over 1/4" proprietary sound reduction mat, and with finish flooring of sheet vinyl, cushioned sheet vinyl, carpet & pad, ceramic tile, and engineered wood laminate. (STC 61 when engineered wood laminate is applied to floor; STC 62 when tested with sheet vinyl, cushioned sheet vinyl, carpet & pad, or ceramic tile applied to floor.)

PROPRIETARY GYPSUM COMPONENTS

United States Gypsum Company
- 5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels
- LEVELROCK® Brand Floor Underlayment

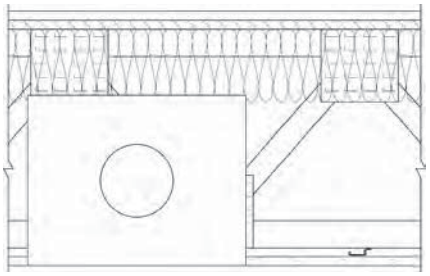

Approx. Ceiling Weight: 3 psf

Fire Test: UL R1319, 97NK28582, 11-20-97, UL R5698, 04NK16820, 6-29-04, UL Design L521; UL R9660, 99NK7096, 5-17-99, UL R1319, 99NK7095, 5-17-99, UL Design L550; UL R15858, 02NK24136, 3-20-03, UL Design L563

Sound Test: RAL OT04-01, 1-19-04; RAL OT04-03, 1-20-04; RAL OT04-05, 1-21-04; RAL OT04-07, 1-26-04; RAL OT04-11, 4-16-04

IIC & Test: (81 generic C&P), RAL OT04-06, 1-21-04; (55 cushion sheet vinyl) RAL OT04-04, 1-20-04; (55 engineered wood laminate) RAL OT04-08, 1-26-04; (54 ceramic tile) RAL OT04-12, 4-16-04; (53 generic sheet vinyl) RAL OT04-02, 1-19-04

GA FILE NO. FC 5102 | **PROPRIETARY*** | **1 HOUR FIRE** | **55 to 59 STC SOUND**

WOOD TRUSSES, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS OR MINERAL FIBER BATT OR LOOSE FILL INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to 7/8" rigid furring channels 24" o.c. with 1" Type S drywall screws 8" o.c. Rigid furring channels attached to trusses with proprietary resilient sound isolation clips spaced 48" o.c. Gypsum board end joints located midway between continuous channels and attached with screws 8" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. **Face** layer 5/8" proprietary type X gypsum wallboard applied at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. Glass or mineral fiber batt insulation stapled to subfloor or loose fill insulation applied directly over gypsum board. Wood trusses supporting 23/32" wood structural panel subfloor, long edges T&G, applied at right angles to trusses with 6d ring shank nails, or staples having equal or greater withdrawal and lateral resistance strength, 12" o.c. Either 3/4" gypsum floor topping or 15/32" wood structural panel underlayment applied over subfloor.

Optional ceiling damper (refer to manufacturer for information on the type of damper).

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type C

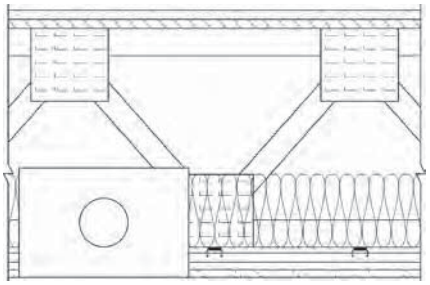

Approx. Ceiling Weight: 5 psf

Fire Test: UL R14196, 09NK08803, 2-15-08, UL Design L574

Sound Test: RAL TL09-244a, 8-27-09

IIC & Test: (73 C & P) RAL IN09-045a, 8-27-09

Contact the manufacturer for more detailed information on proprietary products.

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5103

PROPRIETARY*

1 HOUR FIRE | **55 to 59 STC SOUND**

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS, GLASS OR MINERAL FIBER INSULATION

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to 7/8" rigid furring channels 24" o.c. with 1" Type S drywall screws 8" o.c. Rigid furring channels attached to trusses with proprietary resilient sound isolation clips spaced 48" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 60" long with screws 12" o.c. Resilient furring channels applied at right angles to 12" deep parallel chord wood trusses 24" o.c. with 1 1/4" Type S drywall screws. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels with 1 5/8" Type S drywall screws 8" o.c. Glass or mineral fiber insulation, 3 1/2" thick, loose-laid on resilient channels. Wood trusses supporting 3/4" nominal interior plywood with exterior glue, T & G edges, applied at right angles to trusses with construction adhesive and 6d ring shank nails 12" o.c. Adhesive applied to each top chord and grooved edges of plywood. End joints staggered 48".

Consult gypsum board manufacturer for truss details.

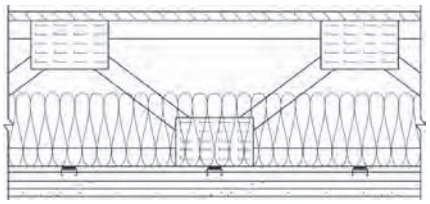

Approx. Ceiling Weight: 3 psf
Fire Test: UL R14196, 09NK08803, 2-15-08, UL Design L528
Sound Test: RAL TL09-244a, 8-27-09
IIC & Test: (73 C & P) RAL IN09-045a, 8-27-09

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® TypeC

GA FILE NO. FC 5104

PROPRIETARY*

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM PANEL PRODUCTS, RESILIENT CHANNELS, WOOD JOISTS

One layer 1/2" proprietary type X glass mat gypsum panels applied at right angles to resilient furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 60" long with screws at 12" o.c. Resilient channels applied at right angles to 2 x 10 wood joists 16" o.c. with 6d common nails. Wood joists supporting 19/32" plywood and 1" proprietary sanded gypsum underlayment.

STC rated with 3 1/2" glass fiber insulation in joist spaces and with carpet and pad. **Second layer of 1/2" or 5/8" type X gypsum wallboard required to achieve 1 hour fire resistance rating when glass fiber insulation is used.**

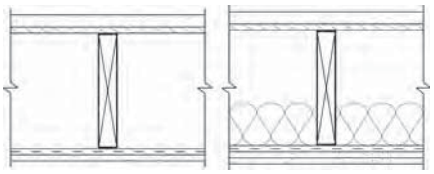

Approx. Ceiling Weight: 2 psf
Fire Test: UL R2717, UL Design L502
Sound Test: G&H BW-10 MT, 10-13-70
IIC & Test: (73 C & P) G&H BW-10 MT, 10-13-70

PROPRIETARY GYPSUM PANEL PRODUCT

Georgia Pacific Gypsum LLC	-	1/2" DensArmor Plus® Fireguard® Interior Panel

GA FILE NO. FC 5105

PROPRIETARY*

1 HOUR FIRE | **55 to 59 STC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, WOOD JOISTS

One layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 60" long with screws at 12" o.c. Resilient channels applied at right angles to 2 x 10 wood joists 16" o.c. with 6d common nails. Wood joists supporting 19/32" plywood and 1" proprietary sanded gypsum underlayment.

STC rated with 3 1/2" glass fiber insulation in joist spaces and with carpet and pad. **Second layer of 1/2" or 5/8" type X gypsum wallboard required to achieve 1 hour fire resistance rating when glass fiber insulation is used.**

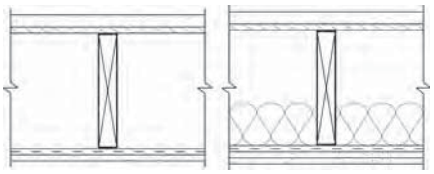

Approx. Ceiling Weight: 2 psf
Fire Test: UL R6352, 4-21-71, UL Design L502
Sound Test: G&H BW-10 MT, 10-13-70
IIC & Test: (73 C & P) G&H BW-10 MT, 10-13-70

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	-	1/2" CertainTeed® Type C Gypsum Board
CertainTeed Gypsum Canada Inc.	-	1/2" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	1/2" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	1/2" Firecheck® Type C
National Gypsum Company	-	1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	1/2" FLAME CURB® Super 'C'™
Temple-Inland	-	1/2" TG-C

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5107

PROPRIETARY*

1 HOUR FIRE | **55 to 59 FSTC SOUND**

GYPSUM WALLBOARD, RESILIENT CHANNELS, WOOD JOISTS, GYPSUM FLOOR UNDERLAYMENT

One layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 54" long with screws at 12" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with 1 1/4" Type W screws. Wood joists supporting 19/32" plywood subfloor and 3/4" 1000 psi sanded gypsum floor underlayment.

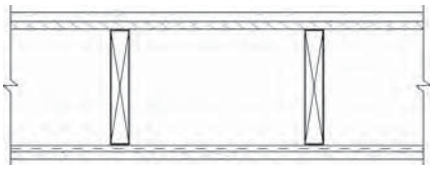

Approx. Ceiling Weight: 3 psf
Fire Test: UL R1319-65, 11-16-64, UL Design L514
Field Sound Test: INTEST 5-761-3, 12-5-77

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	1/2" FireBloc® Type C
CertainTeed Gypsum Inc.	-	1/2" CertainTeed® Type C Gypsum Board
CertainTeed Gypsum Canada Inc.	-	1/2" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	1/2" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	1/2" Firecheck® Type C
National Gypsum Company	-	1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	1/2" FLAME CURB® Super 'C'™
Temple-Inland	-	1/2" TG-C
United States Gypsum Company	-	1/2" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

GA FILE NO. FC 5109

PROPRIETARY*

1 HOUR FIRE | **55 to 59 STC SOUND**

WOOD JOISTS, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS OR MINERAL FIBER BATT OR LOOSE FILL INSULATION, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. (16" o.c. when batt insulation is used; 12" o.c. when loose fill insulation is used) with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached with screws 8" to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to nominal 2 x 10 wood joists spaced a maximum of 24" o.c. with 1 1/4" Type S drywall screws. Glass or mineral fiber batt insulation stapled to subfloor or or loose fill insulation applied directly over gypsum board. Wood joists supporting 15/32" wood structural panel subfloor applied at right angles to joists with construction adhesive and 6d ring shank nails 12" o.c. Minimum 1/2" proprietary gypsum floor topping applied over subfloor.

STC and IIC rated with both joists and resilient channels spaced 16" o.c., 3 1/2" glass fiber insulation in joist spaces, 3/4" proprietary gypsum floor topping poured over 1/4" proprietary sound reduction mat, and with finish flooring of C&P, sheet vinyl, and engineered wood laminate.

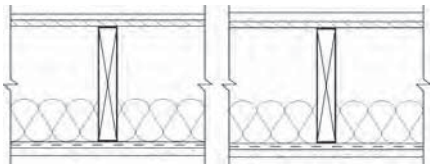

Approx. Ceiling Weight: 3 psf
Fire Test: UL R1319, 05NK04589, 2-4-05; UL R1319, 05NK09496, 3-31-05; UL Design L569
Sound Test: RAL TL04-97 & 98, 4-22-04; RAL TL04-99, - 100, -101, 4-26-04; RAL TL04-109, 4-30-04
IIC & Test: (73 generic C&P), RAL IN04-010, 4-22-04; (52 cushion sheet vinyl) RAL IN04-011, 4-22-04; (51 engineered wood laminate) RAL IN04-012, 4-26-04; (50 cushion sheet vinyl) RAL IN04-013, 4-26-04; (48 generic sheet vinyl) RAL IN04-014, 4-26-04; (45 cushion sheet vinyl & channels spaced 24" o.c.) RAL IN04-015, 4-30-04

PROPRIETARY GYPSUM COMPONENTS

United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels
	-	LEVELROCK® Brand Floor Underlayment

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5111

GENERIC

1 HOUR FIRE

50 to 54 STC SOUND

WOOD I-JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

Base layer 1/2" type X gypsum wallboard applied at right angles to resilient channels 16" o.c. with 1 1/4" Type S drywall screws 12" o.c. Resilient channels applied at right angles to minimum 9 1/2" deep wood I-joists, with minimum 1 1/4" deep x 1 1/2" wide flanges and minimum 3/8" webs, 24" o.c. with 1 1/4" Type W drywall screws. **Face** layer 1/2" type X gypsum wallboard applied at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. Face layer end joints located midway between channels and attached to base layer with 1 1/2" Type G screws 12" o.c. Edge joints offset 24" from base layer edge joints. Wood I-joists supporting 5/8" oriented strand board applied at right angles to I-joists with 8d common nails 12" o.c.

STC and IIC tested with 40 oz carpet over 1/4" foam pad.

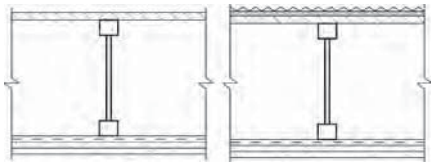

Approx. Ceiling Weight:	5 psf
Fire Test:	NRCC A-4440.1 (Revised), 6-24-97
Sound Test:	NRCC B-3150.2, 6-30-00
IIC & Test:	(68 C & P) NRCC B-3150.2, 6-30-00

GA FILE NO. FC 5112

PROPRIETARY*

1 HOUR FIRE

50 to 54 STC SOUND

WOOD JOISTS, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS OR MINERAL FIBER BATT OR LOOSE FILL INSULATION, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. (16" o.c. when batt insulation is used; 12" o.c. when loose fill insulation is used) with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached with screws 8" to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to nominal 2 x 10 wood joists spaced a maximum of 24" o.c. with 1 1/4" Type S drywall screws. Glass or mineral fiber batt insulation stapled to subfloor or or loose fill insulation applied directly over gypsum board. Wood joists supporting 15/32" wood structural panel subfloor applied at right angles to joists with construction adhesive and 6d ring shank nails 12" o.c. Minimum 1/2" proprietary gypsum floor topping applied over subfloor.

STC and IIC rated with both joists and resilient channels spaced 16" o.c., 3 1/2" glass fiber insulation in joist spaces, 1" proprietary gypsum floor topping poured over 1/4" proprietary sound reduction mat, and with finish flooring of C&P, sheet vinyl, engineered wood laminate, and ceramic tile.

PROPRIETARY GYPSUM COMPONENTS

United States Gypsum Company
- 5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels
- LEVELROCK® Brand Floor Underlayment

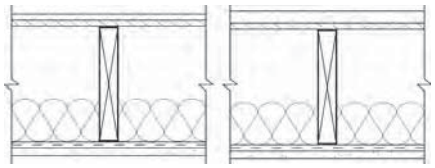

Approx. Ceiling Weight:	3 psf
Fire Test:	UL R1319, 05NK04589, 2-4-05; UL R1319, 05NK09496, 3-31-05; UL Design L569
Sound Test:	RAL TL04-31 & 32, 2-11-04; RAL TL04-33 & 34, 2-22-04; RAL TL04-67, 3-19-04
IIC & Test:	(51 generic sheet vinyl), RAL IN04-004, 4-22-04; (77 generic C&P) RAL IN04-005, 4-22-04; (54 cushion sheet vinyl) RAL IN04-006, 4-26-04; (55 engineered wood laminate) RAL IN04-007, 4-26-04; (52 ceramic tile) RAL IN04-009, 4-26-04

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5115

PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS, GLASS FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 54" long with screws 12" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with 1 1/4" Type W drywall screws. Wood joists supporting 5/8" interior plywood with exterior glue subfloor and 1 5/8" perlite-sand concrete reinforced with No. 19 SWG galvanized hexagonal wire mesh. 3" glass fiber insulation 0.90 pcf in joist space stapled to subfloor.

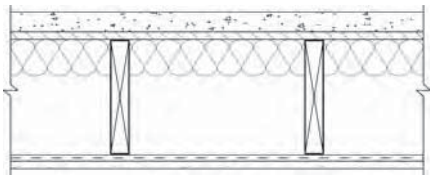

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

Approx. Ceiling Weight: 2 psf
Fire Test: UL R3453-7, 5-1-70; UL Design L516
Sound Test: KAL L 224-28-65, 3-30-65
IIC & Test: (74 C & P) KAL L 224-27-65, 3-30-65

GA FILE NO. FC 5116

PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS, GLASS FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 54" long with screws at 12" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with 1 1/4" Type W drywall screws. Wood joists supporting 5/8" interior plywood with exterior glue subfloor and 1 5/8" perlite-sand concrete reinforced with No. 19 SWG galvanized hexagonal wire mesh. 3" glass fiber insulation 0.90 pcf in joist space stapled to subfloor.

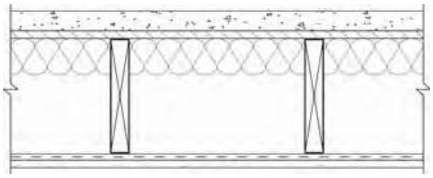

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® Type C
CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type C Gypsum Board
CertainTeed Gypsum Canada Inc.	-	5/8" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	5/8" Firecheck® Type C
National Gypsum Company	-	5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	5/8" FLAME CURB® Super 'C'™
Temple-Inland	-	5/8" TG-C

Approx. Ceiling Weight: 2 psf
Fire Test: UL R3453-7, 5-1-70; Based on UL R3660-7, -8, 11-12-87; R2717-61, 8-18-87; Based on UL R7094, 90NK10635, 10-24-90; Based on UL R8742, 88NK22591, 10-6-88; UL Design L516
Sound Test: KAL L 224-28-65, 3-30-65
IIC & Test: (74 C & P) KAL L 224-27-65, 3-30-65

Contact the manufacturer for more detailed information on proprietary products.

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5119

PROPRIETARY*

1 HOUR FIRE | **50 to 54 STC SOUND**

WOOD TRUSSES, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS OR MINERAL FIBER BATT OR LOOSE FILL INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 9 5/8" o.c. Gypsum board end joints located midway between continuous channels and attached with screws 9 5/8" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to 18" deep parallel chord wood trusses 24" o.c. with 1 1/4" Type S or W drywall screws. Glass or mineral fiber batt insulation stapled to subfloor or loose fill insulation applied directly over gypsum board. Wood trusses supporting 23/32" wood structural panel subfloor, long edges T&G, applied at right angles to trusses with 6d ring shank nails, or staples having equal or greater withdrawal and lateral resistance strength, 12" o.c. Either 3/4" gypsum floor topping or 15/32" wood structural panel underlayment applied over subfloor.

Optional ceiling damper (refer to manufacturer for information on the type of damper).

Sound tested with carpet and pad.

PROPRIETARY GYPSUM BOARD

PABCO Gypsum - 5/8" FLAME CURB® Type C

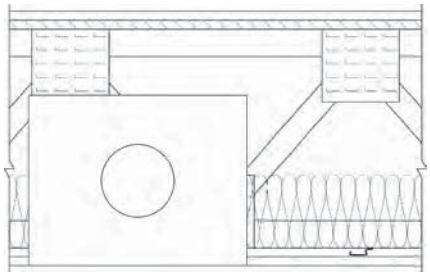

Approx. Ceiling Weight: 3 psf
Fire Test: UL R7094, 07NK11121, 11-27-07, UL Design L592; WFCi 07002C/07048, 8-3-07
Sound Test: RAL-TL08-311a, 10-31-08
IIC & Test (64 C & P) RAL-IN08-040a, 10-31-08

GA FILE NO. FC 5120

GENERIC

1 HOUR FIRE | **50 to 54 STC SOUND**

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS, GLASS FIBER INSULATION

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. with 1" Type S drywall screws 8" o.c. at ends and 12" o.c. at intermediate furring channels. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 64" long with screws 8" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with 6d coated nails, 1 7/8" long, 0.085" shank, 1/4" heads, two per joist. Wood joists supporting 5/8" interior plywood with exterior glue subfloor and 3/8" particle board, 1.5 psf. 3 1/2" glass fiber insulation batts, 0.7 pcf, friction fit in joist cavities supported alternately every 12" by wire rods and resilient furring channels.

Sound tested with carpet and pad and with insulation stapled to joists.

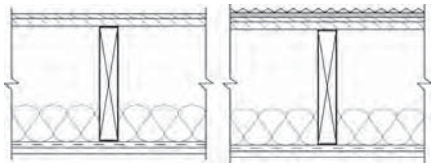

Approx. Ceiling Weight: 2 psf
Fire Test: FM FC-181, 8-31-72
Sound Test: G&H OC-3MT, 10-13-71
IIC & Test: (73 C & P) G&H OC-3MT, 10-13-71

GA FILE NO. FC 5240

GENERIC

1 HOUR FIRE | **45 to 49 STC SOUND**

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 54" long with screws 12" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with 1 1/4" Type W drywall screws. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor, or 19/32" plywood finished floor with long edges T & G and 15/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered.

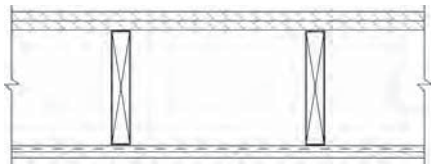

Approx. Ceiling Weight: 3 psf
Fire Test: UL R1319-65, 11-16-64, UL Design L514
Sound Test: CK 6512-6, 7, 4-15-65
IIC & Test: 39 (67 C & P) CK 6512-6, 4-15-65

Contact the manufacturer for more detailed information on proprietary products.

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5241

GENERIC

1 HOUR FIRE | **45 to 49 STC SOUND**

WOOD I-JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

Base layer 1/2" type X gypsum wallboard applied at right angles to resilient channels 16" o.c. with 1 1/4" Type S drywall screws 12" o.c. Resilient channels applied at right angles to minimum 9 1/2" deep wood I-joists, with minimum 1 1/4" deep x 1 1/2" wide flanges and minimum 3/8" webs, 24" o.c. with 1 1/4" Type W drywall screws. **Face** layer 1/2" type X gypsum wallboard applied at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. Face layer end joints located midway between channels and attached to base layer with 1 1/2" Type G screws 12" o.c. Edge joints offset 24" from base layer edge joints. Wood I-joists supporting 5/8" oriented strand board applied at right angles to I-joists with 8d common nails 12" o.c.

Approx. Ceiling Weight: 5 psf
Fire Test: NRCC A-4440.1 (Revised), 6-24-97
Sound Test: NRCC B-3150.1, 6-30-00
IIC & Test: 40 (68 C & P) NRCC B-3150.1, 6-30-00; NRCC B-3150.2, 6-30-00

GA FILE NO. FC 5242

GENERIC

1 HOUR FIRE | **45 to 49 STC SOUND**

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. with 1" Type S drywall screws 11" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 54" long with screws 12" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with 1 1/4" Type W drywall screws or 6d common nails. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor, or 5/8" plywood finished floor with long edges T & G and 1/2" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered.

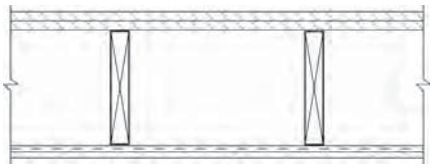

Approx. Ceiling Weight: 2 psf
Fire Test: UL R3543-8, 7-8-68, UL Design L517
Sound Test: See FC 5240 (CK 6512-6, -7, 4-15-65)

GA FILE NO. FC 5250

GENERIC

1 HOUR FIRE | **45 to 49 STC SOUND**

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 60" long with screws 12" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with 6d coated nails, 2" long, 0.113" shank, 17/64" heads. Wood joists supporting 1" nominal wood subfloor and 1" nominal wood finish floor, or 19/32" plywood finished floor with long edges T & G and 15/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered.

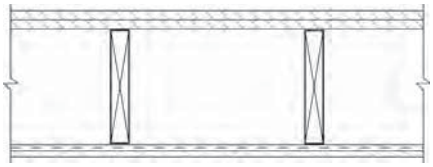

Approx. Ceiling Weight: 2 psf
Fire Test: UL R2717-29, 1-24-64, UL Design L502; ULC Design M501
Sound Test: RAL TL64-155, 2-7-64
IIC & Test: 39 (67 C & P) See FC 5240 (CK 6512-6, 4-15-65)

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5300 | GENERIC | 1 HOUR FIRE | 40 to 44 STC SOUND

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channels 53" long with screws 12" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with two 4d coated nails, 1 1/2" long, 0.080" shank, and 7/32" heads, per joist. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor, or 5/8" plywood finished floor with long edges T & G and 15/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered.

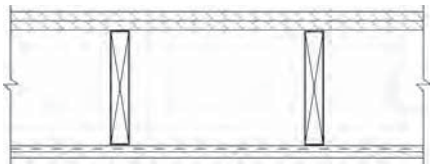

Approx. Ceiling Weight: 2 psf
Fire Test: UL R3501-29, 3-23-64, UL Design L515
Sound Test: NGC 4010, 3-21-66 (Rev. 12-23-70)
IIC & Test: 38 (63 C & P) NGC 5016, 3-17-66

GA FILE NO. FC 5310 | GENERIC | 1 HOUR FIRE | 40 to 44 STC SOUND

WOOD JOISTS, GYPSUM WALLBOARD

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 60" long with screws 12" o.c. Rigid furring channels applied at right angles to 4 x 10 or double 2 x 10 wood joists 48" o.c. with two 1 1/4" Type S drywall screws at each joist. Wood joists supporting 1 1/8 " T & G plywood floor.

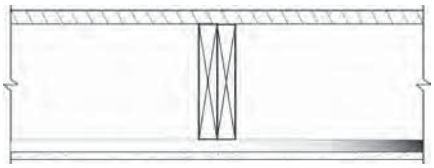

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R1319-47, 5-8-63, UL Design L508
Sound Test: Estimated

GA FILE NO. FC 5406 | GENERIC | 1 HOUR FIRE | 35 to 39 STC SOUND

WOOD JOISTS, GYPSUM WALLBOARD

Base layer 5/8" type X gypsum wallboard applied at right angles to 2 x 10 wood joists 24" o.c. with 1 1/4" Type W or S drywall screws 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to joists with 1 7/8" Type W or S drywall screws 12" o.c. at joints and intermediate joists and 1 1/2" Type G drywall screws 12" o.c. placed 2" back on either side of end joints. Joints offset 24" from base layer joints. Wood joists supporting 1/2" plywood with exterior glue applied at right angles to joists with 8d nails. **Ceiling provides one hour fire resistance protection for framing, including trusses.**

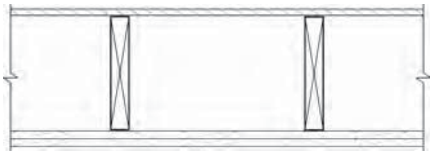

Approx. Ceiling Weight: 5 psf
Fire Test: FM FC 172, 2-25-72; ITS, 8-6-98
Sound Test: Estimated

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5407

GENERIC

1 HOUR FIRE | **35 to 39 STC SOUND**

WOOD I-JOISTS, GYPSUM WALLBOARD

Base layer 5/8" type X gypsum wallboard applied at right angles to wood I-joists 24" o.c. with 1 1/4" Type W or S drywall screws 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to I-joists with 1 7/8" Type W or S drywall screws 12" o.c. at joints and intermediate I-joists and 1 1/2" Type G drywall screws 12" o.c. placed 2" back on either side of end joints. Joints offset 24" from base layer joints. Wood I-joists supporting 1/2" wood structural panels applied at right angles to joists with 8d nails. **Ceiling provides one hour fire resistance protection for I-joists.**

Approx. Ceiling Weight: 5 psf
Fire Test: FM FC 172, 2-25-72; ITS, 8-6-98
Sound Test: Estimated

GA FILE NO. FC 5408

GENERIC

1 HOUR FIRE | **35 to 39 STC SOUND**

WOOD TRUSSES, GYPSUM WALLBOARD

Base layer 5/8" type X gypsum wallboard applied at right angles to parallel chord wood trusses 24" o.c. with 1 1/4" Type W or S drywall screws 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to trusses with 1 7/8" Type W or S drywall screws 12" o.c. at joints and intermediate trusses and 1 1/2" Type G drywall screws 12" o.c. placed 2" back on either side of end joints. Joints offset 24" from base layer joints. Trusses supporting 1/2" wood structural panels applied at right angles to trusses with 8d nails. **Ceiling provides one hour fire resistance protection for trusses.**

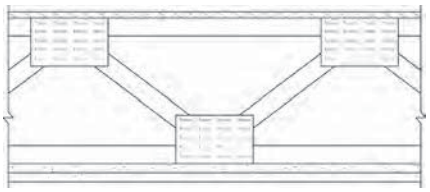

Approx. Ceiling Weight: 5 psf
Fire Test: FM FC 172, 2-25-72; ITS, 8-6-98
Sound Test: Estimated

GA FILE NO. FC 5410

GENERIC

1 HOUR FIRE | **35 to 39 STC SOUND**

WOOD JOISTS, GYPSUM WALLBOARD

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to 2 x 10 wood joists 16" o.c. with 5d nails, 1 5/8" long, 0.099" shank, 1/4" heads, 6" o.c. Nails placed 3/4" from board edge joints and 1/2" from board end joints. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor, or 19/32" plywood finished floor with long edges T & G and 15/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered.

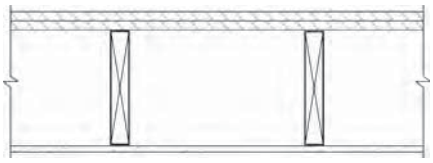

Approx. Ceiling Weight: 2 psf
Fire Test: UL R1319-66, 11-9-64, UL Design L512; UL R3501-45, 5-27-65, UL Design L522; UL R2717-38, 6-10-65, UL Design L503; UL R3543-6, 11-10-65, UL Design L519; ULC Design M502
Sound Test: NGC 4024, 7-13-66
IIC & Test: 32 (66 C & P) NGC 5032, 7-19-66

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5415 | PROPRIETARY* | 1 HOUR FIRE | 35 to 39 STC SOUND

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 16" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 72" long with screws 8" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 24" o.c. with 6d coated nails, 1 7/8" long, 0.092" shank, 1/4" heads. Wood joists supporting 3/4" nominal interior plywood with exterior glue T & G subfloor perpendicular to joists with joints staggered. Underside of T & G joints covered between joist spaces with 6" x 22 1/2" x 5/8" type X gypsum wallboard battens attached to flooring with 16 ga x 1 1/8" legs x 1/2" crown staples spaced 7" o.c. along each edge.

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	5/8" Firecheck® Type C
National Gypsum Company	-	5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	5/8" FLAME CURB® Super 'C'™
Temple-Inland	-	5/8" TG-C
United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

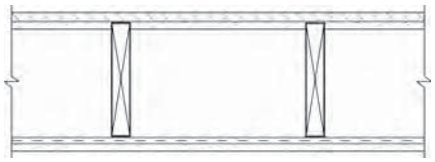

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R5229-2, 5-25-73, UL Design L513
Sound Test: Estimated

GA FILE NO. FC 5420 | GENERIC | 1 HOUR FIRE | 35 to 39 STC SOUND

WOOD JOISTS, GYPSUM WALLBOARD

One layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to 2 x 10 wood joists 16" o.c. with 6d coated nails, 1 7/8" long 0.0915" shank, 1/4" heads, 6" o.c. Wood joists supporting 1" nominal wood subfloor and 1" nominal wood finish floor, or 19/32" plywood finished floor with long edges T & G and 15/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered.

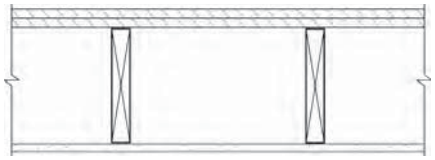

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R3501-5, 9, 7-15-52; UL R1319-2, 3, 6-5-52; UL Design L 501; ULC Design M500
Sound Test: See FC 5410 (NGC 4024, 7-13-66)
IIC & Test: 32 (66 C & P) NGC 5032, 7-19-66

GA FILE NO. FC 5470 | GENERIC | 1 HOUR FIRE | 35 to 39 STC SOUND

WOOD JOISTS, GYPSUM LATH, GYPSUM PLASTER

5/8" 1:2 gypsum-perlite plaster applied over 3/8" type X gypsum lath applied at right angles to 2 x 10 wood joists 16" o.c. with either blued lath nails, 1 1/4" long, 13 ga shank, 9/32" heads or 16 ga staples, 1 1/2" long, 7/16" crown, four fasteners per lath at each joist. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor.

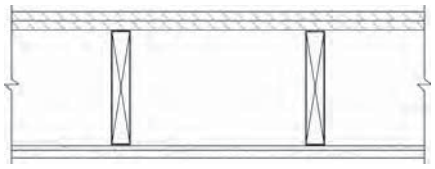

Approx. Ceiling Weight: 4 psf
Fire Test: OSU T-2134-1,4-23-63
Sound Test: Estimated

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5490

GENERIC

1 HOUR FIRE

35 to 39 STC SOUND

WOOD JOISTS, GYPSUM LATH, GYPSUM PLASTER

1/2" 1:2 gypsum-sand plaster applied over 3/8" type X gypsum lath applied at right angles to 2 x 10 wood joists 16" o.c. with blued lath nails, 1 1/8" long, 0.0915" shank, 19/64" heads, 4 nails per lath at each joist. Continuous stripping supporting gypsum lath under each joist with 2.5 lb. steel strip lath or equivalent wire lath nailed with 11 ga, 1 1/2" long, 7/16" heads roofing nails, 6" o.c. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor.

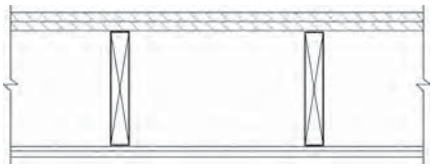

Approx. Ceiling Weight: 6 psf
Fire Test: SFT-6, 2-6-60; SFT-8, 4-9-60; SFT-11, 10-4-60; SFT-12, 10-22-60; SFT-13, 1-7-61
Sound Test: Estimated

GA FILE NO. FC 5504

PROPRIETARY*

1 HOUR FIRE

WOOD I-JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

Base layer 1/2" proprietary type X gypsum wallboard applied at right angles to resilient channels 12" o.c. with 1" Type S drywall screws 12" o.c. Base layer end joints located midway between channels and attached to additional pieces of channel 48" long with 1" Type S drywall screws 8" o.c. Resilient channels applied at right angles to minimum 9 1/2" deep wood proprietary I-joists 24" o.c. with 1 3/4" Type W drywall screws. **Face** layer 1/2" proprietary type X gypsum wallboard applied at right angles to channels with 1 5/8" Type S drywall screws 8" o.c. at end joints and 12" o.c. at intermediate channels. Edge joints offset 24" from base layer edge joints. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor, or 5/8" plywood finished floor with long edges T & G and 15/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered. Glass fiber insulation, 3 1/2" thick, draped over furring channels.

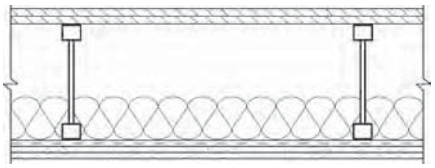

Approx. Ceiling Weight: 4 psf
Fire Test: UL R14196, 08CA66197, 4-24-08, UL Design M502

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 1/2" FireBloc® Type C

GA FILE NO. FC 5505

PROPRIETARY*

1 HOUR FIRE

WOOD I-JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

Base layer 5/8" proprietary type X gypsum wallboard applied at right angles to resilient channels 12" o.c. with 1" Type S drywall screws 12" o.c. Base layer end joints located midway between channels and attached to additional pieces of channel 48" long with 1" Type S drywall screws 8" o.c. Resilient channels applied at right angles to minimum 9 1/2" deep wood proprietary I-joists 24" o.c. with 1 3/4" Type W drywall screws. **Face** layer 5/8" proprietary type X gypsum wallboard applied at right angles to channels with 1 5/8" Type S drywall screws 8" o.c. at end joints and 12" o.c. at intermediate channels. Edge joints offset 24" from base layer edge joints. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor, or 5/8" plywood finished floor with long edges T & G and 15/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered. Glass fiber insulation, 3 1/2" thick, secured to underside of subfloor.

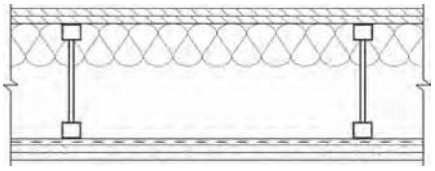

Approx. Ceiling Weight: 4 psf
Fire Test: UL R14196, 08CA66197, 4-24-08, UL Design M502

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type X

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5506

PROPRIETARY*

1 HOUR FIRE

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 53" long with screws 12" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with 1 1/4" Type S drywall screws. 3 1/2" glass or mineral fiber insulation loose-laid on resilient channels. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor, or 5/8" plywood finished floor with long edges T & G and 15/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered.

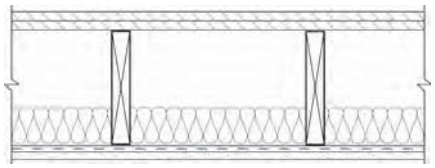

Approx. Ceiling Weight: 3 psf
Fire Test: UL R15187, 08NK13220, 7-30-08, UL Design L515

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type C Gypsum Board

GA FILE NO. FC 5507

PROPRIETARY*

1 HOUR FIRE

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 72" long with screws 8" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 24" o.c. with 1 1/4" Type S drywall screws. 3 1/2" glass or mineral fiber insulation loose-laid on resilient channels. Wood joists supporting 3/4" nominal interior plywood with exterior glue T & G subfloor applied at right angles to joists with joints staggered. Underside of T & G joints covered between joist spaces with 6" x 22 1/2" x 5/8" type X gypsum wallboard battens attached to flooring with 16 ga x 1 1/8" legs x 1/2" crown staples spaced 7" o.c. along each edge.

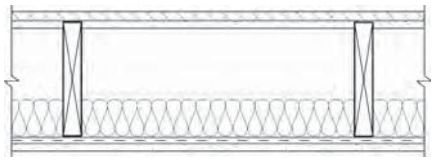

Approx. Ceiling Weight: 3 psf
Fire Test: UL R15187, 08NK13220, 7-30-08, UL Design L513

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC - 5/8" ToughRock® Fireguard C® Gypsum Board

GA FILE NO. FC 5508

PROPRIETARY*

1 HOUR FIRE

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 60" long with screws 8" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 24" o.c. with 6d common nails. 3 1/2" glass or mineral fiber insulation loose-laid on resilient channels. Wood joists supporting 19/32" plywood and 1" proprietary sanded gypsum underlayment.

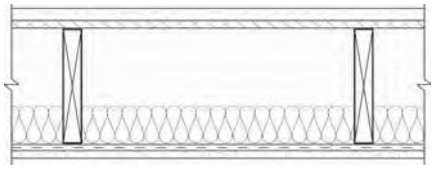

Approx. Ceiling Weight: 3 psf
Fire Test: UL R15187, 08NK13220, 7-30-08, UL Design L502

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC - 5/8" ToughRock® Fireguard C® Gypsum Board

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5509 — PROPRIETARY* — 1 HOUR FIRE

WOOD JOISTS, GLASS MAT GYPSUM SUBSTRATE

One layer 5/8" proprietary type X glass mat gypsum substrate applied at right angles to 2 x 10 wood joists 16" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 6" o.c. Wood joists supporting 1" nominal wood subfloor and 1" nominal wood finish floor, or 19/32" plywood finished floor with long edges T&G and 15/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered.

PROPRIETARY GYPSUM PANEL PRODUCTS

CertainTeed Gypsum Inc.	-	5/8" GlasRoc® Sheathing Type X Gypsum Panels
Georgia Pacific Gypsum LLC	-	5/8" DensGlass® Fireguard® Sheathing
Temple-Inland	-	5/8" GreenGlass Type X

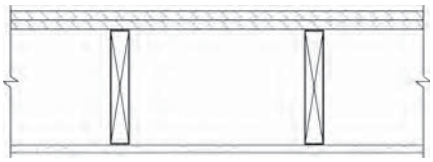

Approx. Ceiling Weight: 2.5 psf
Fire Test: UL R3660/R15187, 01NK21103, 2-4-02; UL R6937, 07NK07391, 9-19-08; UL Design L501

GA FILE NO. FC 5510 — GENERIC — 1 HOUR FIRE

WOOD JOISTS, METAL LATH, GYPSUM PLASTER

5/8" 1:2-1:3 gypsum-sand plaster applied over 3.4 lb. metal lath applied to 2 x 10 wood joists 16" o.c. with barbed roofing nails, 1 1/2" long, 0.120" shank, 7/16" heads, 6" o.c. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor.

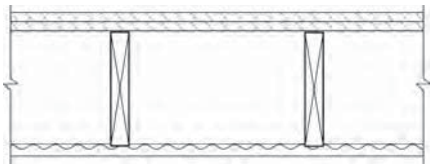

Approx. Ceiling Weight: 9 psf
Fire Test: BMS 92/42, 10-7-42

GA FILE NO. FC 5511 — GENERIC — 1 HOUR FIRE

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 64" long with screws 12" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with two 5d coated nails, 1 5/8" long, 0.086" shank, 15/64" heads, per joist. Wood joists supporting 1 11/32" fiber decking 2'0" x 8'0", T & G four sides, 3 psf.

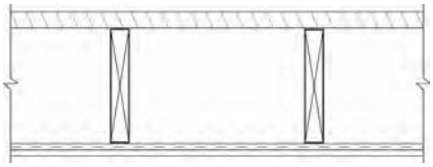

Approx. Ceiling Weight: 3 psf
Fire Test: FM FC-77, 11-3-67

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5512 | GENERIC | 1 HOUR FIRE

GYPSUM BOARD, PARALLEL CHORD WOOD TRUSSES

CEILING: **Base** layer 1/2" type X gypsum wallboard or gypsum veneer base applied perpendicular to wood trusses 24" o.c. with 1 1/4" Type S drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied perpendicular to trusses with 1 7/8" Type S drywall screws 12" o.c. and 1 1/2" Type G drywall screws 12" o.c. placed 3" back from either side of end joints. Joints offset 24" from base layer joints.

TRUSSES: Chord and web members fabricated from 2 x 4 lumber with 20 ga steel connector plates having a minimum tooth length of 5/16". Plate design values based upon a safety factor of 4. Trusses have a minimum depth of 12".

FLOORING: 19/32" T & G plywood with exterior glue applied at right angles to top of trusses with 6d common nails 6" o.c. Plywood end joints staggered 48".

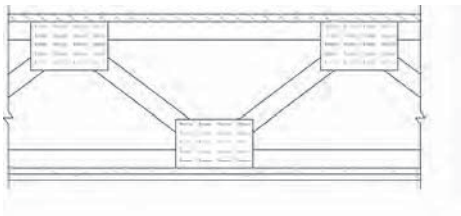

Approx. Ceiling Weight: 4 psf
Fire Test: FM FC214 - 1 hour, 7-6-78

GA FILE NO. FC 5513 | GENERIC | 1 HOUR FIRE

LIGHTWEIGHT CONCRETE, PLYWOOD, WOOD I-JOISTS, GYPSUM WALLBOARD

Base layer 1/2" type X gypsum wallboard applied at right angles to minimum 9 1/2" deep wood I-joists, with minimum 1 1/4" deep x 1 1/2" wide flanges and minimum 3/8" webs, 24" o.c. with 1 5/8" Type W or S drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied at right angles to I-joists with 2" Type W or S drywall screws 12" o.c. at intermediate I-joists, 8" o.c. at end joints, and 1 1/2" Type G drywall screws 8" o.c. placed 6" back on either side of end joints. Joints offset 24" from base layer joints. Wood I-joists supporting 5/8" plywood with long edges T & G applied at right angles to I-joists with 8d common nails. 1 1/2" lightweight concrete poured over plywood.

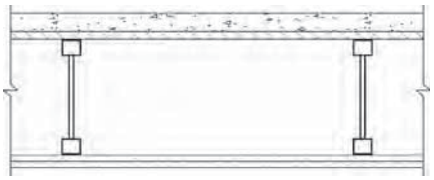

Approx. Ceiling Weight: 5 psf
Fire Test: FM J.I. 2C9Q7.AC, 9-29-78, FM Design FC-268

GA FILE NO. FC 5514 | PROPRIETARY* | 1 HOUR FIRE

WOOD TRUSSES, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS FIBER INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum board or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. Gypsum board end joints attached with screws 8" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to 18" deep parallel chord wood trusses 24" o.c. with 1 1/4" Type S or W screws. Glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting 23/32" wood structural panel subfloor, long edges T & G, applied at right angles to trusses with construction adhesive and 6d ring shank nails 12" o.c. Either 3/4" gypsum floor topping or 15/32" wood structural panel underlayment applied over subfloor.

Optional ceiling damper (refer to manufacturer for information on the type of damper).

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

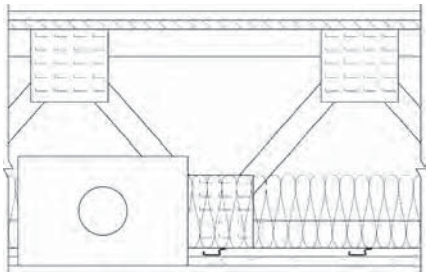

Approx. Ceiling Weight: 3 psf
Fire Test: UL R3501, 00NK42686, 8-16-01, UL Design L558; UL R5698, 4-11-01

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5514.4

PROPRIETARY*

1 HOUR FIRE

WOOD TRUSSES, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS FIBER INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. Gypsum board end joints attached with screws 8" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to 18" deep parallel chord wood trusses 24" o.c. with 1 1/4" Type S screws. Glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting 23/32" wood structural panel subfloor, long edges T & G, applied at right angles to trusses with construction adhesive and 6d ring shank nails 12" o.c. Either 3/4" gypsum floor topping or 15/32" wood structural panel underlayment applied over subfloor.

Optional ceiling damper (refer to manufacturer for information on the type of damper).

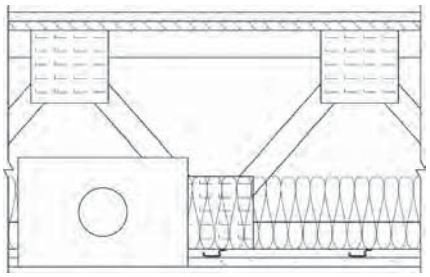

Approx. Ceiling Weight: 3 psf

Fire Test: UL R18482, 06NK24477, 1-30-07; 09NK05485, 5-14-09; UL Design L585

PROPRIETARY GYPSUM BOARD

Lafarge North America Inc.	-	5/8" Firecheck® Type C

GA FILE NO. FC 5515

PROPRIETARY*

1 HOUR FIRE

WOOD TRUSSES, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. and located a minimum of 1 1/2" from joints. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 60" long with screws 12" o.c. Rigid furring channels applied at right angles to 12" deep parallel chord wood trusses 24" o.c. with double strand, 18 ga galvanized steel wire ties 48" o.c. Wood trusses supporting 3/4" nominal interior plywood with exterior glue, T & G edges, applied at right angles to trusses with construction adhesive and 6d ring shank nails 12" o.c. Adhesive applied to each top chord and grooved edges of plywood. End joints staggered 48".

Consult gypsum board manufacturer for truss details.

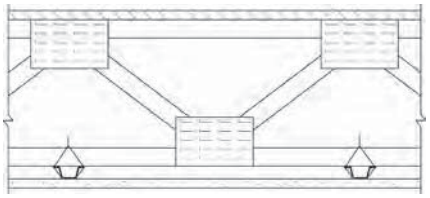

Approx. Ceiling Weight: 3 psf

Fire Test: UL R9500-1, 80NK15492, 2-2-81; UL R2717-61, 8-18-87; UL Design L528

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	5/8" Firecheck® Type C
PABCO Gypsum	-	5/8" FLAME CURB® Super 'C'™ Type C
Temple-Inland	-	5/8" TG-C
United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

Contact the manufacturer for more detailed information on proprietary products.

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5515.3

PROPRIETARY*

1 HOUR FIRE

WOOD TRUSSES, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS OR MINERAL FIBER BATT INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum board applied at right angles to resilient furring channels 16" o.c. (12" o.c. when insulation is draped over channels) with 1" Type S drywall screws 8" o.c. Gypsum board end joints located midway between continuous channels and attached with screws 8" o.c. to additional pieces of channel extending 6" beyond edge of board and located 3" back on either side of end joint. Resilient channels applied at right angles to 18" deep parallel chord wood trusses 24" o.c. with 1 1/4" Type S bugle head drywall screws. Glass or mineral fiber batt insulation stapled to subfloor or draped over resilient channels and gypsum board ceiling membrane. Wood trusses supporting 23/32" wood structural panel subfloor, long edges T&G, applied at right angles to trusses with 6d ring shank nails, or staples having equal or greater withdrawal and lateral resistance strength, 12" o.c. Either 3/4" gypsum floor topping or 15/32" wood structural panel underlayment applied over subfloor.

Optional ceiling damper (refer to manufacturer for information on the type of damper).

PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC - 5/8" ToughRock® Fireguard C® Gypsum Board

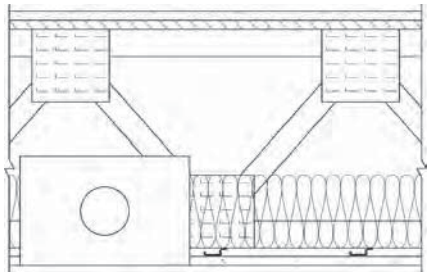

Approx. Ceiling Weight: 3 psf
Fire Test: UL R2717, 08CA46422, 5-13-09, UL Design M503

GA FILE NO. FC 5516

PROPRIETARY*

1 HOUR FIRE

WOOD TRUSSES, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. and 1 1/2" from edges. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 60" long with screws 12" o.c. Rigid furring channels applied at right angles to 12" deep parallel chord wood trusses 24" o.c. with double strand, 18 ga galvanized steel wire ties 48" o.c. Wood trusses supporting 3/4" nominal interior plywood with exterior glue, T&G edges, applied at right angles to trusses with construction adhesive and either 6d smooth shank nails 6" o.c. at end joints and 12" o.c. at intermediate trusses or 6d ring shank nails 12" o.c. Adhesive applied to each top chord and grooved edges of plywood. End joints staggered 48".

Consult gypsum board manufacturer for truss details.

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

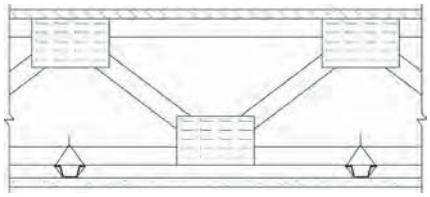

Approx. Ceiling Weight: 3 psf
Fire Test: FM FC-448 (Method B), 2-24-88; Based on UL R3501, 11-27-89, UL Design L528

GA FILE NO. FC 5517

PROPRIETARY*

1 HOUR FIRE

WOOD TRUSSES, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to 12" deep parallel chord wood trusses 24" o.c. with 1 7/8" Type S drywall screws 8" o.c. to trusses and to 2 x 4 wood blocking installed between trusses, centered behind gypsum board edges and secured at each end to the trusses by nail attached 18 ga Z-shaped steel clips. Wood trusses supporting 5/8" nominal interior plywood with exterior glue, T & G edges, applied at right angles to trusses with construction adhesive and 6d smooth shank nails 12" o.c. in field and 6" o.c. along ends. Adhesive applied to each top chord and grooved edges of plywood. End joints staggered 48".

Consult gypsum board manufacturer for truss details.

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

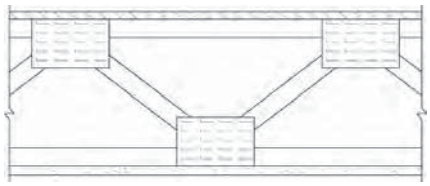

Approx. Ceiling Weight: 2.5 psf
Fire Test: FM FC-442 (Method A), 2-17-88

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5519

PROPRIETARY*

1 HOUR FIRE

WOOD TRUSSES, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS OR MINERAL FIBER BATT OR LOOSE FILL INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. Gypsum board end joints located midway between continuous channels and attached with screws 8" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to 18" deep parallel chord wood trusses 24" o.c. with 1 1/4" Type S or W drywall screws. Glass or mineral fiber batt insulation stapled to subfloor or loose fill insulation applied directly over gypsum board. Wood trusses supporting 23/32" wood structural panel subfloor, long edges T&G, applied at right angles to trusses with 6d ring shank nails, or staples having equal or greater withdrawal and lateral resistance strength, 12" o.c. Either 3/4" gypsum floor topping or 15/32" wood structural panel underlayment applied over subfloor.

Optional ceiling damper (refer to manufacturer for information on the type of damper).

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® Type C
Temple-Inland	-	5/8" TG-C

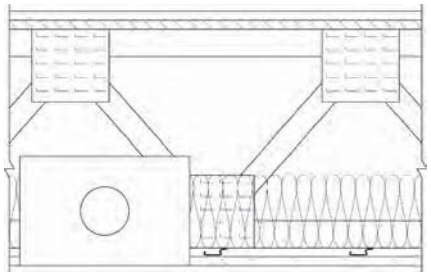

Approx. Ceiling Weight: 3 psf
Fire Test: UL R14196 (R6937), 04NK25585, 1-15-05, UL Design L574

GA FILE NO. FC 5521

PROPRIETARY*

1 HOUR FIRE

WOOD TRUSSES, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS OR MINERAL FIBER BATT OR LOOSE FILL INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 9 5/8" o.c. Gypsum board end joints located midway between continuous channels and attached with screws 9 5/8" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to 18" deep parallel chord wood trusses 24" o.c. with 1 1/4" Type S or W drywall screws. Glass or mineral fiber batt insulation stapled to subfloor or loose fill insulation applied directly over gypsum board. Wood trusses supporting 23/32" wood structural panel subfloor, long edges T&G, applied at right angles to trusses with 6d ring shank nails, or staples having equal or greater withdrawal and lateral resistance strength, 12" o.c. Either 3/4" gypsum floor topping or 15/32" wood structural panel underlayment applied over subfloor.

Optional ceiling damper (refer to manufacturer for information on the type of damper).

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type C Gypsum Board

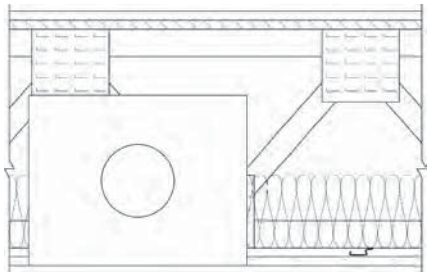

Approx. Ceiling Weight: 3 psf
Fire Test: UL R3660, 07NK25175, 6-24-08, UL Design L562

GA FILE NO. FC 5522

GENERIC

1 HOUR FIRE

WOOD I-JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

Base layer 1/2" type X gypsum wallboard applied at right angles to resilient channels 16" o.c. with 1 1/4" Type S drywall screws 12" o.c. Resilient channels applied at right angles to minimum 9 1/2" deep wood I-joists, with minimum 1 1/4" deep x 1 1/2" wide flanges and minimum 3/8" webs, 24" o.c. with 1 1/4" Type W drywall screws. **Face** layer 1/2" type X gypsum wallboard applied at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. Face layer end joints located midway between channels and attached to base layer with 1 1/2" Type G screws 12" o.c. Edge joints offset 24" from base layer edge joints. Wood I-joists supporting 5/8" oriented strand board applied at right angles to I-joists with 8d common nails 12" o.c.

Approx. Ceiling Weight: 5 psf
Fire Test: NRCC A-4440.1 (Revised), 6-24-97

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5523 — GENERIC — 1 HOUR FIRE

WOOD JOISTS, GYPSUM LATH, GYPSUM PLASTER, RESILIENT CHANNELS

1/2" 1:2-1:3 gypsum-sand plaster applied over 3/8" type X gypsum lath applied at right angles to resilient furring channels 16" o.c with three 3/4" Type S drywall screws at each furring channel 3" wide woven wire strips applied over gypsum lath and parallel to and directly over resilient channels with 7/8" Type S drywall screws with diamond washers 16" o.c. Resilient channels applied at right angles to 2 x 10 wood joists 16" o.c. with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads. Wood joists supporting 1" nominal wood subfloor and 1" nominal wood finish floor.

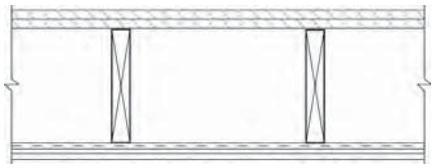

Approx. Ceiling Weight: 6.25 psf
Fire Test: SFT-42, 5-7-66

GA FILE NO. FC 5524 — PROPRIETARY* — 1 HOUR FIRE

WOOD I-JOISTS, WOOD STRUCTURAL PANELS, GYPSUM WALLBOARD, RESILIENT CHANNELS

Base layer 1/2" proprietary type X gypsum wallboard applied at right angles to resilient furring channels 16" o.c. with 1" Type S drywall screws 12" o.c. Resilient channels applied at right angles to minimum 9 1/2" deep proprietary wood I-joists (1 1/8" x 1 3/4" flange dimension) 24" o.c. with 1 1/4" Type W drywall screws. Resilient channel splices overlapped 4" and fastened together with two 1/2" panhead screws. Additional resilient channels installed 3" on either side of the centerline of each continuous butt joint. **Face** layer 1/2" proprietary type X gypsum wallboard applied at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. and staggered 6" from base layer fasteners. Joints in face layer offset 24" from base layer joints, with the continuoud butt joint of the face layer oppostie that of the base layer. Proprietary wood I-joists supporting 23/32" wood structural panel subfloor applied at right angles to joists with construction adhesive and 8d nails space 6" o.c. at the edges and 12" o.c. in the field.

PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC - 1/2" ToughRock® Fireguard C® Gypsum Board

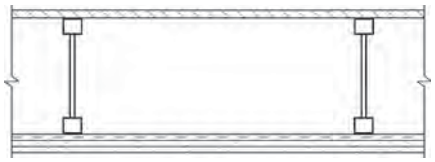

Approx. Ceiling Weight: 3.6 psf
Fire Test: WFCi 10112, 10-11-10

GA FILE NO. FC 5525 — PROPRIETARY* — 1 HOUR FIRE

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS, GLASS OR MINERAL FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 53" long with screws 8" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 24" o.c. with 6d common nails. 3 1/2" glass or mineral fiber insulation draped over resilient channels. Wood joists supporting 1" nominal T & G wood subfloor and 19/32" interior plywood with various floor finishes.

Optional ceiling damper (refer to manufacturer for information on the type of damper).

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type C

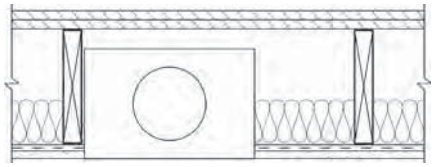

Approx. Ceiling Weight: 3 psf
Fire Test: UL R14196, 09NK08803, 2-15-08, UL Design L502

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5526

PROPRIETARY*

1 HOUR FIRE

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS, GLASS OR MINERAL FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 72" long with screws 8" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 24" o.c. with 1 1/4" Type S drywall screws. 3 1/2" glass or mineral fiber insulation loose-laid on resilient channels. Wood joists supporting 3/4" nominal interior plywood with exterior glue T & G subfloor applied at right angles to joists with joints staggered. Underside of T & G joints covered between joist spaces with 6" x 22 1/2" x 5/8" type X gypsum wallboard battens attached to flooring with 16 ga x 1 1/8" legs x 1/2" crown staples spaced 7" o.c. along each edge.

Optional ceiling damper (refer to manufacturer for information on the type of damper).

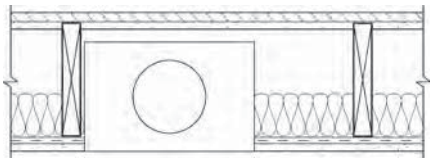

Approx. Ceiling Weight: 3 psf
Fire Test: UL R14196, 09NK08803, 2-15-08, UL Design L513

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type C

GA FILE NO. FC 5527

PROPRIETARY*

1 HOUR FIRE

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS, GLASS OR MINERAL FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 53" long with screws 12" o.c. Resilient furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with 1 1/4" Type S drywall screws. 3 1/2" glass or mineral fiber insulation loose-laid on resilient channels. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor, or 5/8" plywood finished floor with long edges T & G and 15/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered.

Optional ceiling damper (refer to manufacturer for information on the type of damper).

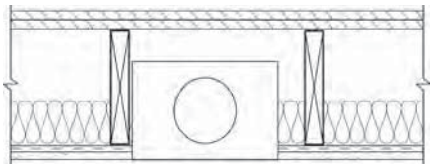

Approx. Ceiling Weight: 3 psf
Fire Test: UL R15187, 08NK13220, 7-30-08, UL Design L515

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type C

GA FILE NO. FC 5528

PROPRIETARY*

1 HOUR FIRE

WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS, GLASS OR MINERAL FIBER INSULATION

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. and located a minimum of 1 1/2" from joints. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 60" long with screws 12" o.c. Resilient furring channels applied at right angles to 12" deep parallel chord wood trusses 24" o.c. with 1 1/4" Type S drywall screws. 3 1/2" glass or mineral fiber insulation loose-laid on resilient channels. Wood trusses supporting 3/4" nominal interior plywood with exterior glue, T & G edges, applied at right angles to trusses with construction adhesive and 6d ring shank nails 12" o.c. Adhesive applied to each top chord and grooved edges of plywood. End joints staggered 48".

Consult gypsum board manufacturer for truss details.

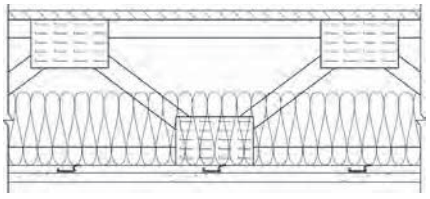

Approx. Ceiling Weight: 3 psf
Fire Test: UL R14196, 09NK08803, 2-15-08, UL Design L528

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type C

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5600 — GENERIC — 1 1/2 HOUR FIRE

WOOD JOISTS, GYPSUM WALLBOARD, GLASS FIBER INSULATION

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to rigid furring channels 16" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 60" long with 1" Type S drywall screws 8" o.c. Rigid furring channels applied at right angles to 2 x 10 wood joists 16" o.c. with 6d cooler or box nails, 1 7/8" long, 0.092" diameter shank, 1/4" heads, or 1 7/8" Type S drywall screws, two per joist. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to furring channels with 1 7/8" Type S drywall screws 8" o.c. at end joints and 12" o.c. at intermediate channels. Edge joints staggered 18" minimum from base layer edge joints; end joints staggered 8" min. from base layer end joints. Wood joists supporting 5/8" interior plywood with exterior glue subfloor and 1 1/2" lightweight concrete reinforced with galvanized hexagonal wire mesh over film or felt or 1" sanded gypsum floor underlayment. 3 1/2" R-11 unfaced glass fiber insulation, 0.6 pcf, supported against subfloor by wire rods 12" o.c. Alternately, insulation may be 3 1/2" faced glass fiber insulation stapled in place against subfloor.

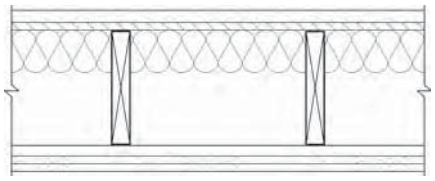

Approx. Ceiling Weight: 5 psf
Fire Test: UL R4024-15, 8-31-84, UL Design L532

GA FILE NO. FC 5610 — GENERIC — 1 3/4 HOUR FIRE

WOOD JOISTS, METAL LATH, GYPSUM PLASTER

5/8" 1:2-1:3 gypsum-vermiculite plaster applied over 3.4 lb. metal lath applied to 2 x 10 wood joists 16" o.c. with barbed roofing nails, 1 1/2 long, 0.120" shank, 7/16" heads 5" o.c. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor.

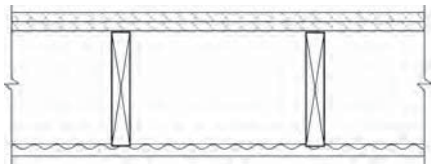

Approx. Ceiling Weight: 4 psf
Fire Test: NBS 272, 12-15-50

GA FILE NO. FC 5710 — PROPRIETARY* — 2 HOUR FIRE

WOOD FLOOR, WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

Base layer 5/8" proprietary type X gypsum wallboard applied at right angles to 2 x 10 wood joists 16" o.c. with 8d cement coated nails, 2 1/2" long, 0.113 shank, 19/64" heads, 7" o.c. Resilient channel 24" o.c. applied at right angles to wood framing through base layer with 1 7/8" long screws. Double channel installed at face layer end joints. **Face** layer 5/8" proprietary type X gypsum wallboard applied at right angles to resilient furring channels with 1" Type S screws 12" o.c. Wood joists supporting 15/32" plywood subfloor and 19/32" plywood finish floor applied at right angles to joists with joints staggered. Consult gypsum board manufacturer for other flooring options.

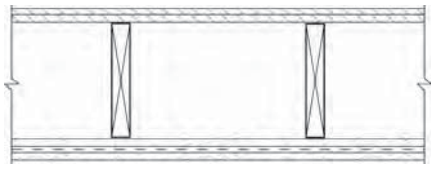

Approx. Ceiling Weight: 6 psf
Fire Test: UL R1319-114, 7-21-67, UL Design L511

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® Type C
CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	5/8" Firecheck® Type C
National Gypsum Company	-	5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	5/8" FLAME CURB® Super 'C'™
Temple-Inland	-	5/8" TG-C
United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5724

PROPRIETARY*

2 HOUR FIRE

WOOD FLOOR, WOOD JOISTS, GYPSUM WALLBOARD, RESILIENT CHANNELS

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to 2 x 10 wood joists 16" o.c. with 8d nails, 2 1/2" long, 0.113" shank, 19/64" heads, 7" o.c. Resilient furring channels 24" o.c. applied at right angles to joists through base layer with one 8d nail, 2 1/2" long, 0.113" shank, 19/64" head, at each joist. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels with 1" Type S drywall screws 12" o.c. Double channel installed at face layer end joints. Wood joists supporting 1" nominal T & G wood subfloor and 1" nominal wood finish floor or 19/32" plywood finished floor with long edges T & G and 15/32" interior plywood with exterior glue subfloor perpendicular to joists with joints staggered.

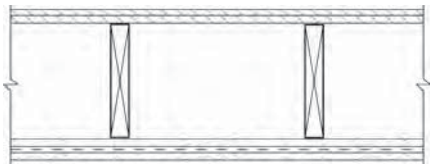

Approx. Ceiling Weight: 6 psf
Fire Test: UL R2717-35, 10-21-64, UL Design L505; ULC Design M503

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® Type C
CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	5/8" Firecheck® Type C
National Gypsum Company	-	5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	5/8" FLAME CURB® Super 'C'™
Temple-Inland	-	5/8" TG-C

GA FILE NO. FC 5725

GENERIC

2 HOUR FIRE

WOOD FLOOR, WOOD JOISTS, GYPSUM WALLBOARD, RIGID FURRING CHANNELS

Base layer 5/8" type X gypsum wallboard applied at right angles to 2 x 8 wood joists 24" o.c. with 1 1/4" Type W drywall screws 12" o.c. **Second** layer 5/8" type X gypsum wallboard applied at right angles to joists with 2" Type W drywall screws 12" o.c. Second layer joints offset 24" from base layer joints. **Third** layer 5/8" type X gypsum wallboard applied at right angles to joists with 2 1/2" Type W drywall screws 12" o.c. Third layer joints offset 12" from second layer joints. Hat-shaped 7/8" rigid furring channels 24" o.c. applied at right angles to joists over third layer with two 2 1/2" long Type W drywall screws at each joist. **Face** layer 5/8" type X gypsum wallboard applied at right angles to furring channels with 1 1/8" Type S drywall screws 12" o.c. Wood joists supporting 3/4" T & G edge plywood floor applied at right angles to joists with 8d nails 6" o.c. at joints and 12" at intermediate joists. **Ceiling provides two-hour fire-resistance protection for wood framing.**

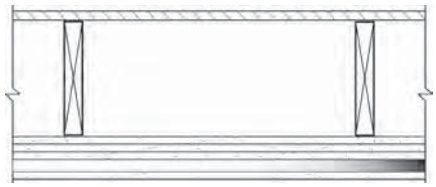

Approx. Ceiling Weight: 12 psf
Fire Test: UL R4024, 00NK26545, 4-27-01; UL R4024, 03NK11206, 3-19-03; UL Design L556; ULC Design M514

GA FILE NO. FC 5750

GENERIC

2 HOUR FIRE

WOOD FLOOR, WOOD I-JOISTS, GYPSUM WALLBOARD, RIGID FURRING CHANNELS

Base layer 5/8" type X gypsum wallboard applied at right angles to 9 1/2" deep wood I-joists 24" o.c. with 1 1/4" Type W drywall screws 12" o.c. **Second** layer 5/8" type X gypsum wallboard applied at right angles to I-joists with 2" Type W drywall screws 12" o.c. Second layer joints offset 24" from base layer joints. **Third** layer 5/8" type X gypsum wallboard applied at right angles to I-joists with 2 1/2" Type W drywall screws 12" o.c. Third layer joints offset 12" from second layer joints. Hat-shaped 7/8" rigid furring channels 24" o.c. applied at right angles to I-joists over third layer with two 2 1/2" long Type W drywall screws at each I-joist. **Face** layer 5/8" type X gypsum wallboard applied at right angles to furring channels with 1 1/8" Type S drywall screws 12" o.c. Wood I-joists supporting 3/4" T & G edge plywood floor applied at right angles to I-joists with 8d nails 6" o.c. at joints and 12" at intermediate I-joists. **Ceiling provides two-hour fire-resistance protection for wood framing.**

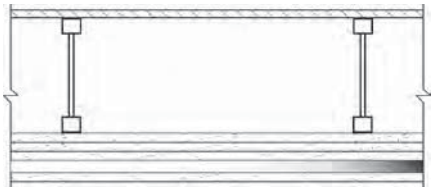

Approx. Ceiling Weight: 12 psf
Fire Test: UL R4024, 00NK26545, 4-27-01, UL Design L556; ULC Design M514

**Contact the manufacturer for more detailed information on proprietary products.*

FLOOR-CEILING SYSTEMS, WOOD FRAMED

GA FILE NO. FC 5751 | GENERIC | 2 HOUR FIRE

WOOD FLOOR, WOOD TRUSSES, GYPSUM WALLBOARD, RIGID FURRING CHANNELS

Base layer 5/8" type X gypsum wallboard applied at right angles to 18" deep parallel chord wood trusses 24" o.c. with 1 1/4" Type W drywall screws 12" o.c. **Second** layer 5/8" type X gypsum wallboard applied at right angles to trusses with 2" Type W drywall screws 12" o.c. Second layer joints offset 24" from base layer joints. **Third** layer 5/8" type X gypsum wallboard applied at right angles to trusses with 2 1/2" Type W drywall screws 12" o.c. Third layer joints offset 12" from second layer joints. Hat-shaped 7/8" rigid furring channels 24" o.c. applied at right angles to trusses over third layer with two 2 1/2" long Type W drywall screws at each truss. **Face** layer 5/8" type X gypsum wallboard applied at right angles to furring channels with 1 1/8" Type S drywall screws 12" o.c. Wood trusses supporting 3/4" T & G edge plywood floor applied at right angles to trusses with 8d nails 6" o.c. at joints and 12" at intermediate trusses. **Ceiling provides two-hour fire-resistance protection for wood framing.**

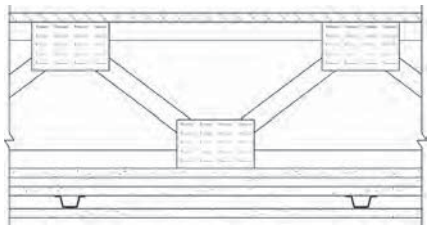

Approx. Ceiling Weight: 12 psf
Fire Test: UL R4024, 00NK26545, 4-27-01, UL Design L556; ULC Design M514

GA FILE NO. FC 5752 | PROPRIETARY* | 2 HOUR FIRE

WOOD TRUSSES, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS OR MINERAL FIBER BATT OR LOOSE FILL INSULATION, GYPSUM WALLBOARD

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to minimum 12" deep parallel chord wood trusses 24" o.c. with 1 5/8" Type S drywall screws 8" o.c. Resilient channels 16" o.c. applied at right angles to trusses with 1 7/8" Type S drywall screws to each truss. **Second** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient channels with end joints centered on channels with 1" Type S-12 drywall screws 8" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1 5/8" Type S-12 drywall screws 8" o.c. Face layer joints offset 16" from second layer joints. Glass or mineral fiber batt, blanket, or loose-fill insulation applied directly over gypsum board. Wood trusses supporting 23/32" nominal wood structural panel subfloor applied at right angles to trusses with construction adhesive and 6d ring shank nails 12" o.c. Minimum 1/2" proprietary gypsum floor topping applied over subfloor.

PROPRIETARY GYPSUM COMPONENTS

United States Gypsum Company
- 5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels
- LEVELROCK® Brand Floor Underlayment

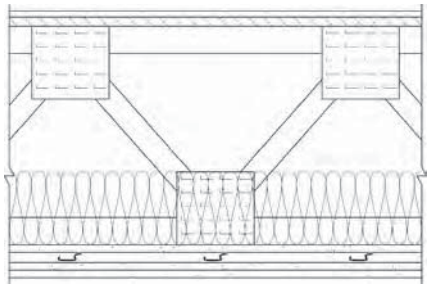

Approx. Ceiling Weight: 3 psf
Fire Test: UL R5698, 05NK20716, 8-10-05, UL Design L577

GA FILE NO. FC 5753 | PROPRIETARY* | 2 HOUR FIRE

WOOD TRUSSES, WOOD STRUCTURAL PANELS, GYPSUM FLOOR TOPPING, RESILIENT CHANNELS, GLASS OR MINERAL FIBER BATT OR LOOSE FILL INSULATION, GYPSUM WALLBOARD

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to minimum 12" deep parallel chord wood trusses 24" o.c. with 1 5/8" Type S drywall screws 8" o.c. Resilient channels 16" o.c. applied at right angles to trusses with 1 7/8" Type S drywall screws to each truss. **Second** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient channels with end joints centered on channels with 1" Type S-12 drywall screws 8" o.c. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1 5/8" Type S-12 drywall screws 8" o.c. Face layer joints offset 16" from second layer joints. 3 1/2" glass or mineral fiber batt, blanket, or loose-fill insulation applied directly over gypsum board. Wood trusses supporting 23/32" nominal wood structural panel subfloor applied at right angles to trusses with construction adhesive and 6d ring shank nails 12" o.c. Minimum 1/2" gypsum floor topping applied over subfloor.

PROPRIETARY GYPSUM COMPONENTS

American Gypsum Company LLC - 5/8" FireBloc® Type C

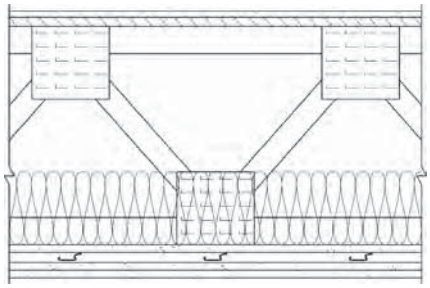

Approx. Ceiling Weight: 3 psf
Fire Test: UL R14196, 11NK04431, 3-12-11, UL Design M510

**Contact the manufacturer for more detailed information on proprietary products.*

ROOF-CEILING SYSTEMS

GA FILE NO. RC 2501

PROPRIETARY*

1 HOUR FIRE

STEEL ROOF TRUSSES, RESILIENT OR RIGID CHANNELS, THERMAL INSULATION, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient or rigid furring channels with 1 1/8" Type S drywall screws 12" o.c. Channels spaced 12" o.c. when insulation is used or 16" o.c. when no insulation is used. Gypsum board end joints attached with screws 12" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of pitched or parallel chord steel trusses 48" o.c. with 1/2" Type S-12 screws or rigid furring channels secured to the bottom chord of each truss with double-strand wire saddle ties **(refer to furring channel manufacturer for maximum spans)**. Optional glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting metal roof deck panels covered by 1/2" regular gypsum sheathing either loose laid, or adhesively or mechanically attached to roof deck. Any thickness polyisocyanurate foamed plastic; polystyrene foamed plastic; or mineral fiber or glass fiber insulation boards laid over gypsum sheathing and covered by a Class A, B, or C roof covering.

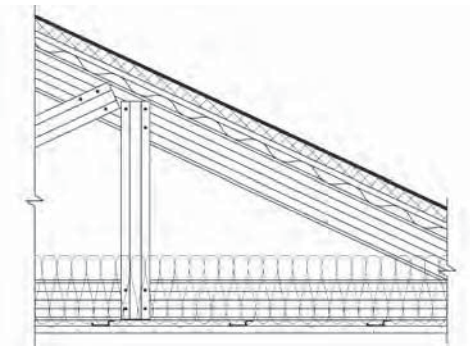

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

Approx. Ceiling Weight: 3 psf
Fire Test: UL R3501, 01NK49664, 9-5-02, UL Design P540

GA FILE NO. RC 2502

PROPRIETARY*

1 HOUR FIRE

STEEL ROOF TRUSSES, RESILIENT OR RIGID CHANNELS, THERMAL INSULATION, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard applied at right angles to resilient or rigid furring channels with 1" Type S drywall screws 12" o.c. Channels spaced 12" o.c. when insulation is used or 16" o.c. when no insulation is used. Gypsum board end joints attached with screws 12" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of pitched or parallel chord steel trusses 48" o.c. with 1/2" Type S-12 screws or rigid furring channels secured to the bottom chord of each truss with double-strand wire saddle ties **(refer to furring channel manufacturer for maximum spans)**. Optional glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting metal roof deck panels covered by 1/2" or 5/8" cement backer board or 1/2" regular gypsum sheathing either loose laid, or adhesively or mechanically attached to roof deck. Any thickness polyisocyanurate foamed plastic; polystyrene foamed plastic; or mineral fiber or glass fiber insulation boards laid over gypsum sheathing and covered by a Class A, B, or C roof covering.

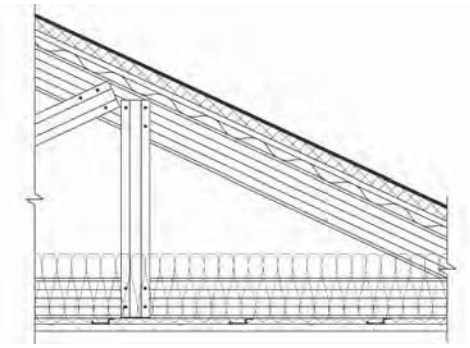

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type C
Temple-Inland - 5/8" TG-C

Approx. Ceiling Weight: 3 psf
Fire Test: UL R14196, 07NK19575, 2-15-08; UL R6937, 08NK02787, 9-19-08; UL Design P550

Contact the manufacturer for more detailed information on proprietary products.

ROOF-CEILING SYSTEMS

GA FILE NO. RC 2503 | PROPRIETARY* | 1 HOUR FIRE

STEEL ROOF TRUSSES, RESILIENT OR RIGID FURRING CHANNELS, THERMAL INSULATION, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum board applied at right angles to resilient or rigid furring channels with 1" Type S drywall screws 12" o.c. Channels spaced 12" o.c. when insulation is used or 16" o.c. when no insulation is used. Gypsum board end joints attached with screws 12" o.c. to additional pieces of channel extending 3" beyond edge of gypsum board and located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of pitched or parallel chord steel trusses 48" o.c. with 1/2" Type S-12 screws or rigid furring channels secured to the bottom chord of each truss with double-strand wire saddle ties **(refer to furring channel manufacturer for maximum spans)**. Optional glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting metal roof deck panels covered by 1/2" regular gypsum sheathing either loose laid, or adhesively or mechanically attached to roof deck. Any thickness polyisocyanurate foamed plastic; polystyrene foamed plastic; or mineral fiber or glass fiber insulation boards laid over gypsum sheathing and covered by a Class A, B, or C roof covering.

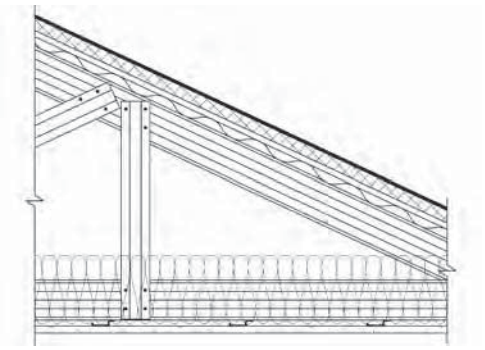

PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard C® Gypsum Board

Approx. Ceiling Weight: 3 psf
Fire Test: UL R2717, 10CA04725, 6-4-10, UL Design P553

GA FILE NO. RC 2504 | PROPRIETARY* | 1 HOUR FIRE

STEEL ROOF TRUSSES, RESILIENT OR RIGID CHANNELS, THERMAL INSULATION, GYPSUM WALLBOARD

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient or rigid furring channels with 1 1/8" Type S drywall screws 8" o.c. at end joints and 12" o.c. at intermediate channels. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 54" long located 3" back on either side of end joint. Gypsum board end joints staggered 12" in adjacent rows. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1 3/4" Type S drywall screws 8" o.c. Face layer joints offset 16" from base layer joints. Resilient channels applied at right angles to bottom chord of pitched or parallel chord steel trusses 48" o.c. with 1/2" Type S-12 screws or rigid furring channels secured to the bottom chord of each truss with double-strand wire saddle ties **(refer to furring channel manufacturer for maximum spans)**. Optional glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting metal roof deck panels.

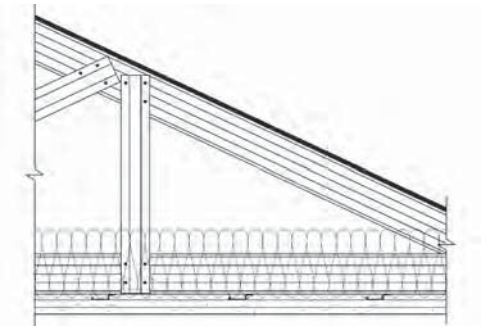

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® Type X
Temple-Inland	-	5/8" Type X

Approx. Ceiling Weight: 4.5 psf
Fire Test: UL R14196, 08NK19036, 9-26-08, UL Design P551

GA FILE NO. RC 2601 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, WOOD JOISTS, ROOF COVERING

Base layer 5/8" type X gypsum wallboard applied at right angles to 2 x 10 wood joists 24" o.c. with 1 1/4" Type W or S drywall screws 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to joists with 1 7/8" Type W or S drywall screws 12" o.c. at joints and intermediate joists and 1 1/2" Type G drywall screws 12" o.c. placed 2" back on either side of end joints. Joints offset 24" from base layer joints. Wood joists supporting 1/2" plywood with exterior glue applied at right angles to joists with 8d nails. Appropriate roof covering. **Ceiling provides one hour fire resistance protection for framing, including trusses.**

Approx. Ceiling Weight: 5 psf
Fire Test: FM FC 172, 2-25-72; ITS, 8-6-98

**Contact the manufacturer for more detailed information on proprietary products.*

ROOF-CEILING SYSTEMS

GA FILE NO. RC 2602 | GENERIC | 1 HOUR FIRE

WOOD TRUSSES, GYPSUM WALLBOARD

Base layer 5/8" type X gypsum wallboard applied at right angles to wood roof trusses 24" o.c. with 1 1/4" Type W or S drywall screws 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied at right angles to trusses with 1 7/8" Type W or S drywall screws 12" o.c. at joints and intermediate trusses and 1 1/2" Type G drywall screws 12" o.c. placed 2" back on either side of end joints. Joints offset 24" from base layer joints. Wood trusses supporting 1/2" wood structural panels applied at right angles to trusses with 8d nails. Appropriate roof covering. **Ceiling provides one hour fire resistance protection for trusses.**

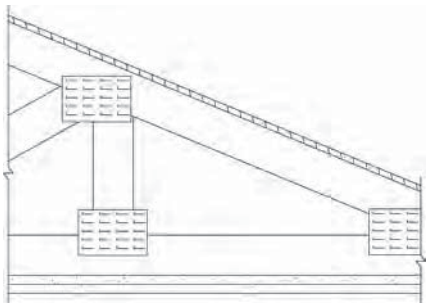

Approx. Ceiling Weight: 5 psf
Fire Test: FM FC 172, 2-25-72; ITS, 8-6-98

GA FILE NO. RC 2603 | PROPRIETARY* | 1 HOUR FIRE

WOOD ROOF TRUSSES, RESILIENT CHANNELS, GLASS OR MINERAL FIBER INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1 1/8" Type S drywall screws 8" o.c. Gypsum board end joints attached with screws 8" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of pitched wood trusses 24" o.c. with 1 1/4" Type S or W screws. Glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting 15/32" plywood or OSB roof sheathing applied at right angles to trusses with construction adhesive and 6d ring shank nails 12" o.c. Optional ceiling damper (refer to manufacturer for information on the type of damper).

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

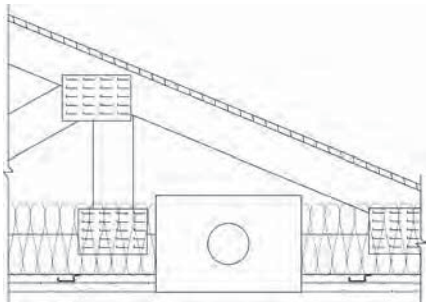

Approx. Ceiling Weight: 3 psf
Fire Test: UL R3501, 00NK42686, 8-16-01, UL Design P533

**Contact the manufacturer for more detailed information on proprietary products.*

ROOF-CEILING SYSTEMS

GA FILE NO. RC 2604 | **PROPRIETARY*** | **1 HOUR FIRE**

WOOD ROOF TRUSSES, RESILIENT CHANNELS, GLASS FIBER INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 16" o.c. (12" o.c. when insulation is draped over channels) with 1" Type S drywall screws 12" o.c. Gypsum board end joints attached with screws 8" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of pitched wood trusses 24" o.c. with 1 1/4" Type S or W screws. Glass fiber insulation secured to wood structural panels or draped over channels. Trusses supporting 15/32" wood structural panels applied at right angles to trusses with construction adhesive and 6d ring shank nails 12" o.c. Optional ceiling damper (refer to manufacturer for information on the type of damper).

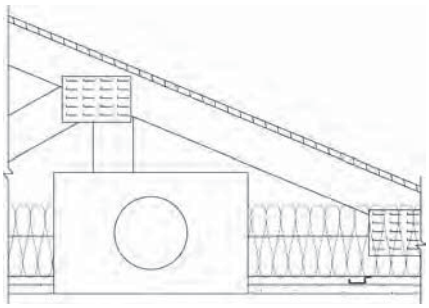

PROPRIETARY GYPSUM BOARD

United States Gypsum Company - 5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

Approx. Ceiling Weight: 3 psf
Fire Test: UL R15858, 02NK24136, 3-20-03, UL Design P544; UL R15858, 02NK41925, 9-30-02, UL Design P531; UL R1319, 98NK41378, 11-20-98, UL Design P522

GA FILE NO. RC 2606 | **PROPRIETARY*** | **1 HOUR FIRE**

WOOD ROOF TRUSSES, RESILIENT CHANNELS, GLASS OR MINERAL FIBER INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 12" o.c. with 1 1/8" Type S drywall screws 8" o.c. Gypsum board end joints attached with screws 8" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of pitched wood trusses 24" o.c. with 1 1/4" Type S or W screws. Glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting 15/32" plywood or OSB roof sheathing applied at right angles to trusses with 6d ring shank nails 12" o.c. Optional ceiling damper (refer to manufacturer for information on the type of damper).

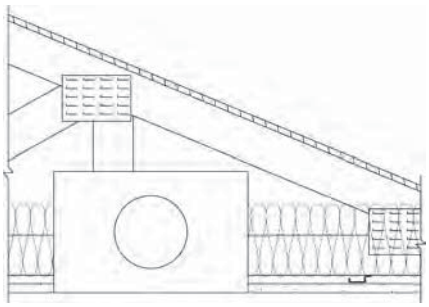

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type C
Temple-Inland - 5/8" TG-C

Approx. Ceiling Weight: 3 psf
Fire Test: UL R14196 (R6937) 04NK25585, 1-15-05, UL Design P545

Contact the manufacturer for more detailed information on proprietary products.

ROOF-CEILING SYSTEMS

GA FILE NO. RC 2608

PROPRIETARY*

1 HOUR FIRE

WOOD ROOF TRUSSES, RESILIENT CHANNELS, GLASS OR MINERAL FIBER INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 16" o.c. (12" o.c. when insulation is draped over channels) with 1" Type S drywall screws 12" o.c. (9 5/8" o.c. when insulation is draped over channels). Gypsum board end joints attached with screws 8" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of pitched wood trusses 24" o.c. with 1 1/4" Type S or W screws. Optional glass fiber or mineral fiber batt insulation secured to wood structural panels or applied directly over gypsum board. Trusses supporting 15/32" wood structural panels applied at right angles to trusses with either 6d ring shank nails or staples having equal or greater withdrawal and lateral resistance strength. Optional ceiling damper (refer to manufacturer for information on the type of damper).

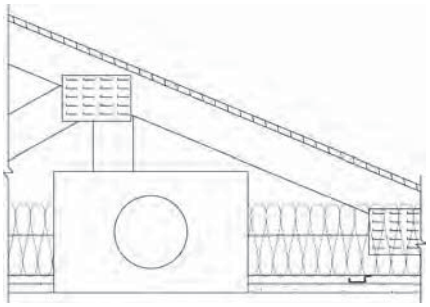

PROPRIETARY GYPSUM BOARD

PABCO Gypsum - 5/8" FLAMECURB® Type C

Approx. Ceiling Weight: 3 psf
Fire Test: UL R7094, 07NK11121, 11-27-07, UL Design P549; WFCi 07002C/07048, 8-3-07

GA FILE NO. RC 2609

PROPRIETARY*

1 HOUR FIRE

WOOD ROOF TRUSSES, RESILIENT CHANNELS, GLASS FIBER INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient furring channels 16" o.c. (12" o.c. when insulation is draped over channels or sprayed directly over gypsum board) with 1" Type S drywall screws 12" o.c. (8" o.c. when insulation is draped over channels). Gypsum board end joints attached with screws 8" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of pitched wood trusses 24" o.c. with 1 1/4" Type S or W screws. Optional glass fiber insulation secured to wood structural panels or draped over channels, or cellulose insulation sprayed directly over gypsum board. Trusses supporting 15/32" wood structural panels applied at right angles to trusses with either construction adhesive and 6d ring shank nails 12" o.c. Optional ceiling damper (refer to manufacturer for information on the type of damper).

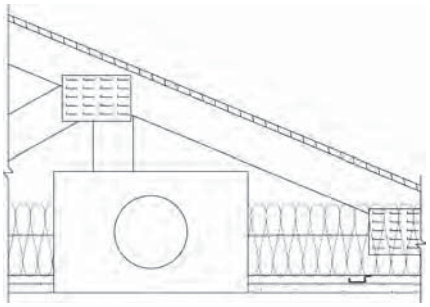

PROPRIETARY GYPSUM BOARD

CertainTeed Gypsum Inc. - 5/8" CertainTeed® Type C Gypsum Board

Approx. Ceiling Weight: 3 psf
Fire Test: UL R3660, 07NK25175, 6-24-08, UL Design P538

GA FILE NO. RC 2610

PROPRIETARY*

1 HOUR FIRE

WOOD ROOF TRUSSES, RESILIENT CHANNELS, GLASS FIBER INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard applied at right angles to resilient furring channels 16" o.c. (12" o.c. when insulation is draped over channels) with 1" Type S drywall screws 8" o.c. Gypsum board end joints attached with screws 8" o.c. to additional pieces of channel extending 6" beyond edge of board and located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of pitched or parallel chord wood trusses 24" o.c. with 1 1/4" Type S screws. Glass fiber insulation secured to wood structural panels or draped over channels. Wood trusses supporting 23/32" wood structural panels applied at right angles to trusses with 6d ring shank nails or staples having equal or greater withdrawal andf lateral resistance strength 12" o.c.

Optional ceiling damper (refer to manufacturer for information on the type of damper).

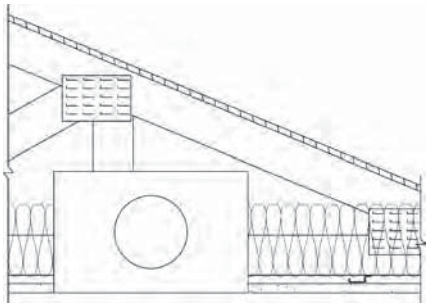

PROPRIETARY GYPSUM BOARD

Georgia Pacific Gypsum LLC - 5/8" ToughRock® Fireguard C® Gypsum Board

Approx. Ceiling Weight: 3 psf
Fire Test: UL R2717, 08CA46422, 5-13-09, UL Design P552

**Contact the manufacturer for more detailed information on proprietary products.*

ROOF-CEILING SYSTEMS

GA FILE NO. RC 2611

PROPRIETARY*

1 HOUR FIRE

WOOD ROOF TRUSSES, RESILIENT CHANNELS, GLASS FIBER INSULATION, CEILING DAMPER, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard applied at right angles to resilient furring channels 12" o.c. with 1" Type S drywall screws 8" o.c. Gypsum board end joints attached with screws 8" o.c. to additional pieces of channel 60" long and located 3" back on either side of end joint. Resilient channels applied at right angles to bottom chord of pitched wood trusses 24" o.c. with 1 1/4" Type S screws. Glass fiber batt insulation applied directly over gypsum board. Wood trusses supporting 15/32" plywood or OSB roof sheathing applied at right angles to trusses with 6d ring shank nails 12" o.c.

Optional ceiling damper (refer to manufacturer for information on the type of damper).

PROPRIETARY GYPSUM BOARD

Lafarge North America Inc. - 5/8" Firecheck® Type C

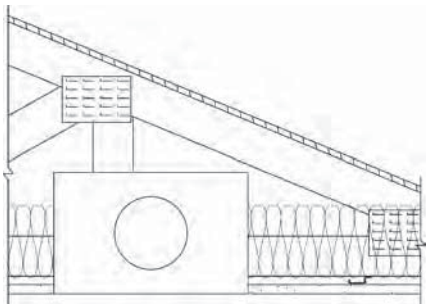

Approx. Ceiling Weight: 3 psf
Fire Test: UL R18482, 06NK24477, 1-30-07; 09NK05485, 5-14-09
UL Design P547

GA FILE NO. RC 2750

GENERIC

2 HOUR FIRE

GYPSUM WALLBOARD, RIGID FURRING CHANNELS WOOD JOISTS or WOOD I-JOISTS, ROOF COVERING

Base layer 5/8" type X gypsum wallboard applied at right angles to either 2 x 8 wood joists or 9 1/2" deep wood I-joists 24" o.c. with 1 1/4" Type W drywall screws 12" o.c. **Second** layer 5/8" type X gypsum wallboard applied at right angles to joists or I-joists with 2" Type W drywall screws 12" o.c. Second layer joints offset 24" from base layer joints. **Third** layer 5/8" type X gypsum wallboard applied at right angles to joists or I-joists with 2 1/2" Type W drywall screws 12" o.c. Third layer joints offset 12" from second layer joints. Hat-shaped rigid furring channels 24" o.c. applied at right angles to joists or I-joists over third layer with two 2 1/2" long Type W drywall screws at each joist or I-joist. **Face** layer 5/8" type X gypsum wallboard applied at right angles to furring channels with 1 1/8" Type S drywall screws 12" o.c. Wood joists or I-joists supporting 3/4" T & G edge plywood applied at right angles to joists or I-joists with 8d nails 6" o.c. at joints and 12" at intermediate joists or I-joists. Appropriate roof covering. **Ceiling provides two-hour fire-resistance protection for wood framing.**

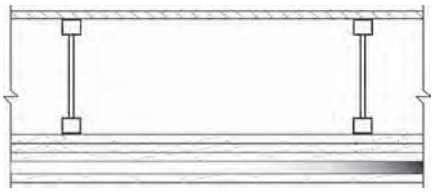

Approx. Ceiling Weight: 12 psf
Fire Test: UL R4024, 00NK26545, 4-27-01;
UL R4042, 03NK11206, 3-19-03;
UL Design L556;
ULC Design M514

GA FILE NO. RC 2751

GENERIC

2 HOUR FIRE

WOOD ROOF TRUSSES, GYPSUM WALLBOARD, RIGID FURRING CHANNELS

Base layer 5/8" type X gypsum wallboard applied at right angles to wood roof trusses 24" o.c. with 1 1/4" Type W drywall screws 12" o.c. **Second** layer 5/8" type X gypsum wallboard applied at right angles to trusses with 2" Type W drywall screws 12" o.c. Second layer joints offset 24" from base layer joints. **Third** layer 5/8" type X gypsum wallboard applied at right angles to trusses with 2 1/2" Type W drywall screws 12" o.c. Third layer joints offset 12" from second layer joints. Hat-shaped rigid furring channels 24" o.c. applied at right angles to trusses over third layer with two 2 1/2" long Type W drywall screws at each truss. **Face** layer 5/8" type X gypsum wallboard applied at right angles to furring channels with 1 1/8" Type S drywall screws 12" o.c. Wood trusses supporting 3/4" T & G edge wood structural panels applied at right angles to trusses with 8d nails 6" o.c. at joints and 12" at intermediate I-joists. Appropriate roof covering. **Ceiling provides two-hour fire-resistance protection for wood framing.**

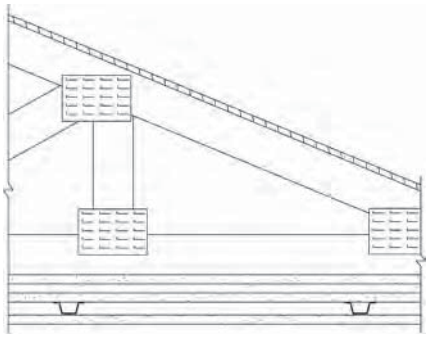

Approx. Ceiling Weight: 12 psf
Fire Test: UL R4024, 00NK26545, 4-27-01,
UL Design L556;
ULC Design M514

**Contact the manufacturer for more detailed information on proprietary products.*

ROOF-CEILING SYSTEMS

GA FILE NO. RC 2752

PROPRIETARY*

2 HOUR FIRE

STEEL ROOF TRUSSES, RESILIENT OR RIGID CHANNELS, THERMAL INSULATION, GYPSUM WALLBOARD

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient or rigid furring channels with 1 1/8" Type S drywall screws 12" o.c. Gypsum board end joints attached with screws 12" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. Channels spaced 12" o.c. when insulation is used or 16" o.c. when no insulation is used. Resilient channels applied at right angles to bottom chord of pitched or parallel chord steel trusses 48" o.c. with 1/2" Type S-12 screws or rigid furring channels secured to the bottom chord of each truss with double-strand wire saddle ties **(refer to furring channel manufacturer for maximum spans)**. Optional glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting metal roof deck panels covered by 1/2" regular gypsum sheathing either loose laid or adhesively or mechanically attached to roof deck. Any thickness polyisocyanurate foamed plastic; polystyrene foamed plastic; or mineral fiber or glass fiber insulation boards laid over gypsum sheathing and covered by a Class A, B, or C roof covering.

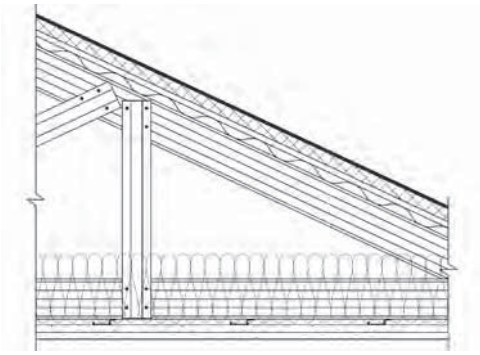

Approx. Ceiling Weight: 5 psf
Fire Test: UL R3501, 01NK49664, 4-2-03, UL Design P543

PROPRIETARY GYPSUM BOARD

National Gypsum Company - 5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board

GA FILE NO. RC 2753

PROPRIETARY*

2 HOUR FIRE

STEEL ROOF TRUSSES, RESILIENT OR RIGID CHANNELS, THERMAL INSULATION, GYPSUM WALLBOARD

Base layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to resilient or rigid furring channels with 1" Type S drywall screws 12" o.c. Gypsum board end joints attached with screws 12" o.c. to additional pieces of channel 60" long located 3" back on either side of end joint. **Face** layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to channels with 1 5/8" Type S drywall screws 12" o.c. Channels spaced 12" o.c. when insulation is used or 16" o.c. when no insulation is used. Resilient channels applied at right angles to bottom chord of pitched or parallel chord steel trusses 48" o.c. with 1/2" Type S-12 screws or rigid furring channels secured to the bottom chord of each truss with double-strand wire saddle ties **(refer to furring channel manufacturer for maximum spans)**. Optional glass fiber or mineral fiber batt or loose fill insulation applied directly over gypsum board. Trusses supporting metal roof deck panels covered by 1/2" regular gypsum sheathing either loose laid or adhesively or mechanically attached to roof deck. Any thickness polyisocyanurate foamed plastic; polystyrene foamed plastic; or mineral fiber or glass fiber insulation boards laid over gypsum sheathing and covered by a Class A, B, or C roof covering.

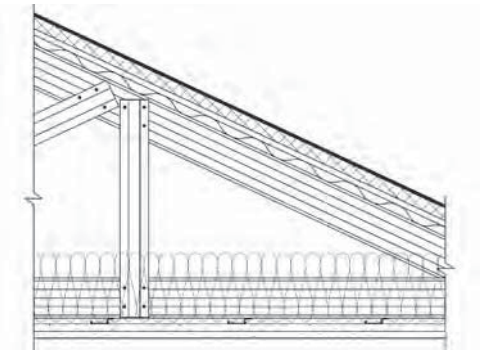

Approx. Ceiling Weight: 5 psf
Fire Test: UL R14196, 08NK19036, 2-15-08, UL Design P550

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC - 5/8" FireBloc® Type C
Temple-Inland - 5/8" Type C

This Space Left Blank

**Contact the manufacturer for more detailed information on proprietary products.*

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 1000 | **GENERIC** | **1 HOUR FIRE**

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied without horizontal joints around W10x49 column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 1001 | **GENERIC** | **1 HOUR FIRE**

GYPSUM WALLBOARD, STEEL STUDS

One layer 1/2" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of W10x49 column with 1" Type S drywall screws 24" o.c. Metal cornerbead applied to all corners with 1" Type S drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

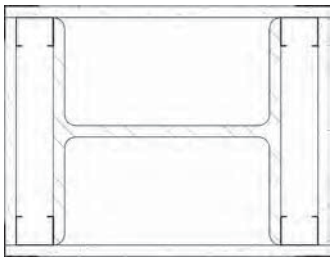

Fire Test: UL NC505, 77NK1747; 6-13-77, UL Design X528

GA FILE NO. CM 1002 | **GENERIC** | **1 HOUR FIRE**

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W10x49 column and held in place with paper masking tape. **Second** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges.

Horizontal joints offset 24" from base layer joints. Metal cornerbead attached to all corners with 1" Type S drywall screws 12" o.c. in each flange.



Fire Test: See CM1000 (UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526)

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 1003 | **GENERIC** | **1 HOUR FIRE**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied to 1 5/8" steel studs located at each corner of W10x49 column with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard applied with 1 3/4" Type S drywall screws 24" o.c. Metal cornerbead applied to all corners with 1" Type S drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

Horizontal joints staggered 24" between layers.

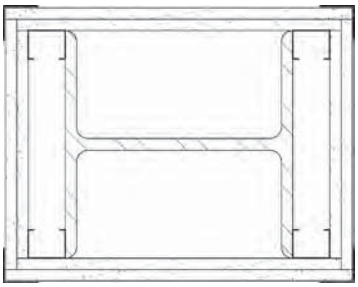

Fire Test: Based on UL NC505, 77NK1747; 6-13-77, UL Design X528

GA FILE NO. CM 1300 | **GENERIC** | **1 HOUR FIRE**

METAL LATH, GYPSUM PLASTER

5/8" 1:3 gypsum-sand plaster applied over 3.4 lb metal lath applied around and wire tied to W10x49 column with 18 ga wire 6" o.c.



Fire Test: BMS 92/40, 10-7-42

GA FILE NO. CM 1400 | **GENERIC** | **1 HOUR FIRE**

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W4x13 column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied without horizontal joints to column cover and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 1401 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W4x13 column and held in place with paper masking tape. **Second** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied without horizontal joints to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead applied to all corners with 1" Type S drywall screws 12" o.c. in each flange.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 1402 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of W4x13 column with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard applied without horizontal joints to studs with 1 3/4" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.



Fire Test: UL NC505, 77NK1747, 6-13-77; UL Design X528

GA FILE NO. CM 1403 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W4x13 column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead applied to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between layers.



Fire Test: Based on UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 1404 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied to 1 5/8" steel studs located at each corner of W4x13 column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum wallboard applied to studs with 1 3/4" Type S drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to studs with 2" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

Horizontal joints staggered 24" between layers.



Fire Test: Based on UL NC505, 77NK1747, 6-13-77; UL Design X528

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 1450 — GENERIC — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around TS4x4x0.188 tube steel column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 1451 — GENERIC — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around TS4x4x0.188 tube steel column and held in place with paper masking tape. **Second** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied without horizontal joints to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead applied to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 1452 — GENERIC — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of TS4x4x0.188 tube steel column with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard applied without horizontal joints to studs with 1 3/4" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.



Fire Test: UL NC505, 77NK1747; 6-13-77, UL Design X528

GA FILE NO. CM 1453 — GENERIC — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around TS4x4x0.188 tube steel column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead applied to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between layers.



Fire Test: Based on UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 1454 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied to 1 5/8" steel studs located at each corner of TS4x4x0.188 tube steel column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum wallboard applied to studs with 1 3/4" Type S drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to studs with 2" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

Horizontal joints staggered 24" between layers.



Fire Test: Based on UL NC505, 77NK1747; 6-13-77, UL Design X528

GA FILE NO. CM 1600 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W6x15.5 column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 1601 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W6x15.5 column and held in place with paper masking tape. **Second** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied without horizontal joints to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead applied to all corners with 1" Type S drywall screws 12" o.c. in each flange.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 1602 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of W6x15.5 column with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard applied without horizontal joints to studs with 1 3/4" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.



Fire Test: UL NC505, 77NK1747, 6-13-77; UL Design X528

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 1603 — GENERIC — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W6x15.5 column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead applied to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between layers.



Fire Test: Based on UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 1604 — GENERIC — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied to 1 5/8" steel studs located at each corner of W6x15.5 column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum wallboard applied to studs with 1 3/4" Type S drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to studs with 2" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

Horizontal joints staggered 24" between layers.



Fire Test: Based on UL NC505, 77NK1747, 6-13-77; UL Design X528

GA FILE NO. CM 1850 — GENERIC — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 5/8" type X gypsum wallboard applied around TS8x8x0.250 tube steel column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 1851 — GENERIC — 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

One layer 5/8" type X gypsum wallboard applied without horizontal joints and parallel to 1 5/8" steel studs located at each corner of TS8x8x0.250 tube steel column with 1" Type S drywall screws 24" o.c. Metal cornerbead, 1 1/2" flanges, applied with 1" Type S drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.



Fire Test: UL NC505, 77NK1747, 6-13-77; UL Design X528

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 1852 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 5/8" type X gypsum wallboard applied around TS8x8x0.250 tube steel column and held in place with paper masking tape. **Second** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard applied to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead applied to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between layers.



Fire Test: Based on UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 1853 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" type X gypsum wallboard applied to 1 5/8" steel studs located at each corner of TS8x8x0.250 tube steel column with 1" Type S drywall screws 24" o.c. **Face** layer 5/8" type X gypsum wallboard applied to studs with 1 3/4" Type S drywall screws 12" o.c. Metal cornerbead, 1 1/2" flanges, applied with 1" Type S drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

Horizontal joints staggered 24" between layers.

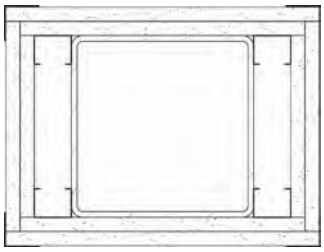

Fire Test: Based on UL NC505, 77NK1747, 6-13-77; UL Design X528

GA FILE NO. CM 2010 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied to flanges and across web openings of W10x49 column and fastened to 1 5/8" steel studs with 1" Type S drywall screws 24" o.c. **Face** layers 1/2" type X gypsum wallboard or gypsum veneer base applied to studs over flanges with 1" Type S drywall screws 12" o.c. to provide a cavity between boards on the flange. **Face** layers across the web opening laid flat across the base layer and attached to studs with 1 5/8" Type S drywall screws 12" o.c. Metal cornerbead applied with 4d nails, 1 3/8" long, 0.067" shank, 13/64" heads, 12" o.c. in each flange.

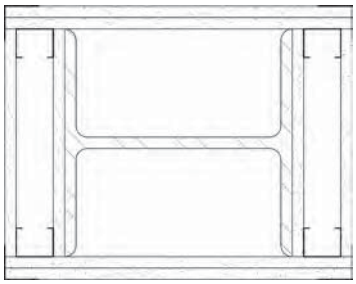

Fire Test: UL R1319-80, 5-27-65, UL Design X518; ULC Design X518

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 2015 | **GENERIC** | **2 HOUR FIRE**

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W10x49 column and held in place with paper masking tape. **Second** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 2016 | **GENERIC** | **2 HOUR FIRE**

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W10x49 column and held in place with paper masking tape. **Second** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard applied without horizontal joints to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead attached to all corners with 1" Type S drywall screws 12" o.c. in each flange.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 2017 | **GENERIC** | **2 HOUR FIRE**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of W10x49 column with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard applied without horizontal joints to studs with 1 3/4" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

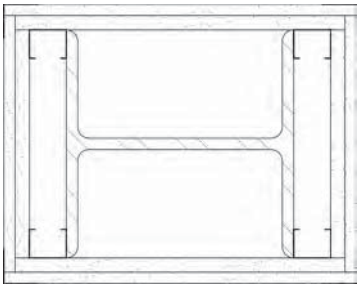

Fire Test: UL NC505, 77NK1747; 6-13-77, UL Design X528

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 2018 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W10x49 column and held in place with paper masking tape. **Second** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard applied without horizontal joints to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead attached to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between layers.

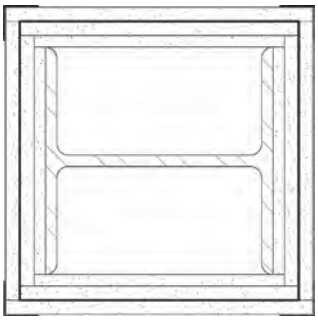

Fire Test: Based on UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 2019 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" type X gypsum wallboard applied to 1 5/8" steel studs located at each corner of W10x49 column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum wallboard applied to studs with 1 3/4" Type S drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to studs with 2" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

Horizontal joints staggered 24" between layers.

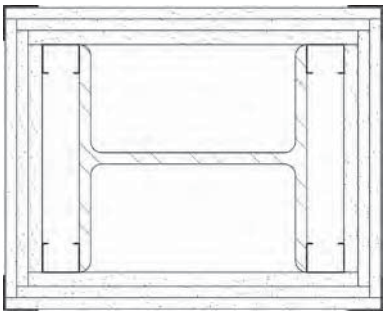

Fire Test: Based on UL NC505, 77NK1747; 6-13-77, UL Design X528

GA FILE NO. CM 2020 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied around W10x49 column and nailed with 1 3/8" long ring shank nails as required for support. **Second** layer 5/8" type X gypsum wallboard or gypsum veneer base applied around column and nailed with 1 3/8" long ring shank nails as required for support. 1 1/4" x 1 1/4" 25 ga steel angles applied over corners with 1/2" x 0.015" steel straps 30" o.c. wrapped around second layer beginning 18" from each end of column. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base attached to steel angles. Metal cornerbead applied to all corners with 1" Type S drywall screws spaced 12" o.c.

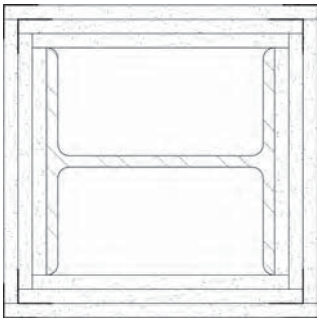

Fire Test: UL R1319-33, 11-3-60, UL Design X516

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 2110 | **GENERIC** | **2 HOUR FIRE**

STEEL STUDS, GYPSUM WALLBOARD

One layer 1/2" type X gypsum wallboard or gypsum veneer base attached to 1 5/8" steel studs located at each corner of heavy steel W14x228 columns with 1" Type S drywall screws 12" o.c. 1 1/4" metal cornerbead applied by crimping 6" o.c.

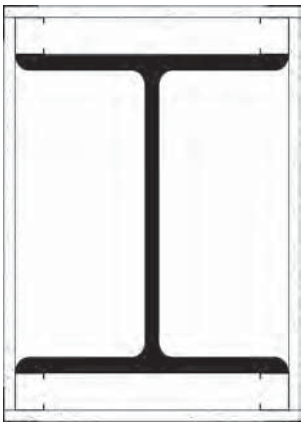

Fire Test: UL R3501-58, 10-10-67, UL Design X520; ULC Design X520

GA FILE NO. CM 2120 | **GENERIC** | **2 HOUR FIRE**

STEEL STUDS, GYPSUM WALLBOARD

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied to 1 5/8" steel studs located at each corner of W10x49 column with 1" Type S screws 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied to studs with 1 5/8" Type S drywall screws 12" o.c. 1 1/4" metal cornerbead applied with 6d coated nails, 1 3/4" long, 0.0915" shank, 1/4" heads, 12" o.c. in each flange.

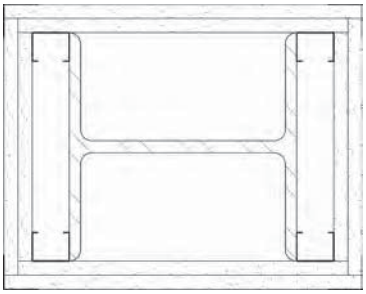

Fire Test: UL R2717-34, 5-15-64, UL Design X517; ULC Design Z503

GA FILE NO. CM 2310 | **GENERIC** | **2 HOUR FIRE**

METAL LATH, GYPSUM PLASTER

1 5/8" 1:1-1:1 wood-fibered gypsum-sand plaster applied over 3.4 lb diamond mesh expanded metal lath wire tied with 18 ga wire 6" o.c. at seams applied over 1/2" x 3/4" spacers 40" o.c. Spacers made of 3/4" furring channel with 2" legs bent around each corner of W10x49 column.

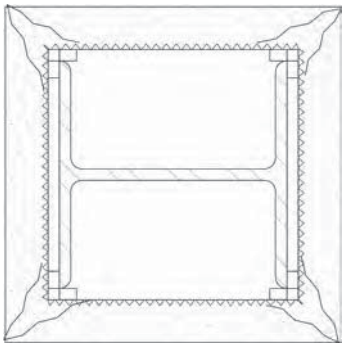

Fire Test: UL R4024-10, 1-5-67

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 2320 | GENERIC | 2 HOUR FIRE

METAL LATH, GYPSUM PLASTER

1" 1:2-1:3 gypsum-perlite plaster applied over 3.4 lb. self-furring expanded diamond mesh metal lath and 2½" wide flanged expanded metal cornerbeads wire tied to W10x49 column with 18 ga galvanized wire 6" o.c.



Fire Test: UL R3187-4, -5, -7, 7-30-52, UL Design X402

GA FILE NO. CM 2400 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer ½" type X gypsum wallboard applied around W4x13 column and held in place with paper masking tape. **Second** layer ½" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer ½" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x½" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 2401 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer ½" type X gypsum wallboard applied around W4x13 column and held in place with paper masking tape. **Second** layer ½" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x½" sheet metal screws 12" o.c. **Face** layer ½" type X gypsum wallboard applied without horizontal joints to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead attached to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between base and second layers.

Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 2402 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer ½" type X gypsum wallboard applied without horizontal joints to 1⅝" steel studs located at each corner of W4x13 column with 1" Type S drywall screws 24" o.c. **Second** layer ½" type X gypsum board applied without horizontal joints with 1¾" Type S drywall screws 12" o.c. and wire tied with 18 ga wire 24" o.c. **Face** layer ½" type X gypsum wallboard applied without horizontal joints to studs with 2¼" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.



Fire Test: UL NC505, 77NK1747, 6-13-77, UL Design X528

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 2403 — GENERIC — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W4x13 column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Fourth** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead attached to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between base and second layers.



Fire Test: Based on UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 2404 — GENERIC — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied to 1 5/8" steel studs located at each corner of W4x13 column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum board applied with 1 3/4" Type S drywall screws 12" o.c. and wire tied with 18 ga wire 24" o.c. **Third** layer 1/2" type X gypsum wallboard applied to studs with 2 1/4" Type S drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to studs with 2 1/2" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

Horizontal joints staggered 24" between layers.



Fire Test: Based on UL NC505, 77NK1747, 6-13-77, UL Design X528

GA FILE NO. CM 2453 — GENERIC — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around TS4x4x0.188 tube steel column and held in place with paper masking tape. **Second** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL NC505, 3-6-06; UL Design X526

GA FILE NO. CM 2454 — GENERIC — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around TS4x4x0.188 tube steel column and held in place with paper masking tape. **Second** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard applied without horizontal joints to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead attached to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between base and second layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL NC505, 3-6-06; UL Design X526

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 2455 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of TS4x4x0.188 tube steel column with 1" Type S drywall screws 24" o.c. **Second** layer 5/8" type X gypsum board applied without horizontal joints with 1 3/4" Type S drywall screws 12" o.c. and wire tied with 18 ga wire 24" o.c. **Face** layer 5/8" type X gypsum wallboard applied without horizontal joints to studs with 2 1/4" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.



Fire Test: UL NC505, 77NK1747, 6-13-77; UL NC505, 3-6-06; UL Design X528

GA FILE NO. CM 2456 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied to 1 5/8" steel studs located at each corner of TS4x4x0.188 tube steel column with 1" Type S drywall screws 24" o.c. **Second** layer 5/8" type X gypsum board applied with 1 3/4" Type S drywall screws 12" o.c. and wire tied with 18 ga wire 24" o.c. **Third** layer 5/8" type X gypsum wallboard applied to studs with 2 1/4" Type S drywall screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard applied to studs with 2 1/2" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

Horizontal joints staggered 24" between layers.



Fire Test: Based on UL NC505, 77NK1747, 6-13-77; UL NC505, 3-6-06; UL Design X528

GA FILE NO. CM 2457 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around TS4x4x0.188 tube steel column and held in place with paper masking tape. **Second** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Fourth** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard applied to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead attached to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between layers.



Fire Test: Based on UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL NC505, 3-6-06; UL Design X526

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 2600 | **GENERIC** | **2 HOUR FIRE**

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W6x15.5 column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 2601 | **GENERIC** | **2 HOUR FIRE**

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W6x15.5 column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied without horizontal joints to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead attached to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between base and second layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 2602 | **GENERIC** | **2 HOUR FIRE**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of W6x15.5 column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum board applied without horizontal joints with 1 3/4" Type S drywall screws 12" o.c. and wire tied with 18 ga wire 24" o.c. **Face** layer 1/2" type X gypsum wallboard applied without horizontal joints to studs with 2 1/4" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.



Fire Test: UL NC505, 77NK1747, 6-13-77, UL Design X528

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 2603 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W6x15.5 column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Fourth** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead attached to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between layers.



Fire Test: Based on UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 2604 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied to 1 5/8" steel studs located at each corner of W6x15.5 column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum board applied with 1 3/4" Type S drywall screws 12" o.c. and wire tied with 18 ga wire 24" o.c. **Third** layer 1/2" type X gypsum wallboard applied to studs with 2 1/4" Type S drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to studs with 2 1/2" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

Horizontal joints staggered 24" between layers.

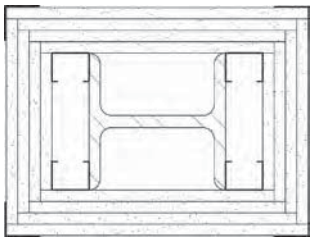

Fire Test: Based on UL NC505, 77NK1747, 6-13-77, UL Design X528

GA FILE NO. CM 2801 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around TS8x8x0.0250 tube steel column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL NC505, 3-6-06; UL Design X526

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 2802 — GENERIC — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around TS8x8x0.250 tube steel column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied without horizontal joints to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead attached to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between base and second layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL NC505, 3-6-06; UL Design X526

GA FILE NO. CM 2803 — GENERIC — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of TS8x8x0.250 tube steel column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum board applied without horizontal joints with 1 3/4" Type S drywall screws 12" o.c. and wire tied with 18 ga wire 24" o.c. **Face** layer 1/2" type X gypsum wallboard applied without horizontal joints to studs with 2 1/4" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

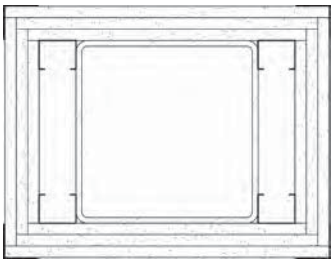

Fire Test: UL NC505, 77NK1747, 6-13-77; UL NC505, 3-6-06; UL Design X528

GA FILE NO. CM 2804 — GENERIC — 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around TS8x8x0.250 tube steel column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Fourth** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied without horizontal joints to column cover with 1" Type S drywall screws 8" o.c. spaced 1" from vertical edges. Metal cornerbead attached to all corners with 1" Type S drywall screws 12" o.c. in each flange.

Horizontal joints staggered 24" between layers.



Fire Test: Based on UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL NC505, 3-6-06; UL Design X526

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 2805 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied to 1 5/8" steel studs located at each corner of TS8x8x0.250 tube steel column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum board applied with 1 3/4" Type S drywall screws 12" o.c. and wire tied with 18 ga wire 24" o.c. **Third** layer 1/2" type X gypsum wallboard applied to studs with 2 1/4" Type S drywall screws 12" o.c. **Face** layer 1/2" type X gypsum wallboard applied to studs with 2 1/2" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

Horizontal joints staggered 24" between layers.

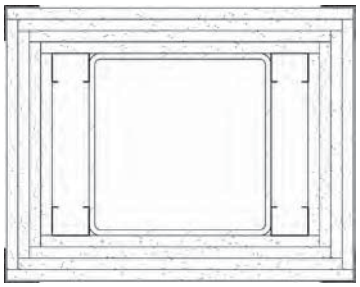

Fire Test: Based on UL NC505, 77NK1747, 6-13-77 UL NC505, 3-6-06; UL Design X528

GA FILE NO. CM 3100 | PROPRIETARY* | 3 HOUR FIRE

STEEL STUDS, GYPSUM WALLBOARD

Base layer 1/2" proprietary type X gypsum wallboard applied to flanges and across web openings of W10x49 column and fastened to 1 5/8" steel studs with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" proprietary gypsum wallboard applied to studs with 1 5/8" Type S drywall screws 12" o.c. creating a stud cavity between base and second layers over column flanges. **Face** layer 1/2" proprietary gypsum wallboard applied to studs with 2 1/4" Type S drywall screws 12" o.c. 1 1/4" cornerbead applied with 4d drywall nails. Joint compound 1/16" thick applied over cornerbead and face layer.

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	1/2" FireBloc® Type C
CertainTeed Gypsum Inc.	-	1/2" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	1/2" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	1/2" Firecheck® Type C
National Gypsum Company	-	1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	1/2" FLAME CURB® Super 'C'™
Temple-Inland	-	1/2" TG-C
United States Gypsum Company	-	1/2" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

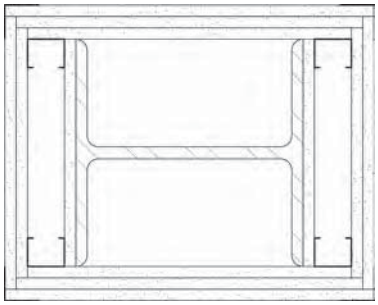

Fire Test: UL R7094, 90NK10635, 12-4-90, UL Design X515

GA FILE NO. CM 3115 | GENERIC | 3 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 5/8" type X gypsum wallboard applied around W10x49 column and held in place with paper masking tape. **Second** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.

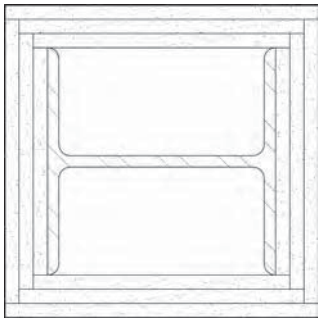

Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

**Contact the manufacturer for more detailed information on proprietary products.*

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 3116 — GENERIC — 3 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 5/8" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of W10x49 column with 1" Type S drywall screws 24" o.c. **Second** layer 5/8" type X gypsum board applied without horizontal joints with 1 3/4" Type S drywall screws 12" o.c. and wire tied with 18 ga wire 24" o.c. **Face** layer 5/8" type X gypsum wallboard applied without horizontal joints to studs with 2 1/4" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

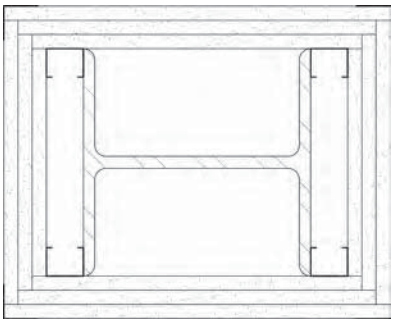

Fire Test: UL NC505, 77NK1747; 6-13-77, UL Design X528

GA FILE NO. CM 3120 — GENERIC — 3 HOUR FIRE

STEEL STUDS, GYPSUM WALLBOARD

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied to 1 5/8" steel studs located at each corner of W10x49 column with 1" Type S drywall screws 24" o.c. **Second** layer 5/8" type X gypsum wallboard or gypsum veneer base applied to studs with 1 5/8" Type S drywall screws 12" o.c. and 18 ga wire tied 24" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied to studs with 2 1/4" Type S drywall screws 12" o.c. Metal cornerbead applied with 6d coated nails, 1 7/8" long, 0.0915" shank, 1/4" heads, 12" o.c. in each flange.

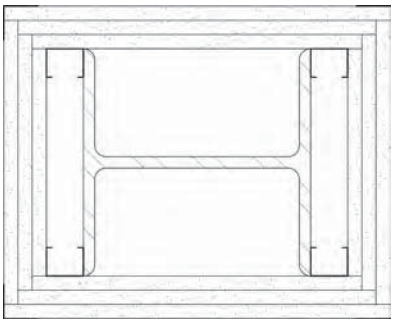

Fire Test: UL R2717-31, 2-20-64, UL Design X509; UL R3501-36, 7-31-64, UL Design X510; ULC Design Z502

GA FILE NO. CM 3130 — GENERIC — 3 HOUR FIRE

STEEL STUDS, GYPSUM WALLBOARD

Base layer 1/2" type X gypsum wallboard or gypsum veneer base applied to 1 5/8" steel studs located at corners of heavy steel W14x228 column with 1" Type S drywall screws 24" o.c. **Face** layer 1/2" type X gypsum wallboard or gypsum veneer base applied to studs with 1 5/8" Type S drywall screws 12" o.c. 1" cornerbead applied with 4d coated nails, 1 3/8" long, 0.067" shank, 13/64" heads, 12" o.c.

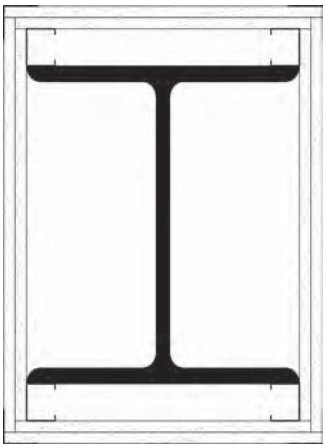

Fire Test: UL R3501-61, 7-16-69, UL Design X513; ULC Design X513

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 3310 | GENERIC | 3 HOUR FIRE

METAL LATH, GYPSUM PLASTER

1 3/8" 1:2-1:3 gypsum-perlite plaster applied over 3.4 lb. self-furring expanded diamond mesh metal lath and 2 1/2" wide flanged expanded metal cornerbeads wire tied to W10x49 column with 18 ga galvanized wire 6" o.c.

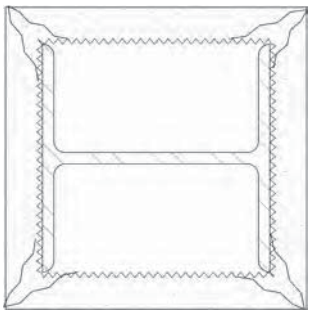

Fire Test: UL R3187-4, -5, -7; 7-30-52, UL Design X402

GA FILE NO. CM 3401 | GENERIC | 3 HOUR FIRE

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of W4x13 column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum board applied without horizontal joints with 1 3/4" Type S drywall screws 12" o.c. Steel angle, 2"x2"x25 ga, applied to all corners over second layer with 1 3/4" Type S drywall screws 12" o.c. in each flange. **Third** layer 5/8" type X gypsum wallboard applied without horizontal joints to steel angles with 1" Type S drywall screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard applied without horizontal joints to steel angles with 1 3/4" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.



Fire Test: UL NC505, 77NK1747, 6-13-77, UL Design X528

GA FILE NO. CM 3402 | GENERIC | 3 HOUR FIRE

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around W4x13 column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Fourth** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.



Fire Test: UL NC505-7, 76NK8228, 2-15-77; UL NC505, 77NK1518; UL Design X526

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 3452 | **GENERIC** | **3 HOUR FIRE**

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around TS4x4x0.188 column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Fourth** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Fifth** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL NC505, 3-6-06; UL Design X526

GA FILE NO. CM 3454 | **GENERIC** | **3 HOUR FIRE**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of TS 4x4x0.188 tube steel column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum board applied without horizontal joints with 1 3/4" Type S drywall screws 12" o.c. Steel angle, 2"x2"x25 ga, applied to all corners over second layer with 1 3/4" Type S drywall screws 12" o.c. in each flange. **Third** layer 1/2" type X gypsum wallboard applied without horizontal joints to steel angles with 1" Type S drywall screws 12" o.c. **Fourth** layer 1/2" type X gypsum wallboard applied without horizontal joints to steel angles with 1 3/4" Type S drywall screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard applied without horizontal joints to steel angles with 2" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" Type S drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.



Fire Test: UL NC505, 77NK1747, 6-13-77; UL NC505, 3-6-06; UL Design X528

GA FILE NO. CM 3601 | **GENERIC** | **3 HOUR FIRE**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of W6x15.5 column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum board applied without horizontal joints with 1 3/4" Type S drywall screws 12" o.c. Steel angle, 2"x2"x25 ga, applied to all corners over second layer with 1 3/4" Type S drywall screws 12" o.c. in each flange. **Third** layer 5/8" type X gypsum wallboard applied without horizontal joints to steel angles with 1" Type S drywall screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard applied without horizontal joints to steel angles with 1 3/4" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

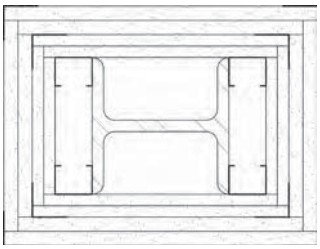

Fire Test: UL NC505, 77NK1747, 6-13-77, UL Design X528

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 3602 | **GENERIC** | **3 HOUR FIRE**

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" Type X gypsum wallboard applied around W6x15.5 column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Fourth** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 3801 | **GENERIC** | **3 HOUR FIRE**

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 1/2" type X gypsum wallboard applied around TS8x8x0.0250 tube steel column and held in place with paper masking tape. **Second** layer 1/2" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Fourth** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga galvanized steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga galvanized steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL NC505, 3-6-06; UL Design X526

GA FILE NO. CM 3803 | **GENERIC** | **3 HOUR FIRE**

GYPSUM WALLBOARD, STEEL STUDS

Base layer 1/2" type X gypsum wallboard applied without horizontal joints to 1 5/8" steel studs located at each corner of TS8x8x0.250 tube steel column with 1" Type S drywall screws 24" o.c. **Second** layer 1/2" type X gypsum board applied without horizontal joints with 1 3/4" Type S drywall screws 12" o.c. and wire tied with 18 ga wire 24" o.c. **Third** layer 5/8" type X gypsum wallboard applied without horizontal joints to studs with 2 1/4" Type S drywall screws 12" o.c. **Face** layer 5/8" type X gypsum wallboard applied without horizontal joints to studs with 3" Type S drywall screws 12" o.c. Metal cornerbead applied to all corners with 1" drywall screws 12" o.c. in each flange. Joint compound 1/16" thick applied over cornerbead.

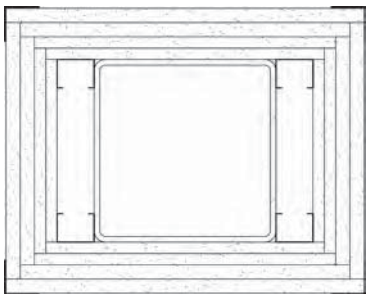

Fire Test: UL NC505, 77NK1747, 6-13-77; UL NC505, 3-6-06; UL Design X528

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 4110 | **GENERIC** | **4 HOUR FIRE**

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 5/8" type X gypsum wallboard applied around W10x49 column and held in place with paper masking tape. **Second** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Fourth** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga stainless steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga stainless steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.

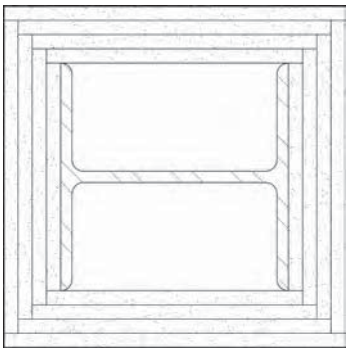

Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75; UL NC505, 77NK1518; UL Design X526

GA FILE NO. CM 4322 | **PROPRIETARY*** | **4 HOUR FIRE**

STEEL STUDS, GYPSUM WALLBOARD

Base layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied to 1 5/8" steel studs located at each corner of heavy steel W14x228 column with 1" Type S drywall screws 12" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard or gypsum veneer base applied to studs with 1 5/8" Type S drywall screws 12" o.c. Metal cornerbead applied with 4d coated nails, 1 3/8" long, 0.067" shank, 13/64" heads, 12" o.c. in each flange.

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	1/2" FireBloc® Type C
CertainTeed Gypsum Inc.	-	1/2" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	1/2" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	1/2" Firecheck® Type C
National Gypsum Company	-	1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	1/2" FLAME CURB® Super 'C'™
Temple-Inland	-	1/2" TG-C
United States Gypsum Company	-	1/2" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

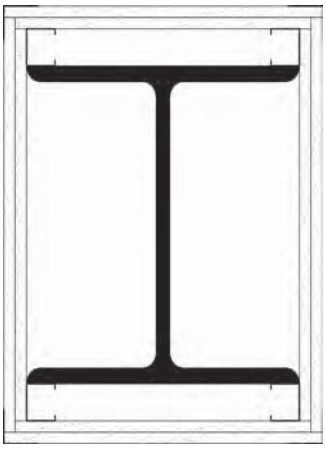

Fire Test: UL R1319-127, 8-20-69; Based on UL R3660-7, -8; 11-12-87; UL R7094, 90NK10635, 12-4-90; UL Design X507

**Contact the manufacturer for more detailed information on proprietary products.*

COLUMNS, NONCOMBUSTIBLE

GA FILE NO. CM 4410 | **GENERIC** | **4 HOUR FIRE**

GYPSUM PLASTER, METAL LATH

1 3/4" 1:2-1:3 gypsum-perlite plaster applied over 3.4 lb. self-furring expanded diamond mesh metal lath and 2 1/4" wide flanged expanded metal cornerbeads wire tied to W10x49 column with 18 ga galvanized wire 6" o.c.

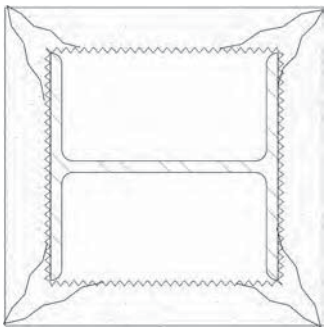

Fire Test: UL R3187-4, -5, -7, 7-30-52, UL Design X402

GA FILE NO. CM 4420 | **GENERIC** | **4 HOUR FIRE**

GYPSUM PLASTER, METAL LATH

1 1/2" 1:2-1:3 gypsum-perlite plaster applied over 3.4 lb. metal lath wire tied to W10x49 column with 18 ga wire 24" o.c. Lath spaced 7/16" away from column with 3/4" cold rolled channels.

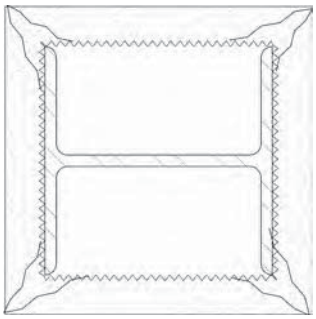

Fire Test: UL R3187-6, 8-7-52, UL Design X406

GA FILE NO. CM 4600 | **GENERIC** | **4 HOUR FIRE**

GYPSUM WALLBOARD, STEEL COLUMN COVER

Base layer 5/8" type X gypsum wallboard applied around W6x15.5 column and held in place with paper masking tape. **Second** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Third** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Fourth** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Fifth** layer 5/8" type X gypsum wallboard applied around column and held in place with paper masking tape. **Face** layer either 24 ga stainless steel column cover consisting of two L-shaped sections with snap-lock sheet steel joints or 22 ga stainless steel column covers consisting of two L-shaped sections with lap joints fastened with No. 8x1/2" sheet metal screws 12" o.c.

Horizontal joints staggered 24" between layers.



Fire Test: UL NC505-(1-6), 71NK2639, 12-23-75;
UL NC505, 77NK1518;
UL Design X526

BEAMS, GIRDERS, AND TRUSSES, NONCOMBUSTIBLE

GA FILE NO. BM 1137 — PROPRIETARY* — 1 HOUR FIRE

STEEL FRAME, GYPSUM WALLBOARD

Base layer 1/2" proprietary type X gypsum wallboard applied to beam cage with 1" Type S-12 drywall screws 12" o.c. **Face** layer 1/2" proprietary type X gypsum wallboard applied to beam cage with 1 5/8" Type S-12 drywall screws 12" o.c. Joints offset from base layer joints.

Beam cage fabricated from 24 ga 7/8" x 1 3/8" steel angles screw attached to steel joists at beam top flange and 25 ga 2 1/2" steel runners hooked over beam lower flange and supporting 1 5/8" steel studs 24" o.c. Minimum beam size W8x15. **(One hour unrestrained beam.)**

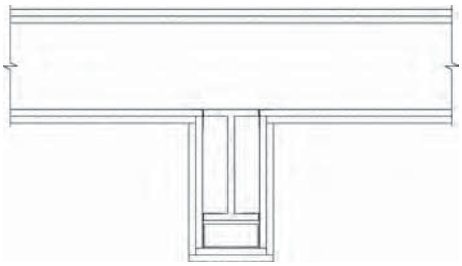

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	1/2" FireBloc® Type C
CertainTeed Gypsum Inc.	-	1/2" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	1/2" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	1/2" Firecheck® Type C
National Gypsum Company	-	1/2" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	1/2" FLAME CURB® Super 'C'™
Temple-Inland	-	1/2" TG-C
United States Gypsum Company	-	1/2" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

Fire Test: UL R1319-133, 7-16-75; Based on UL R3660-7 & -8, 11-12-87; UL Design L524

GA FILE NO. BM 2120 — GENERIC — 2 HOUR FIRE

STEEL FRAME, GYPSUM WALLBOARD

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied to beam cage with 1 1/4" Type S drywall screws 16" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied to beam cage with 1 3/4" Type S drywall screws 8" o.c.

Beam cage fabricated from horizontally installed steel angles (25 ga steel having 1" and 2" legs) located not less than 1/2" from beam flanges. 1" legs of the upper angles secured to steel deck units with 1/2" Type S pan head screws 12" o.c. "U" shaped brackets formed of 25 ga "U" shaped steel channels (1 11/16" wide with 1" legs) 24" o.c. suspended from upper angles with 1/2" Type S pan head screws and supported 1" x 2" angles at lower corners attached to brackets with 1/2" Type S pan head screws. Outside corners of gypsum board protected by 0.020" thick metal cornerbeads crimped or nailed. Minimum beam size W8x24. **(Two hour restrained or unrestrained beam.)**

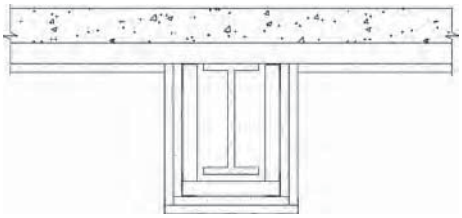

Fire Test: UL R4024-5, 9-14-66, UL Design N501; ULC Design O501

GA FILE NO. BM 2130 — GENERIC — 2 HOUR FIRE

STEEL FRAME, GYPSUM WALLBOARD

Base layer 5/8" type X gypsum wallboard or gypsum veneer base applied to beam cage with 1 1/4" Type S drywall screws 16" o.c. **Face** layer 5/8" type X gypsum wallboard or gypsum veneer base applied to beam cage with 1¾" Type S drywall screws 8" o.c.

Beam cage fabricated from horizontally installed "U" shaped steel channels (25 ga steel 1 11/16" wide with 1" legs) located not less than 1/2" from beam flanges. Upper channels secured to steel deck units with 1/2" Type S pan head screws 12" o.c. "U" shaped brackets formed of steel channels 24" o.c. suspended from the upper channels with 1/2" Type S pan head screws and supported steel channels installed at lower corners of brackets. Outside corners of gypsum board protected by 0.020" thick metal cornerbeads crimped or nailed. Minimum beam size W8x24. **(Two hour restrained or unrestrained beam.)**

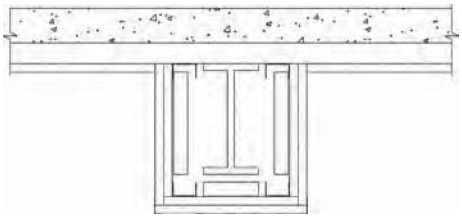

Fire Test: UL R4024-5, 9-14-66; UL Design N502; ULC Design O502

**Contact the manufacturer for more detailed information on proprietary products.*

BEAMS, GIRDERS, AND TRUSSES, NONCOMBUSTIBLE

GA FILE NO. BM 2221 — GENERIC — 2 HOUR FIRE

METAL LATH, GYPSUM PLASTER

1 1/8" 1:2 mill-mixed gypsum-perlite plaster applied over 3.4 lb. diamond mesh metal lath attached to beam flange with 11 ga steel clips 9" o.c. 1" space between beam bottom flange and lath. Minimum beam size W8x24. **(Two hour restrained beam.)**

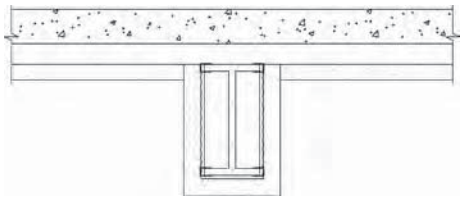

Fire Test: UL R4197-1, 1-29-59

GA FILE NO. BM 3110 — GENERIC — 3 HOUR FIRE

METAL LATH, GYPSUM PLASTER

1 1/4" 1:2 mill-mixed gypsum-perlite plaster applied over 3.4 lb. diamond mesh metal lath attached to beam flange with 11 ga steel clips 9" o.c. Minimum beam size W8x24. **(Three hour restrained beam.)**

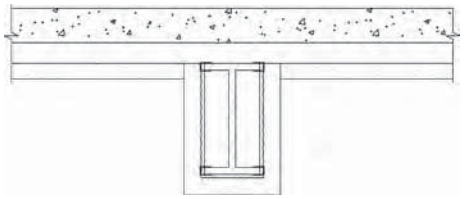

Fire Test: UL R4197-1, 1-29-59

GA FILE NO. BM 3212 — PROPRIETARY* — 3 HOUR FIRE

CEILING MEMBRANE FIREPROOFING, METAL CHANNELS, GYPSUM WALLBOARD

One layer 5/8" proprietary type X gypsum wallboard or gypsum veneer base applied at right angles to furring channels 24" o.c. (double channels at end joints) with 1" Type S drywall screws 12" o.c. 5/8" x 2 3/4" type X gypsum wallboard strips over butt joints. Furring channels wire tied to open web steel joists 24" o.c. supporting 3/8" rib metal lath and 2 1/2" concrete slab. Minimum beam size W8x35. **(Three hour unrestrained beam.)**

(See GA File No. FC 3012)

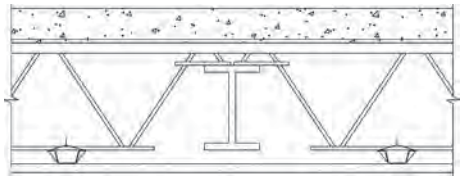

PROPRIETARY GYPSUM BOARD

American Gypsum Company LLC	-	5/8" FireBloc® Type C
CertainTeed Gypsum Inc.	-	5/8" CertainTeed® Type C Gypsum Board
Georgia Pacific Gypsum LLC	-	5/8" ToughRock® Fireguard C® Gypsum Board
Lafarge North America Inc.	-	5/8" Firecheck® Type C
National Gypsum Company	-	5/8" Gold Bond® Brand FIRE-SHIELD C™ Gypsum Board
PABCO Gypsum	-	5/8" FLAME CURB® Super 'C'™
Temple-Inland	-	5/8" TG-C
United States Gypsum Company	-	5/8" SHEETROCK® Brand FIRECODE® C Core Gypsum Panels

Fire Test: UL R1319-79, 4-14-65 (Rev. 4-4-77); UL R3501, 88NK21023, 11-27-89; Based on UL R3660-7, -8, 11-12-87; UL R2717-61, 8-18-87; UL Design G512

GA FILE NO. BM 3310 — GENERIC — 3 HOUR FIRE

CEILING MEMBRANE FIREPROOFING, METAL CHANNELS, GYPSUM WALLBOARD

One layer 1/2" type X gypsum wallboard or gypsum veneer base applied at right angles to rigid furring channels 24" o.c. with 1" Type S drywall screws 12" o.c. Gypsum board end joints located midway between continuous channels and attached to additional pieces of channel 54" long with screws 12" o.c. Furring channels 24" o.c. attached with 18 ga wire ties 48" o.c. to open web steel joists 24" o.c. supporting 3/8" rib metal lath or 9/16" deep 28 ga corrugated steel and 2 1/2" concrete slab measured from top of flute. Furring channels may be attached to 1 1/2" cold rolled carrying channels 48" o.c. suspended from joists by 8 ga wire hangers not over 48" o.c. Minimum beam size W8x31. **(Three hour unrestrained beam.)**

(See GA File No. FC 2030)

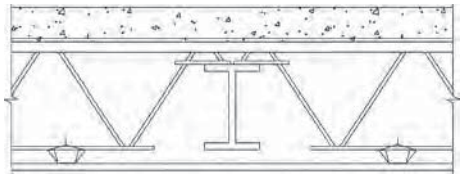

Fire Test: UL R3501, 66K3415, 7-22-66, UL Design G514

**Contact the manufacturer for more detailed information on proprietary products.*

BEAMS, GIRDERS, AND TRUSSES, NONCOMBUSTIBLE

GA FILE NO. BM 4310 — GENERIC — 4 HOUR FIRE

GYPSUM PLASTER, METAL LATH

1½" 1:2 gypsum-perlite plaster applied over 3.4 lb. self-furring diamond mesh metal lath tied with 18 ga wire 6" o.c. and held ¼" from steel. Minimum beam size W12x58. **(Four hour unrestrained beam.)**

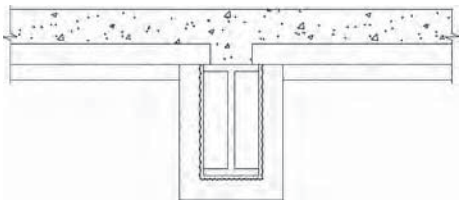

Fire Test: UL R3413-4, 7-1-53, UL Design D404

GA FILE NO. BM 4320 — GENERIC — 4 HOUR FIRE

GYPSUM PLASTER, METAL LATH

1½" 1:2½ gypsum-perlite plaster applied over 3.4 lb. diamond mesh metal lath tied with 18 ga galvanized wire 4" o.c. to floor units and 6" o.c. to No. 6 ga lath hangers 22" to 28" o.c. wrapped completely around beam. Minimum beam size W12x27. **(Four hour unrestrained beam.)**

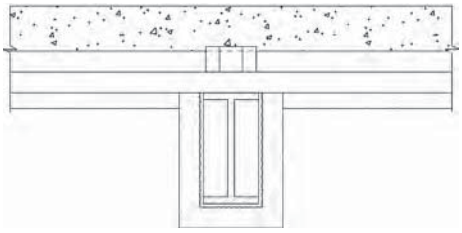

Fire Test: UL R3789-1, 10-3-56, UL Design A406

GA FILE NO. BM 4410 — GENERIC — 4 HOUR FIRE

GYPSUM PLASTER, METAL LATH

¾" 1:2 mill-mixed gypsum-perlite plaster applied over 3.4 lb. diamond mesh metal lath wire tied to ¾" cold rolled channels 12" o.c. with 18 ga wire. Channels wire tied with 8 ga wire to 1½" cold rolled carrying channels 48" o.c. suspended from steel deck and 2" concrete slab. 3½" minimum clearance from lower beam flange to top of ceiling. Minimum beam size W12x27. **(Four hour unrestrained beam.)**

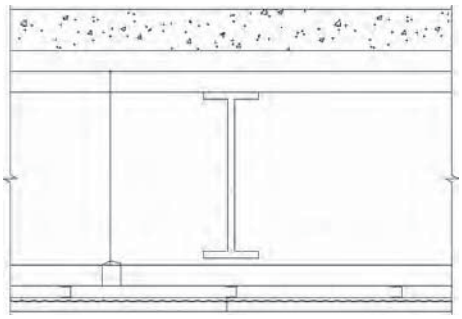

Fire Test: UL R3574-6, 7-25-57, UL Design A403

GA FILE NO. BM 4420 — GENERIC — 4 HOUR FIRE

GYPSUM PLASTER, METAL LATH

⅞" 1:2-1:3 gypsum-perlite plaster applied over 3.4 lb. diamond mesh metal lath tied to ¾" cold rolled channels 12" o.c. with 18 ga wire. Channels wire tied to 1½" cold rolled carrying channels 36" o.c. suspended with 8 ga hanger wire 48" o.c. from cellular steel deck and 2" concrete slab. Minimum clearance 3½" from lower beam flange to top of ceiling. Minimum beam size W12x27. **(Four hour unrestrained beam.)**

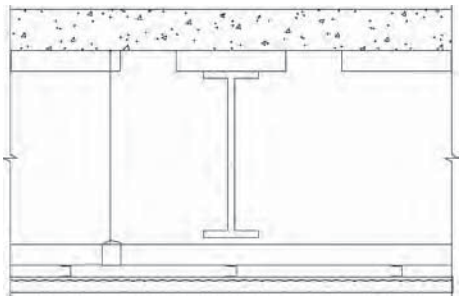

Fire Test: UL R3355-1, 4-30-51, UL Design A405

STRAIN RELIEF SYSTEMS - CONTROL JOINTS, WALLS, NONCOMBUSTIBLE

GA FILE NO. SRS 1101 | GENERIC | 1 HOUR FIRE

GYPSUM WALLBOARD STRIPS, CONTROL JOINT, STEEL STUDS

Two back-to-back steel studs framing the control joint and spaced 1⁷⁄₈" apart. Two strips of ⁵⁄₈" type X gypsum panel products applied to the back of one of the studs with 1⁵⁄₈" Type S drywall screws 24" o.c. Horizontal joints offset 24" between strips. Gypsum strips are the same width as the stud depth and extend the full height of the wall with a ⁵⁄₈" space between the back of the second strip and the back of the opposite stud. Gypsum panel products applied to the faces of the studs as specified in the listing for the 1-hour fire-resistance rated wall or partition with a ¹⁄₂" control joint opening centered over the gypsum panel strips. Gypsum panel ends or edges on one side of the control joint attached to one stud and gypsum panel ends or edges on the other side of the joint attached to the second stud. A ¹⁄₂" metal or vinyl control joint accessory stapled to the wall on each side of the control joint opening. **(NLB)**

This control joint protection method is intended for use in any 1-hour fire-resistance rated nonload-bearing steel C-stud system in this Manual having a single row of studs. The wall system shall be constructed of the materials and in the manner described in the individual GA File Number.

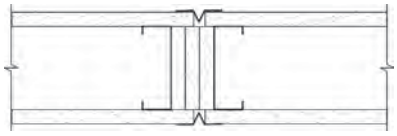

Fire Test: WHI-651-0318.1, 3-15-90 & 3-20-90; WHI-647-3024, 9-20-91

GA FILE NO. SRS 1201 | GENERIC | 2 HOUR FIRE

GYPSUM WALLBOARD STRIPS, CONTROL JOINT, STEEL STUDS

Two back-to-back steel studs framing the control joint and spaced 1⁷⁄₈" apart. Two strips of ⁵⁄₈" type X gypsum panel products applied to the back of one of the studs with 1⁵⁄₈" Type S drywall screws 24" o.c. Horizontal joints offset 24" between strips. Gypsum strips are the same width as the stud depth and extend the full height of the wall with a ⁵⁄₈" space between the back of the second strip and the back of the opposite stud. Gypsum panel products applied to the faces of the studs as specified in the listing for the 2-hour fire-resistance rated wall or partition with a ¹⁄₂" control joint opening centered over the gypsum panel strips. Gypsum panel ends or edges on one side of the control joint attached to one stud and gypsum panel ends or edges on the other side of the joint attached to the second stud. A ¹⁄₂" metal or vinyl control joint accessory stapled to the wall on each side of the control joint opening. **(NLB)**

This control joint protection method is intended for use in any 2-hour fire-resistance rated nonload-bearing steel C-stud system in this Manual having a single row of studs. The wall system shall be constructed of the materials and in the manner described in the individual GA File Number.

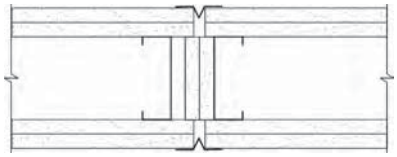

Fire Test: WHI-651-0318.1, 3-15-90 & 3-20-90

GA FILE NO. SRS 1401 | GENERIC | 4 HOUR FIRE

GYPSUM WALLBOARD STRIPS, CONTROL JOINT, STEEL STUDS

Two back-to-back steel studs framing the control joint and spaced 2¹⁄₈" apart. Two strips of ³⁄₄" type X gypsum panel products applied to the back of one of the studs. **First** strip applied with 1¹⁄₄" Type S drywall screws 8" o.c. **Second** strip applied with 2" Type S drywall screws 8" o.c. Horizontal joints offset 24" between strips. Gypsum strips are the same width as the stud depth and extend the full height of the wall with a maximum ³⁄₄" space between the back of the second strip and the back of the opposite stud. Gypsum panel products applied to the faces of the studs as specified in the listing for the 4-hour fire-resistance rated wall or partition with a ¹⁄₂" control joint opening centered over the gypsum panel strips. Gypsum panel ends or edges on one side of the control joint attached to one stud and gypsum panel ends or edges on the other side of the joint attached to the second stud. A ¹⁄₂" metal or vinyl control joint accessory stapled to the wall on each side of the control joint opening. **(NLB)**

This control joint protection method is intended for use in any 3 or 4-hour fire-resistance rated nonload-bearing steel C-stud system in this Manual having a single row of studs. The wall system shall be constructed of the materials and in the manner described in the individual GA File Number.

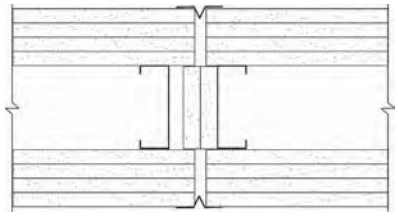

Fire Test: UL R1319, 02NK41607, 9-27-02

STRAIN RELIEF SYSTEMS - CONTROL JOINTS, WALLS, WOOD FRAMED

GA FILE NO. SRS 2101 | **GENERIC** | **1 HOUR FIRE**

GYPSUM WALLBOARD STRIPS, CONTROL JOINT, WOOD STUDS

Two back-to-back 2 x 4 wood studs framing the control joint and spaced 2½" apart. Three strips of ⅝" type X gypsum panel products applied to the side of one of the studs with either 2⅝" Type W or S drywall screws or 8d coated nails 24" o.c. Horizontal joints offset 24" between strips. Gypsum strips are the same width as the stud depth and extend the full height of the wall cavity with a ⅝" space between the back of the third strip and the side of the opposite stud. Gypsum panel products applied to the faces of the studs as specified in the listing for the 1-hour fire-resistance rated wall or partition with a ½" control joint opening centered over the gypsum panel strips. Gypsum panel ends or edges on one side of the control joint attached to one stud and gypsum panel ends or edges on the other side of the joint attached to the second stud. A ½" metal or vinyl control joint accessory stapled to the wall on each side of the control joint opening. **(LOAD-BEARING)**

This control joint protection method is intended for use in any 1-hour fire-resistance rated wood stud system in this Manual having a single row of studs. The wall system shall be constructed of the materials and in the manner described in the individual GA File Number.

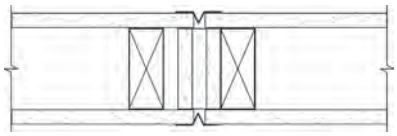

Fire Test: WHI-651-0318.1, 3-15-90 & 3-20-90; WHI-647-3024, 9-20-91

GA FILE NO. SRS 2201 | **GENERIC** | **2 HOUR FIRE**

GYPSUM WALLBOARD STRIPS, CONTROL JOINT, WOOD STUDS

Two back-to-back 2 x 4 wood studs framing the control joint and spaced 2½" apart. Three strips of ⅝" type X gypsum panel products applied to the side of one of the studs with either 2⅝" Type W or S drywall screws or 8d coated nails 24" o.c. Horizontal joints offset 24" between strips. Gypsum strips are the same width as the stud depth and extend the full height of the wall cavity with a ⅝" space between the back of the third strip and the side of the opposite stud. Gypsum panel products applied to the faces of the studs as specified in the listing for the 2-hour fire-resistance rated wall or partition with a ½" control joint opening centered over the gypsum panel strips. Gypsum panel ends or edges on one side of the control joint attached to one stud and gypsum panel ends or edges on the other side of the joint attached to the second stud. A ½" metal or vinyl control joint accessory stapled to the wall on each side of the control joint opening. **(LOAD-BEARING)**

This control joint protection method is intended for use in any 2-hour fire-resistance rated wood stud system in this Manual having a single row of studs. The wall system shall be constructed of the materials and in the manner described in the individual GA File Number.

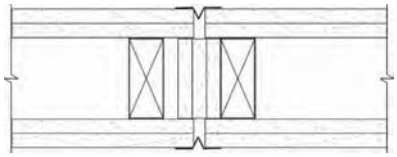

Fire Test: WHI-651-0318.1, 3-15-90 & 3-20-90; WHI-647-3024, 9-20-91

This Space Left Blank

STRAIN RELIEF SYSTEMS - CONTROL JOINTS, CEILING, WOOD FRAMED

GA FILE NO. SRS 5101 | **GENERIC** | **1 HOUR FIRE**

GYPSUM WALLBOARD STRIPS, CONTROL JOINT PARALLEL TO FRAMING, WOOD JOISTS, I-JOISTS, OR TRUSSES

Two back-to-back wood joists, I-joists, or trusses framing the control joint and spaced 4" apart. Single 3½" wide strip of ⅝" type X gypsum wallboard attached to the back face of the gypsum board ceiling membrane along one side of the control joint opening with 1½" Type G drywall screws 24" o.c. Gypsum panel products applied to the ceiling as specified in the listing for the 1-hour fire-resistance rated floor- or roof-ceiling system with a ½" control joint opening centered over the backing strip. Gypsum panel ends or edges on one side of the control joint attached to one ceiling framing member and gypsum panel ends or edges on the other side of the joint attached to the second ceiling framing member. A ½" metal or vinyl control joint accessory stapled to the ceiling on each side of the control joint opening. **(NLB)**

This control joint protection method is intended for use in any 1-hour fire-resistance rated wood framed system in this Manual. The floor-ceiling or roof-ceiling system shall be constructed of the materials and in the manner described in the individual GA File Number.

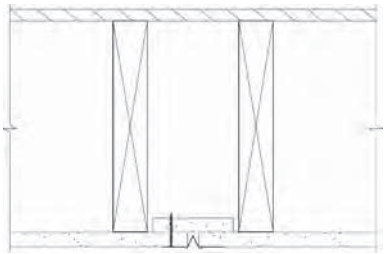

Fire Test: UL R4024, 97NK13566, 7-29-96

GA FILE NO. SRS 5102 | **GENERIC** | **1 HOUR FIRE**

GYPSUM WALLBOARD STRIPS, CONTROL JOINT PARALLEL TO JOISTS, RIGID FURRING CHANNELS, WOOD JOISTS, I-JOISTS, OR TRUSSES

Two back-to-back wood joists, I-joists, or trusses framing the control joint and spaced 4" apart. Rigid furring channels applied at right angles to ceiling framing with ends at control joint opening cantilevered ¼" into 4" space. Single 3½" wide strip of ⅝" type X gypsum wallboard attached to the back face of the gypsum board ceiling membrane along one side of the control joint opening with 1½" Type G drywall screws 24" o.c. Gypsum panel products applied to the ceiling as specified in the listing for the 1-hour fire-resistance rated floor- or roof-ceiling system with a ½" control joint opening centered over the backing strip. Gypsum panel ends or edges on one side of the control joint attached to one furring channel and gypsum panel ends or edges on the other side of the joint attached to the opposing furring channel. A ½" metal or vinyl control joint accessory stapled to the ceiling on each side of the control joint opening. **(NLB)**

This control joint protection method is intended for use in any 1-hour fire-resistance rated wood framed system in this Manual. The floor-ceiling or roof-ceiling system shall be constructed of the materials and in the manner described in the individual GA File Number.

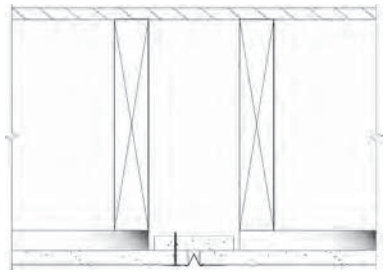

Fire Test: UL R4024, 97NK2136, 2-7-97

GA FILE NO. SRS 5103 | **GENERIC** | **1 HOUR FIRE**

GYPSUM WALLBOARD STRIPS, CONTROL JOINT PARALLEL TO FURRING, RIGID FURRING CHANNELS, WOOD JOISTS, I-JOISTS, OR TRUSSES

Rigid furring channels applied at right angles to wood joists, I-joists, or trusses with two furring channels framing the control joint and spaced 4" apart. Single 3½" wide strip of ⅝" type X gypsum wallboard attached to the back face of the gypsum board ceiling membrane along one side of the control joint opening with 1½" Type G drywall screws 24" o.c. Gypsum panel products applied to the ceiling as specified in the listing for the 1-hour fire-resistance rated floor- or roof-ceiling system with a ½" control joint opening centered over the backing strip. Gypsum panel ends or edges on one side of the control joint attached to one furring channel and gypsum panel ends or edges on the other side of the joint attached to the second furring channel. A ½" metal or vinyl control joint accessory stapled to the ceiling on each side of the control joint opening. **(NLB)**

This control joint protection method is intended for use in any 1-hour fire-resistance rated wood framed system in this Manual. The floor-ceiling or roof-ceiling system shall be constructed of the materials and in the manner described in the individual GA File Number.

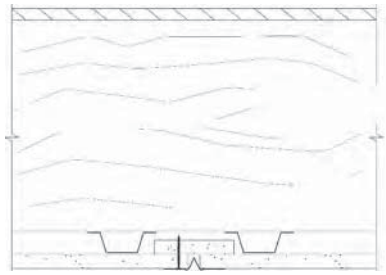

Fire Test: UL R4024, 97NK13566, 7-29-96

STRAIN RELIEF SYSTEMS - CONTROL JOINTS, CEILING, SUSPENDED

GA FILE NO. SRS 5104 | **GENERIC** | **1 HOUR FIRE**

GYPSUM WALLBOARD STRIPS, CONTROL JOINT, COLD ROLLED CHANNELS, RIGID FURRING CHANNELS

Suspended cold rolled channels installed to extend 6" beyond control joint location and overlapping in opposite directions. Rigid furring channels wire tied at right angles to cold rolled channels with two furring channels framing the control joint and spaced 4" apart. Single 3½" wide strip of ⅝" type X gypsum wallboard attached to the back face of the gypsum board ceiling membrane along one side of the control joint opening with 1½" Type G drywall screws 24" o.c. Gypsum panel products applied to the ceiling as specified in the listing for the 1-hour fire-resistance rated floor- or roof-ceiling system with a ½" control joint opening centered over the backing strip. Gypsum panel ends or edges on one side of the control joint attached to one furring channel and gypsum panel ends or edges on the other side of the joint attached to the second furring channel. A ½" metal or vinyl control joint accessory stapled to the ceiling on each side of the control joint opening. **(NLB)**

This control joint protection method is intended for use in any 1-hour fire-resistance rated wood framed system in this Manual. The floor-ceiling or roof-ceiling system shall be constructed of the materials and in the manner described in the individual GA File Number.

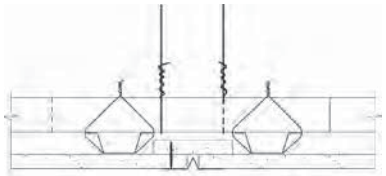

Fire Test: UL R4024, 97NK13566, 7-29-96

This Space Left Blank

STRAIN RELIEF SYSTEMS - PERIMETER RELIEF, HEAD OF WALL

GA FILE NO. SRS 7101 | **GENERIC** | **1 HOUR FIRE**

STEEL RUNNER (TRACK), STEEL STUDS, DRYWALL TRIM, FLEXIBLE SEALANT

Steel top track with minimum 1" lip attached to the ceiling or deck. Steel studs cut 1/2" short and positioned into top track leaving a 1/2" space between the top of the stud and the web of the track. Gypsum panels applied to the wall as specified in the listing for the 1-hour fire-resistance rated system leaving a 1/2" space between the top edge of the gypsum board and the ceiling or deck. The first row of screws in each layer of gypsum panel products is located not less than 1/2" below the lip of the drywall track applied to the ceiling. Drywall J-bead applied to top edge of face layer of gypsum panel products. Minimum 1/2" of flexible sealant applied in space between the top edge of the gypsum board and the ceiling or deck. **(NLB)**

This perimeter relief system is intended for use in any 1-hour fire-resistance steel stud system in this Manual using a single row of studs. The wall system shall be constructed of the materials and in the manner described in the individual GA File Number.



Fire Test: FM WP-163, 6-18-69

GA FILE NO. SRS 7201 | **GENERIC** | **2 HOUR FIRE**

STEEL RUNNER (TRACK), STEEL STUDS, DRYWALL TRIM, FLEXIBLE SEALANT

Steel top track with minimum 1" legs attached to the ceiling or deck. Steel studs cut 1/2" short and positioned into top track leaving a 1/2" space between the top of the stud and the web of the track. Gypsum panels applied to the wall as specified in the listing for the 2-hour fire-resistance rated system leaving a 1/2" space between the top edge of the gypsum board and the ceiling or deck. The first row of screws in each layer of gypsum panel products is located not less than 1/2" below the lip of the drywall track applied to the ceiling. Drywall J-bead applied to top edge of face layer of gypsum panel products. Minimum 1/2" of flexible sealant applied in space between the top edge of the gypsum board and the ceiling or deck. **(NLB)**

This perimeter relief system is intended for use in any 2-hour fire-resistance steel stud system in this Manual using a single row of studs. The wall system shall be constructed of the materials and in the manner described in the individual GA File Number.



Fire Test: FM WP-163, 6-18-69

GA FILE NO. SRS 7202 | **GENERIC** | **2 HOUR FIRE**

STEEL RUNNER (TRACK), SEMI-SOLID GYPSUM STUDS, MINERAL FIBER, DRYWALL TRIM, FLEXIBLE SEALANT

Field fabricated steel slip-track consisting of an outer track with 1" legs attached to the ceiling or deck with 1/2" thick mineral fiber strips friction fit into track flat against track web and an inner track with 1 3/8" legs nested inside the outer track touching but not compressing the mineral fiber. Gypsum studs extending full height and touching the legs of the inner track. Gypsum panels applied to the wall as specified in the listing for the fire-resistance rated system and overlapping the slip-track leaving a 1/2" space between the top edge of the gypsum board and the ceiling or deck. The first row of screws in each layer of gypsum panel products is located not less than 1/2" below the legs of the inner track. Drywall J-bead applied to top edge of face layer of gypsum panel products. Flexible sealant applied to fill the space between the top edge of the gypsum board and the ceiling or deck. **(NLB)**

This perimeter relief system is intended for use in any 1 or 2-hour fire-resistance steel stud system in this Manual using a single row of studs. The wall system shall be constructed of the materials and in the manner described in the individual GA File Number.



Fire Test: UL R4024-7-8, 65C3200, 6-23-66

STRAIN RELIEF SYSTEMS - PERIMETER RELIEF, WALL-TO-WALL

GA FILE NO. SRS 8101 | **GENERIC** | **1 HOUR FIRE**

STEEL STUDS, DRYWALL TRIM, FLEXIBLE SEALANT

Top and bottom track positioned to leave a 1/2" space between the end of the track and the through wall into which it abuts. Steel track with 1" flange applied vertically full height to through wall. Mineral fiber strips, 1/2" thick friction fit full height against web of vertical track. End stud nested into vertical track and positioned to be in contact with but not compress the mineral fiber strips. Gypsum panels applied to the wall as specified in the listing for the 1-hour fire-resistance rated system leaving a 1/2" space between the gypsum board edge at the end of the wall. Drywall J-bead applied to edge of the gypsum board forming the 1/2" space at the end of the wall. Minimum 1/2" of flexible sealant applied in the space between the J-bead and the through wall. **(NLB)**

This perimeter relief system is intended for use in any 1-hour fire-resistance steel stud system in this Manual using a single row of studs. The wall system shall be constructed of the materials and in the manner described in the individual GA File Number. Screws attaching gypsum panels and J-trim to end stud shall be located not less than 1/2" from flange of track to allow for movement.

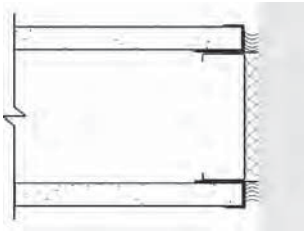

Fire Test: FM WP-163, 6-18-69

GA FILE NO. SRS 8201 | **GENERIC** | **2 HOUR FIRE**

STEEL STUDS, DRYWALL TRIM, FLEXIBLE SEALANT

Top and bottom track positioned to leave a 1/2" space between the end of the track and the through wall into which it abuts. Steel track with 1" flange applied vertically full height to through wall. Mineral fiber strips, 1/2" thick friction fit full height against web of vertical track. End stud nested into vertical track and positioned to be in contact with but not compress the mineral fiber strips. Gypsum panels applied to the wall as specified in the listing for the 2-hour fire-resistance rated system leaving a 1/2" space between the gypsum board edge at the end of the wall. Drywall J-bead applied to edge of the gypsum board forming the 1/2" space at the end of the wall. Minimum 1/2" of flexible sealant applied in the space between the J-bead and the through wall. **(NLB)**

This perimeter relief system is intended for use in any 2-hour fire-resistance steel stud system in this Manual using a single row of studs. The wall system shall be constructed of the materials and in the manner described in the individual GA File Number. Screws attaching gypsum panels and J-trim to end stud shall be located not less than 1/2" from flange of track to allow for movement.

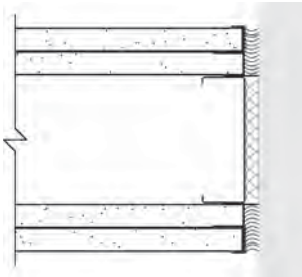

Fire Test: FM WP-163, 6-18-69

This Space Left Blank

APPENDIX

COMMONLY USED METRIC CONVERSIONS

Gypsum Panel Product Thickness

1/4 in. - 6.4 mm
3/8 in. - 9.5 mm
1/2 in. - 12.7 mm
5/8 in. - 15.9 mm
3/4 in. - 19.0 mm
1 in. - 25.4 mm

Framing Spacing

8 in. - 203 mm
12 in. - 305 mm
16 in. - 406 mm
24 in. - 610 mm

Fastener Spacing

2 in. - 51 mm
2 1/2 in. - 64 mm
7 in. - 178 mm
8 in. - 203 mm
12 in. - 305 mm
16 in. - 406 mm
24 in. - 610 mm

Temperature

40°F - 5°C
50°F - 10°C
125°F - 52°C

NOTES

GYPSUM ASSOCIATION
6525 Belcrest Road, #480
Hyattsville, MD 20782
301-277-8686
Fax: 301-277-8747
E-mail: info@gypsum.org
http://www.gypsum.org

AMERICAN GYPSUM COMPANY LLC

CERTAINTEED GYPSUM, INC.

CERTAINTEED GYPSUM CANADA, INC.

CGC INC.

GEORGIA - PACIFIC GYPSUM LLC

LAFARGE NORTH AMERICA INC.

NATIONAL GYPSUM COMPANY

PABCO® GYPSUM
a division of PABCO® building products, LLC

TEMPLE - INLAND

UNITED STATES GYPSUM COMPANY

GYPSUM ASSOCIATION 69 GYPSUM DRYWALL
JUNE 2012

GYPSUM ASSOCIATION

Gypsum Association
6525 Belcrest Road, Suite 480
Hyattsville, MD 20782

301.277.8686
Fax: 301.277.8747
E-mail: info@gypsum.org
http://www.gypsum.org